


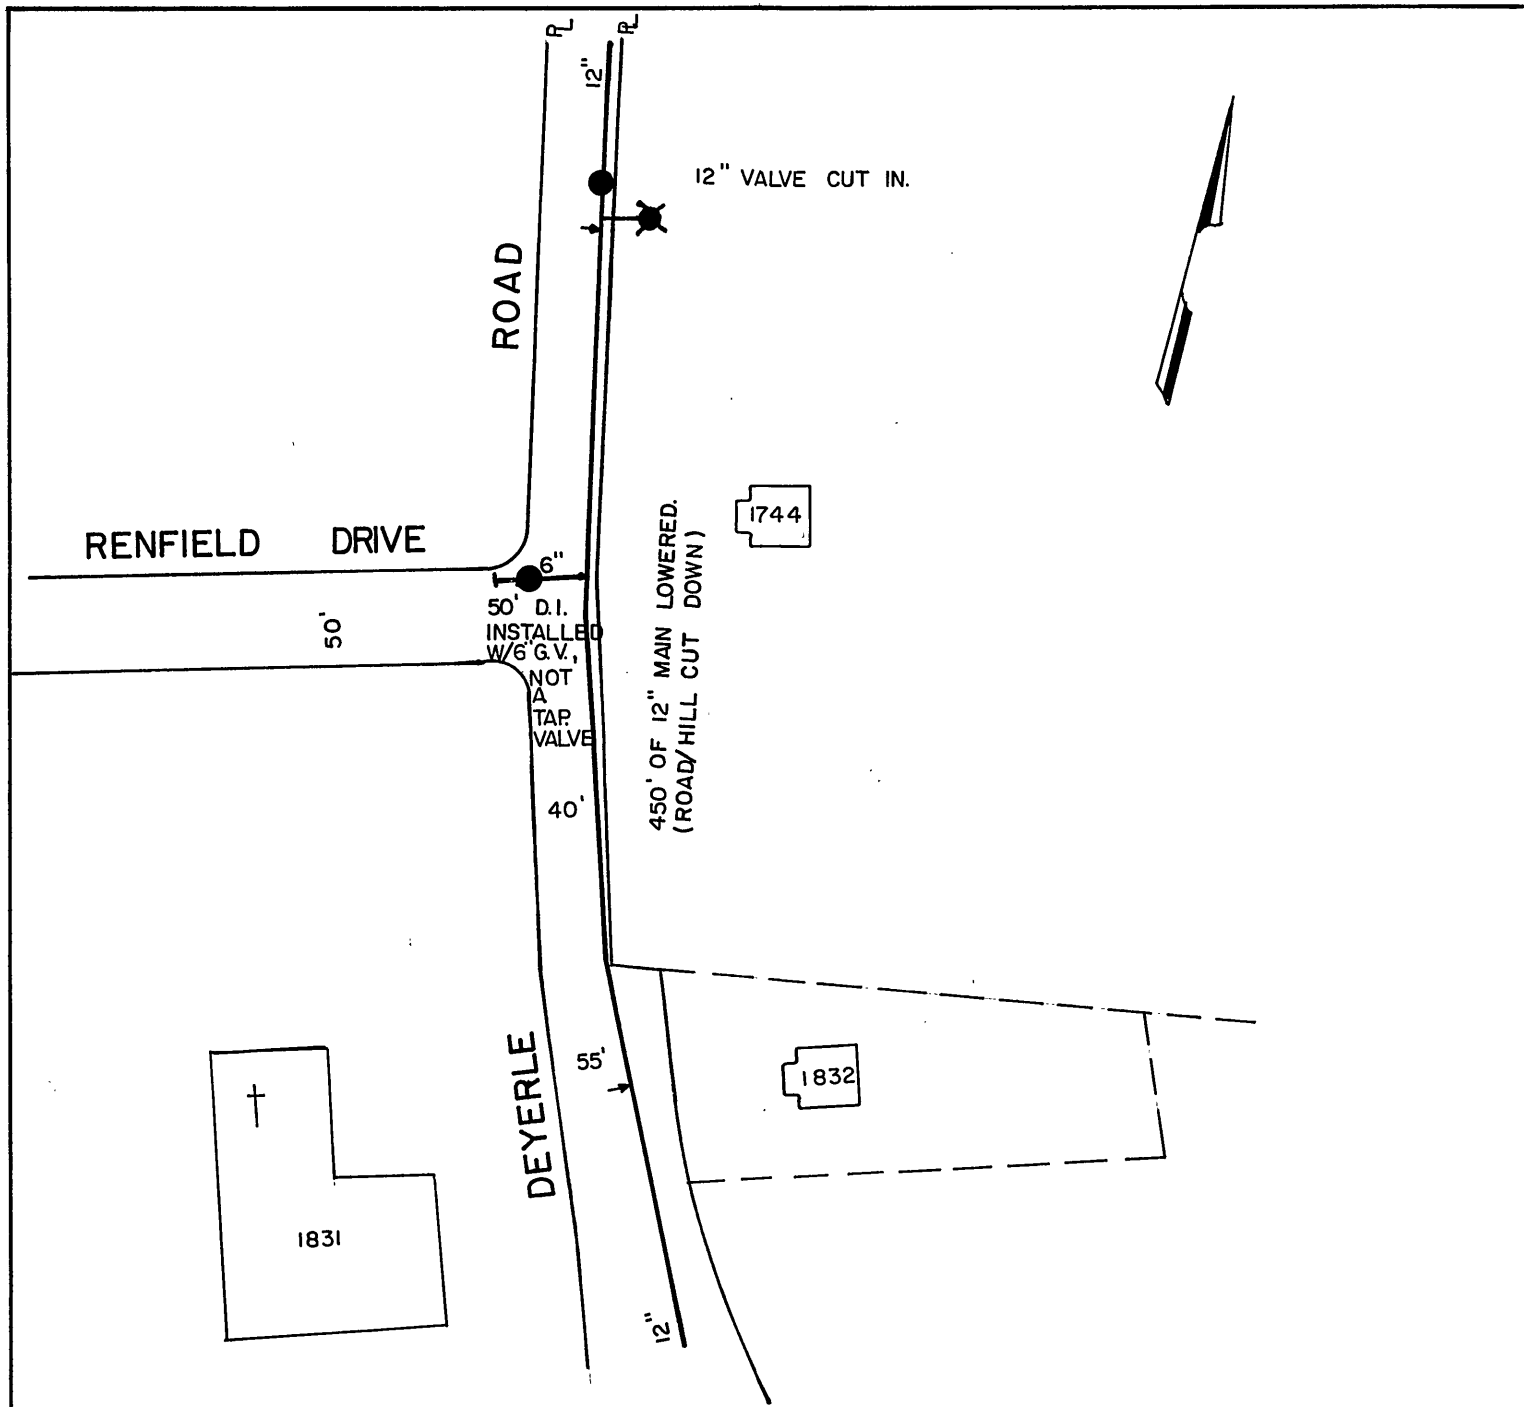

DATE STARTED		5-2-90			
DATE COMP.		5-15-90			
FEET MAIN	SIZE	VALVE	VAULT	BOX	
50'	6"	I	I		
	12"	I	I		
F.H. COMP.	☒				
F.H. STUB ONLY	☒				
SERV. INS. BY:					
MAIN INS. BY: CHUCK CLARK-U.L.S.					
NO. 3/4" SERV. INS.					
CITY OR CO. CITY					
DEPT. INSP. U.L.S.					

WATER DEPARTMENT	
ROANOKE	VIRGINIA
DEYERLE ROAD (MAIN LOWERED)	
RENFIELD DRIVE, S.W. (MAIN STUBBED)	
SCALE: 1" = 100'	DIRECTOR UTILITIES & OPERATIONS DATE
DATE: 11/15/91	
DIST. MAP: 507	
PLAN NO.: 90-20	DIRECTOR OF PUBLIC WORKS DATE