


NOTE :

1. TIE INTO EXIST. 6" MAIN.
2. INSTALL TAPPING SLEEVE & VALVE.
3. VERIFY ANY SERVICES CONNECTED TO 1 1/2" MAIN GOING THROUGH LOT 10. / YES
4. ABANDON 1 1/2" MAIN.
5. ABANDON 3/4" MAIN.
6. CONNECT 1 1/2" IF MAIN SERVES, TO PROPOSED 6" OTHERWISE, ABANDON. / YES

DATE STARTED 6-13-88				
DATE COMP. 6-29-88				
FEET MAIN	SIZE	VALVE	VAULT	BOX
930'	6"	1	1	
F.H. COMP. 1 #2				
F.H. STUB ONLY 0				
SERV. INS. BY:				
MAIN INS. BY: C.O. DAME				
NO. 14" SERV. INS.				
CITY OR CO. CITY				
DEPT. INSP. U.L.S.				

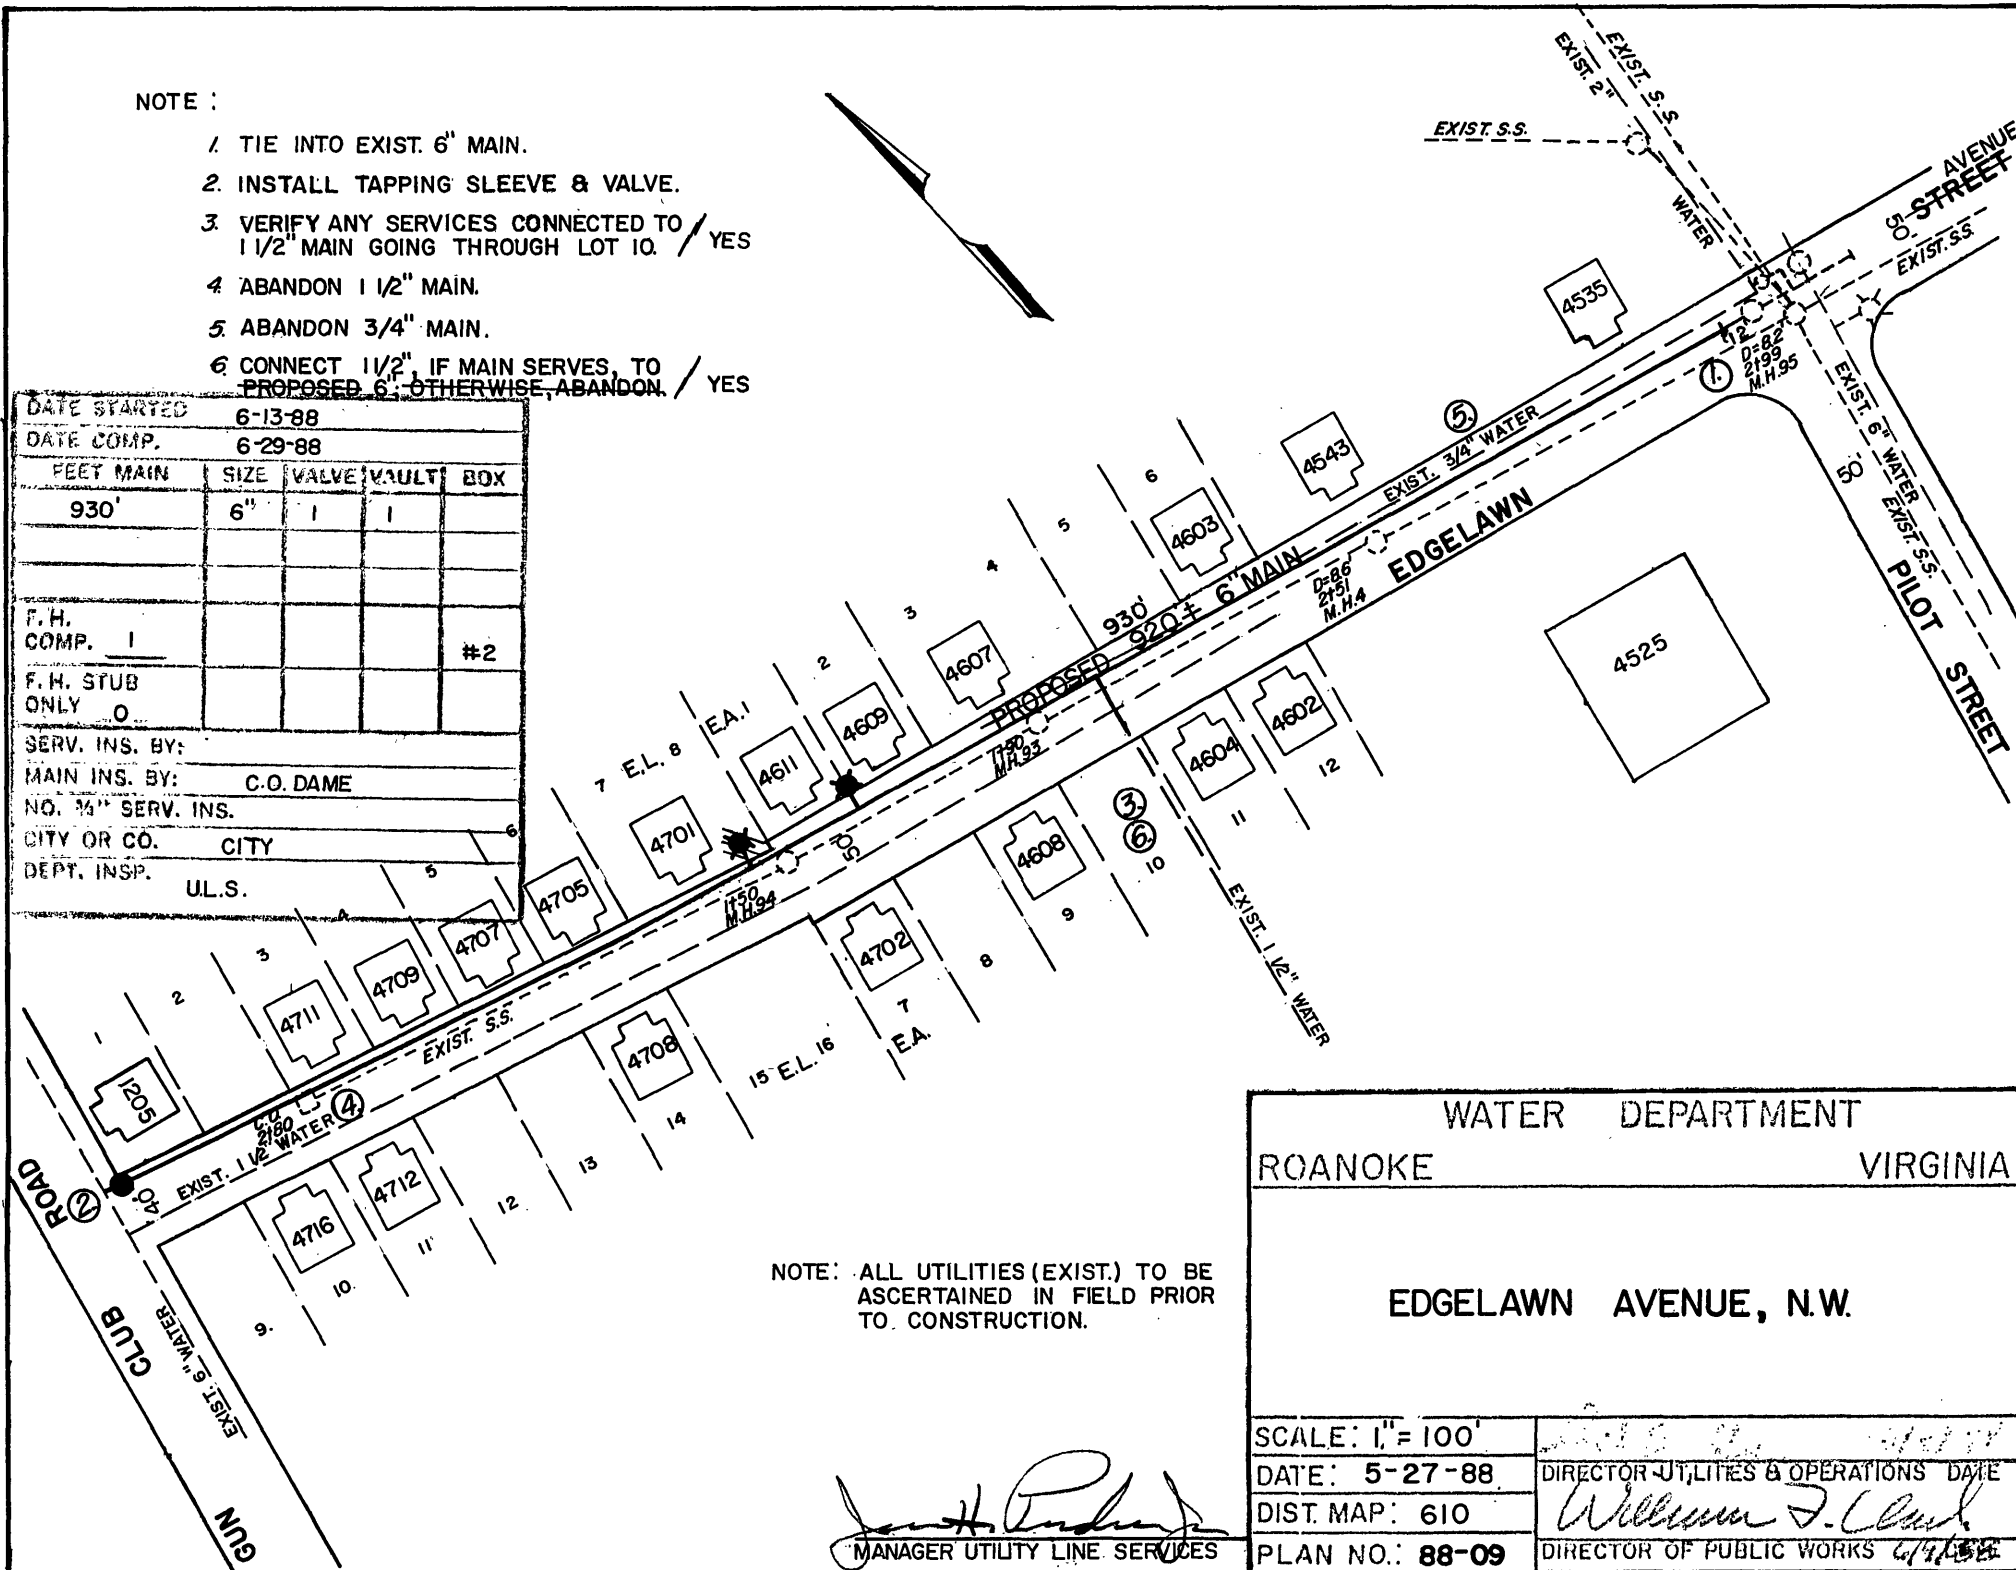

NOTE: ALL UTILITIES (EXIST.) TO BE ASCERTAINED IN FIELD PRIOR TO CONSTRUCTION.

WATER DEPARTMENT
ROANOKE VIRGINIA

EDGELOWN AVENUE, N.W.

SCALE: 1" = 100'

DATE: 5-27-88

DIST. MAP: 610

PLAN NO.: 88-09

DIRECTOR UTILITIES & OPERATIONS DATE

William F. Clark

DIRECTOR OF PUBLIC WORKS 6/1/88

John H. Anderson
MANAGER UTILITY LINE SERVICES