


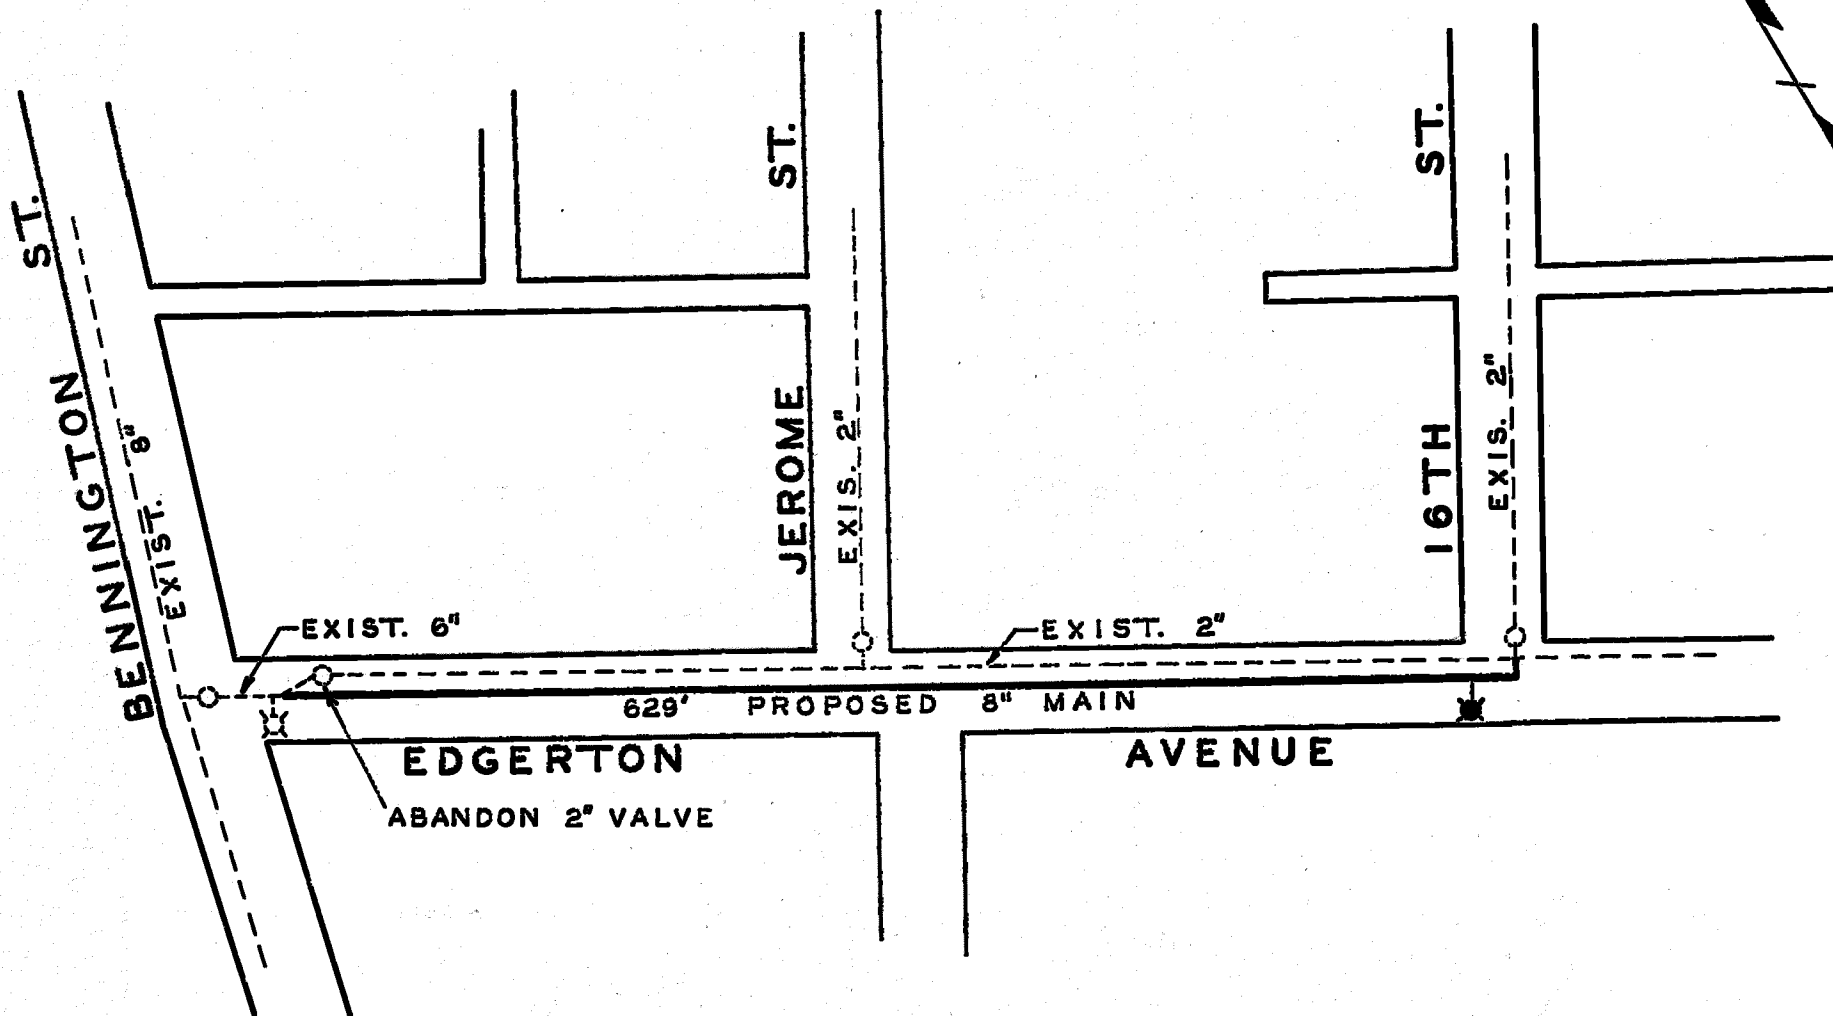

DATE STARTED OCT. 10. 1961				
DATE COMP. OCT. 23. 1961				
FEET MAIN	SIZE	VALVE	VAULT	BOX
629'	8"			
F. H. COMP. 1	6"	1-6"	1	
F. H. STUB ONLY				
SERV. INS. BY:				
MAINS INS. BY: BRH				
NO. 3/4" SERV. INS. NONE				
CITY OR CO. CITY				
DEPT. INSP.				

WATER DEPARTMENT
 CITY OF ROANOKE, VA.
 EDGERTON AVE. S. E.
 SCALE - 1" = 100'
 DRAWN BY N. H. C. SEPT. 15, 1961