
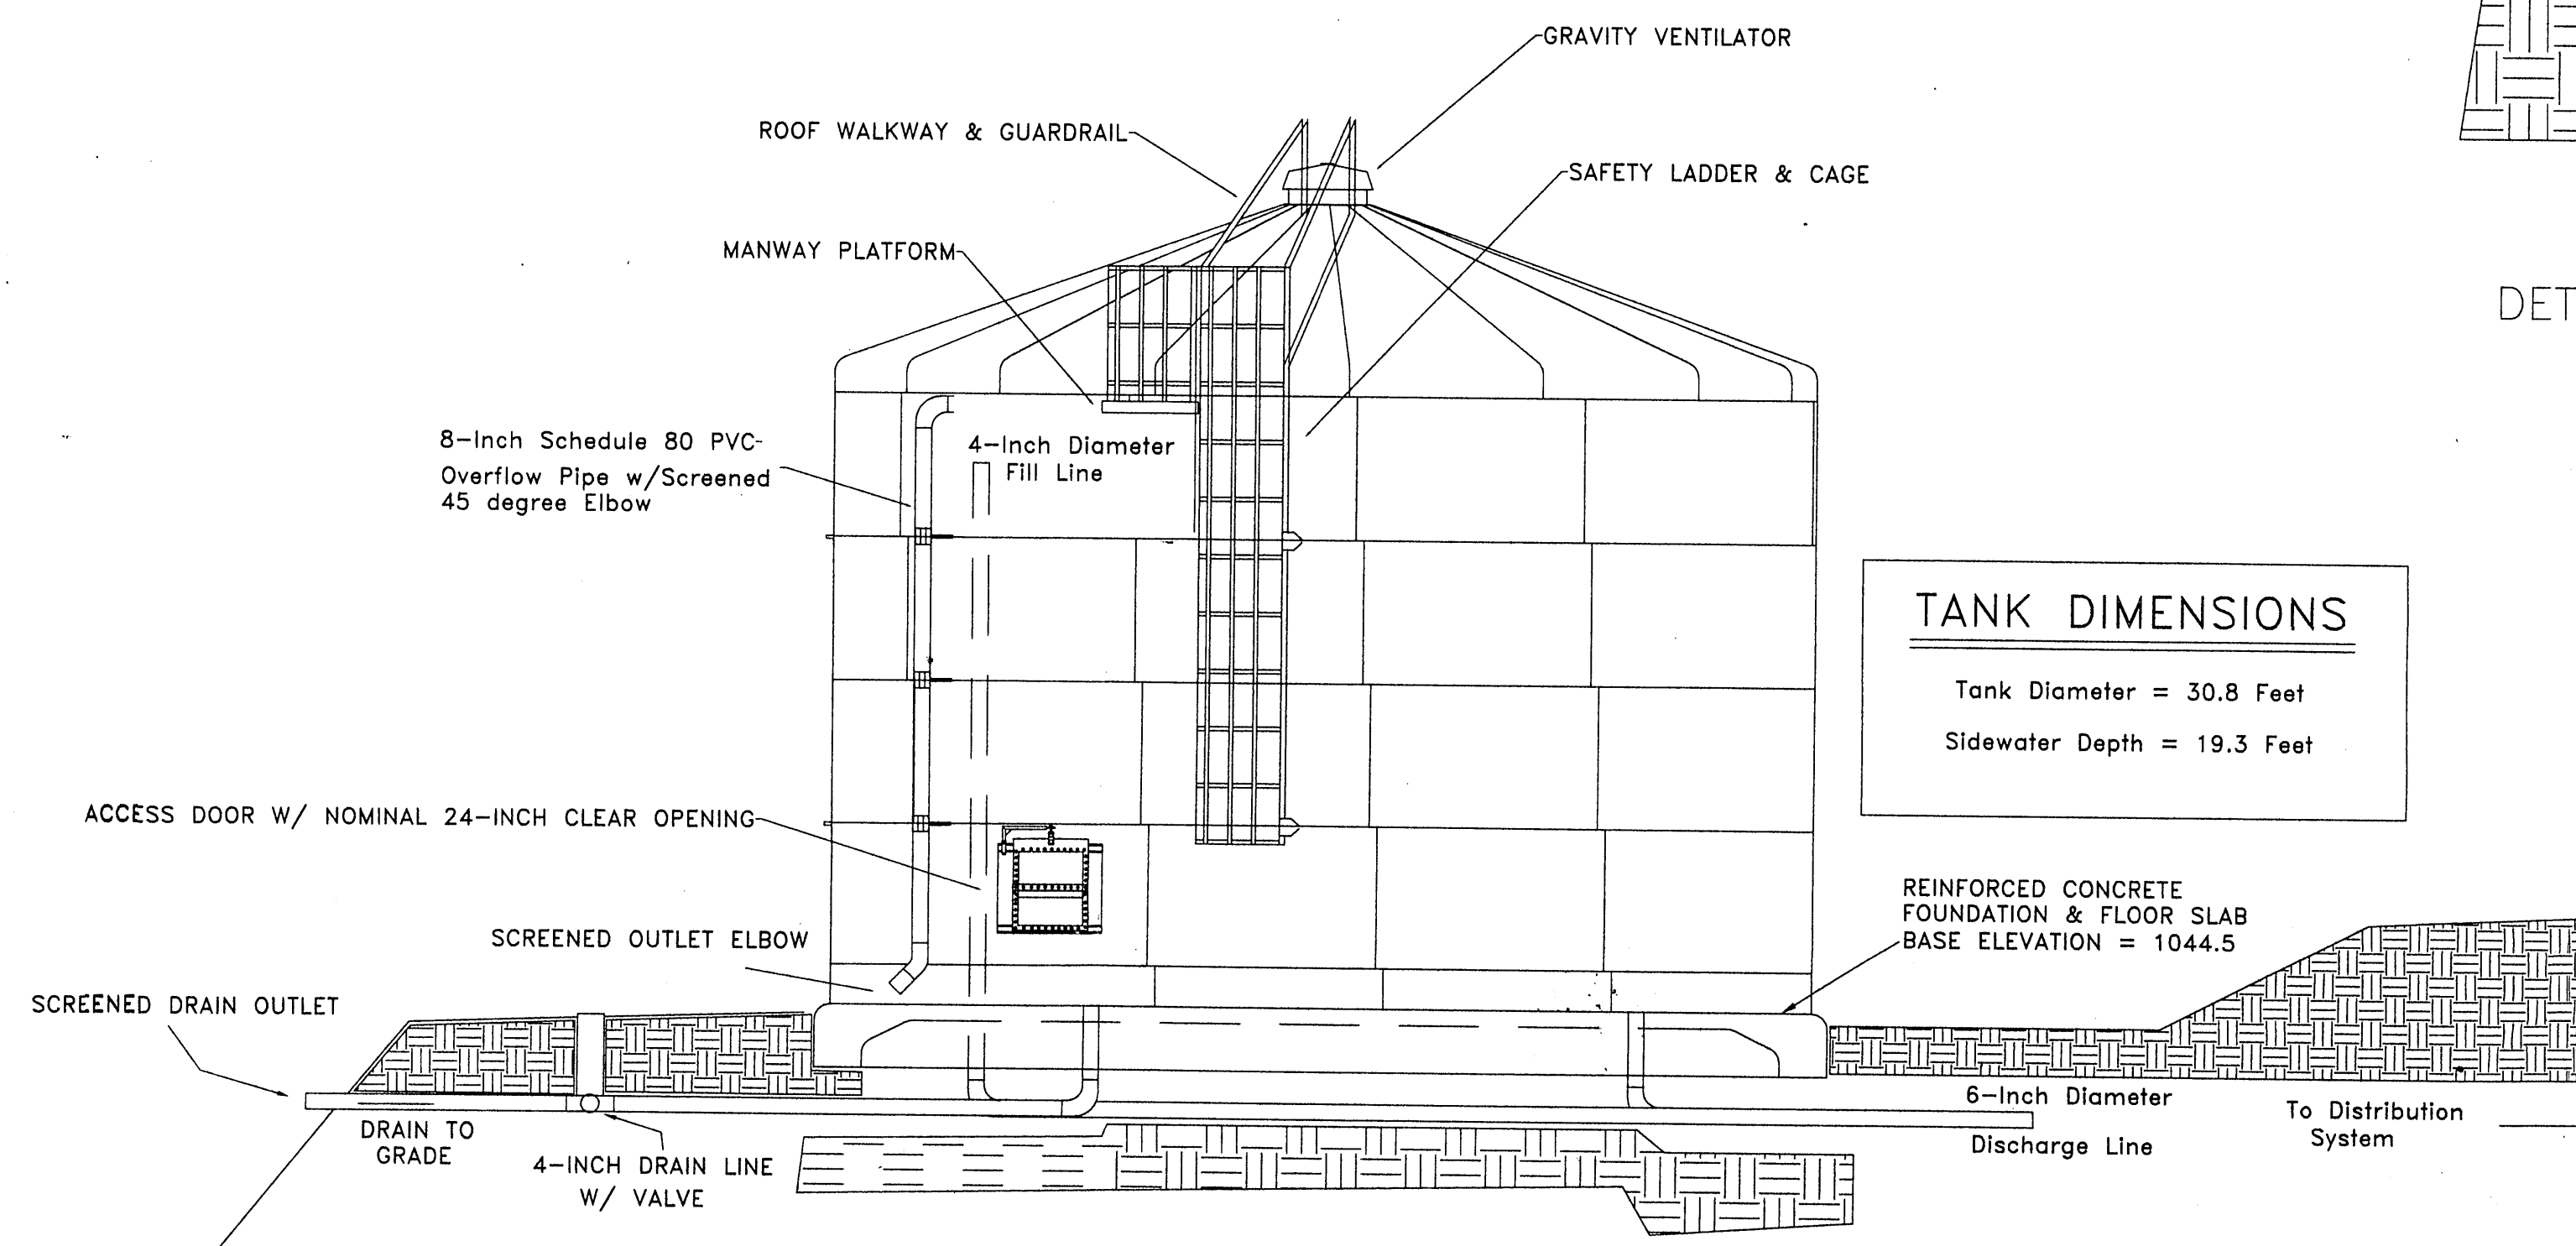


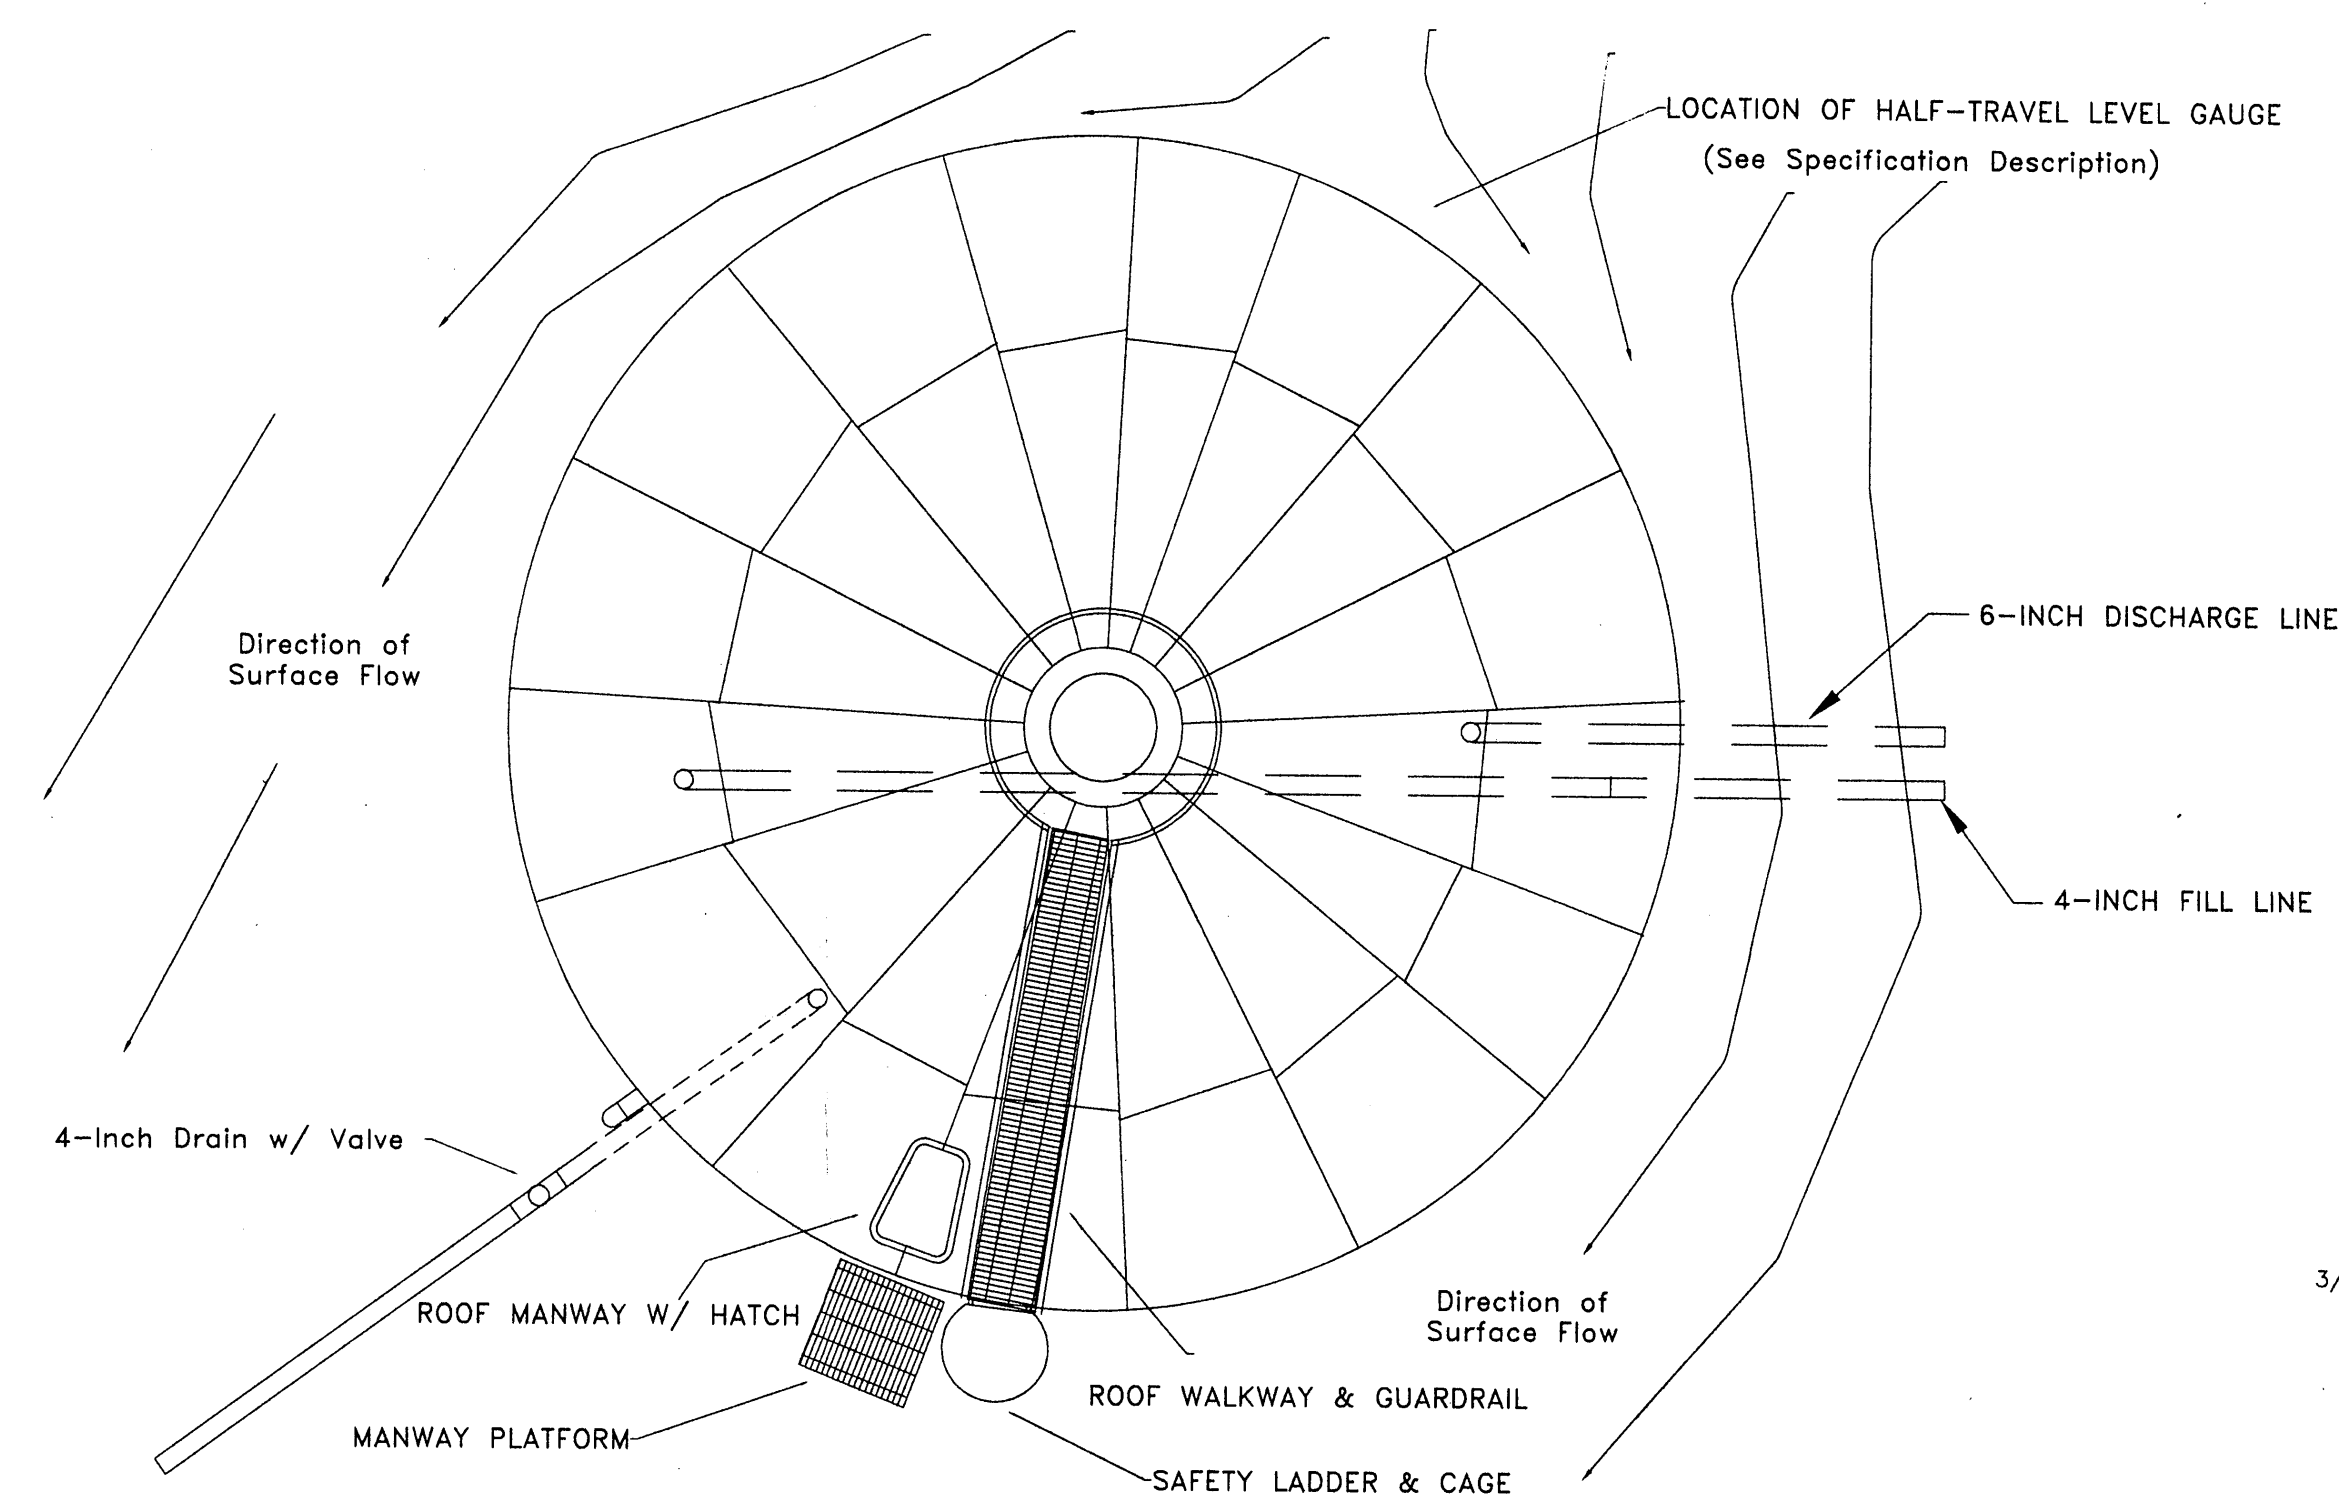

TANK DIMENSIONS

Tank Diameter = 30.8 Feet
Sidewater Depth = 19.3 Feet


VIRGINIA EXPLORE PARK WATER STORAGE TANK

(Nominal Storage Volume = 103,000 Gallons)

SCALE: 1" = 5'

GENERAL NOTES:

1. Provide rip-rap protection at end of all drain lines and tank overflow lines.
2. Provide splash plate below overflow line to divert water from base of tank.

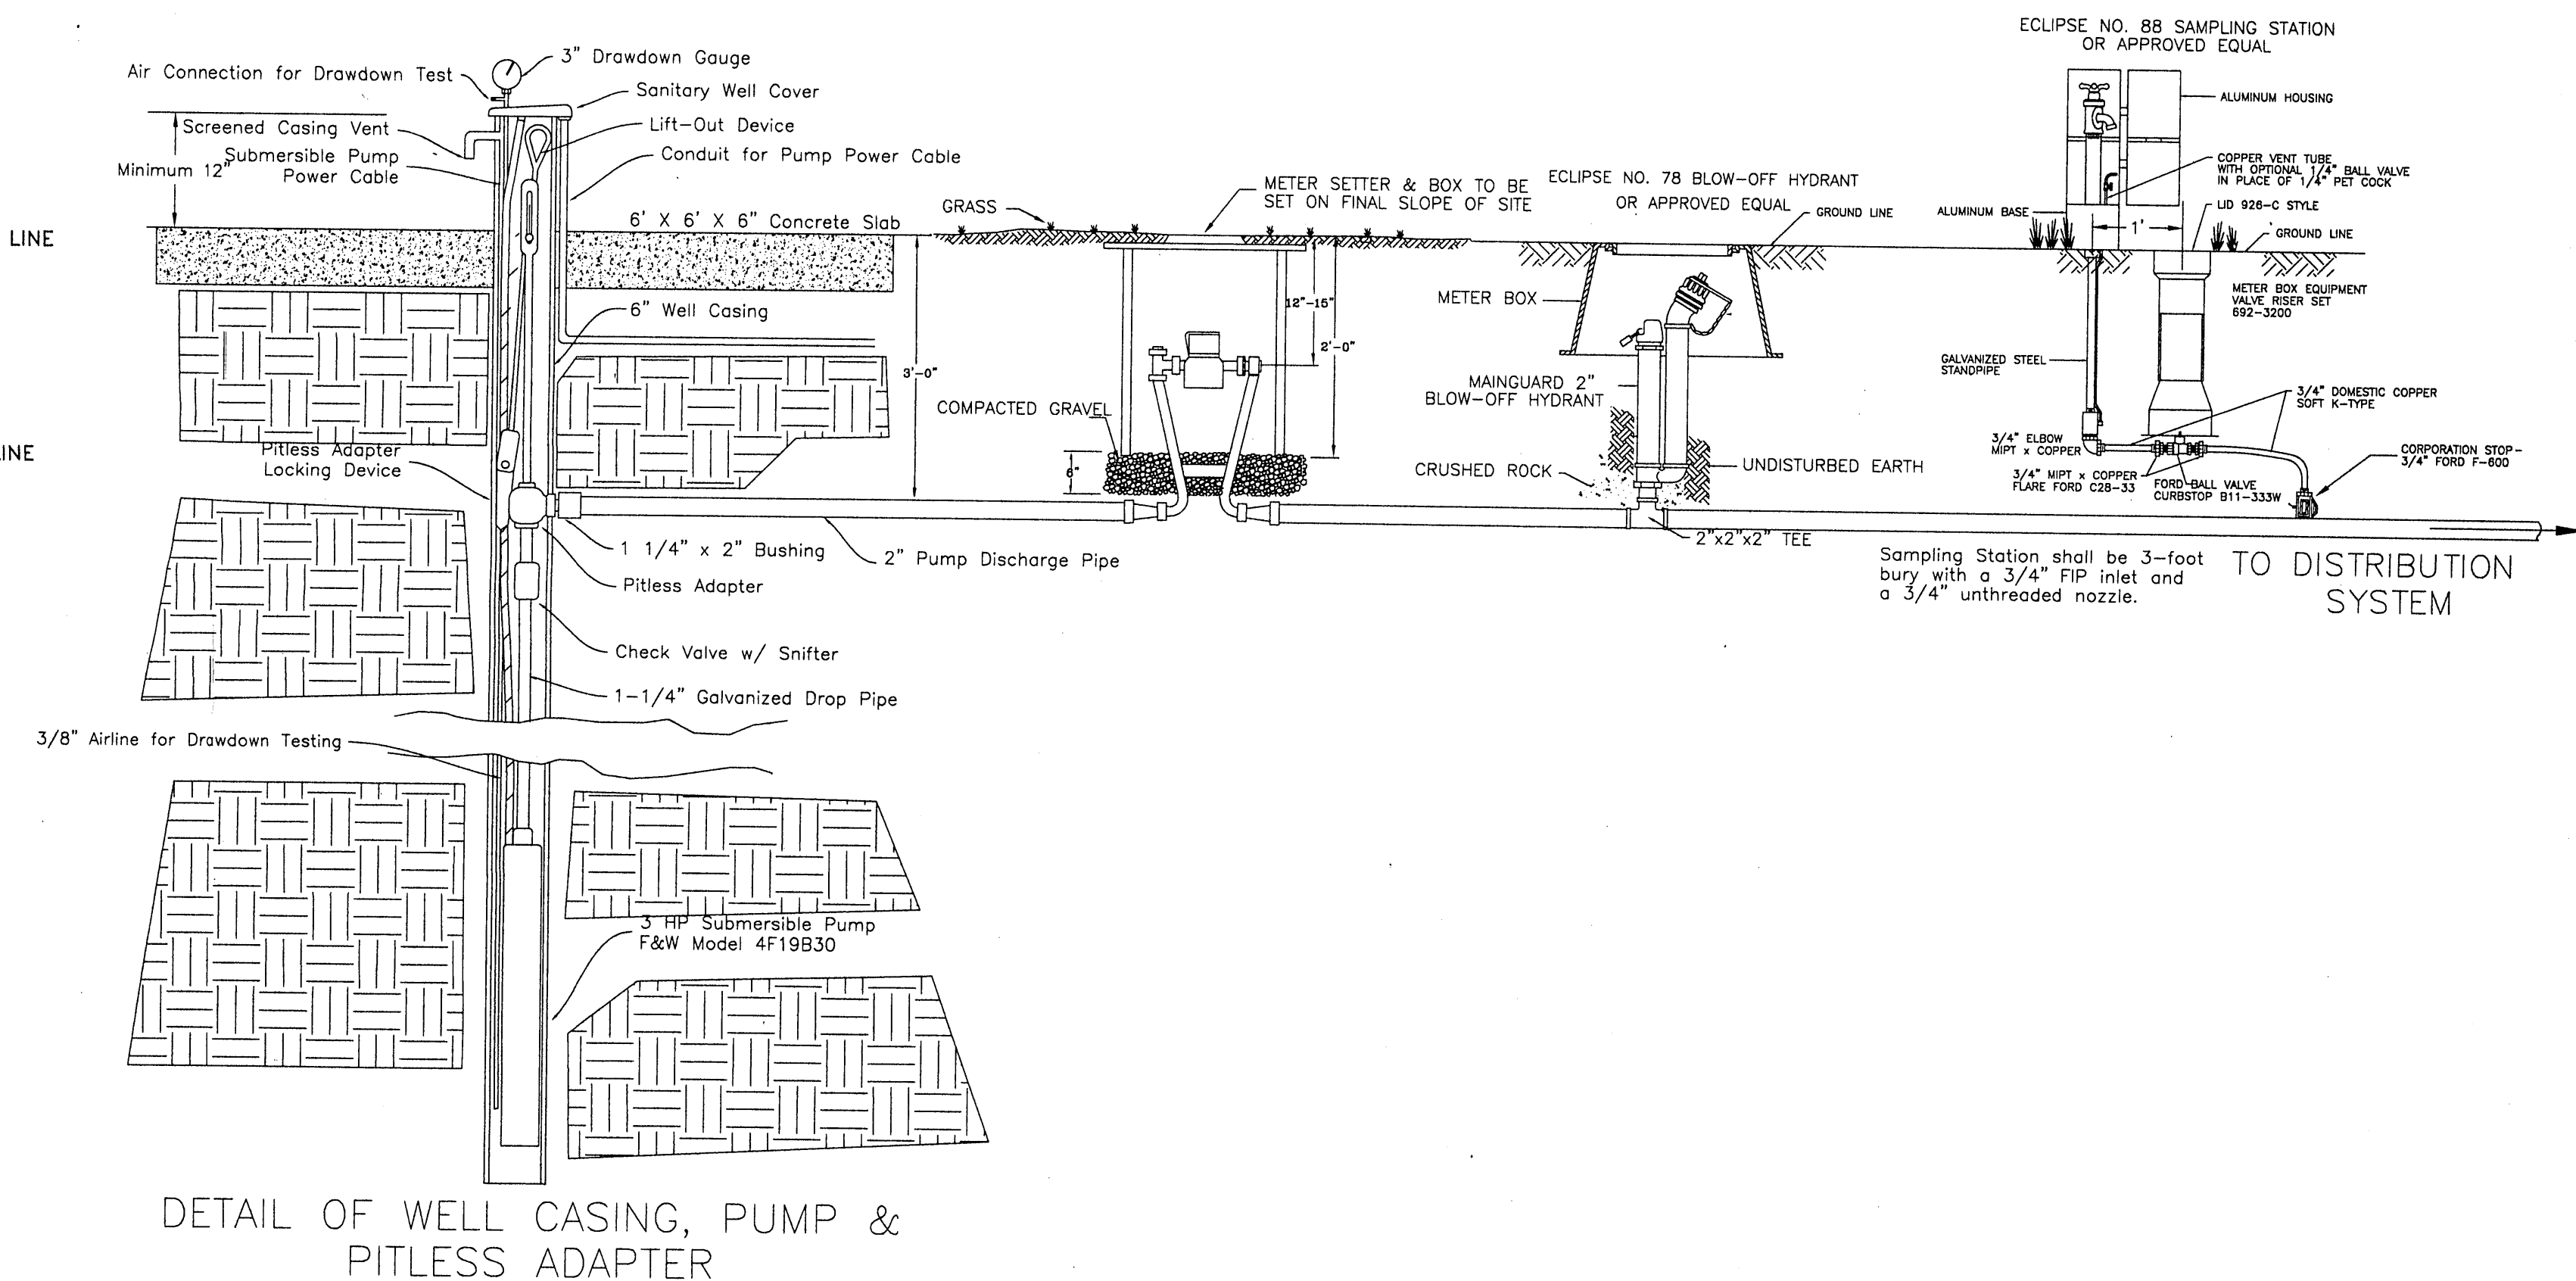

PROPOSED WATER SYSTEM VIRGINIA'S EXPLORE PARK

VINTON MAGISTERIAL DISTRICT
ROANOKE COUNTY, VIRGINIA

WATER SYSTEM DETAILS

WATER STORAGE TANK &
McKEE FORD WELL INSTALLATION
PHASE 1

DRAWN BY R.W.B.
DESIGNED BY G.L.R. & R.W.B.
CHECKED BY G.L.R.
PROJECT NO. 96-60
SCALE: AS SHOWN