


1505 Peters Creek Rd

1477 Peters Creek Rd

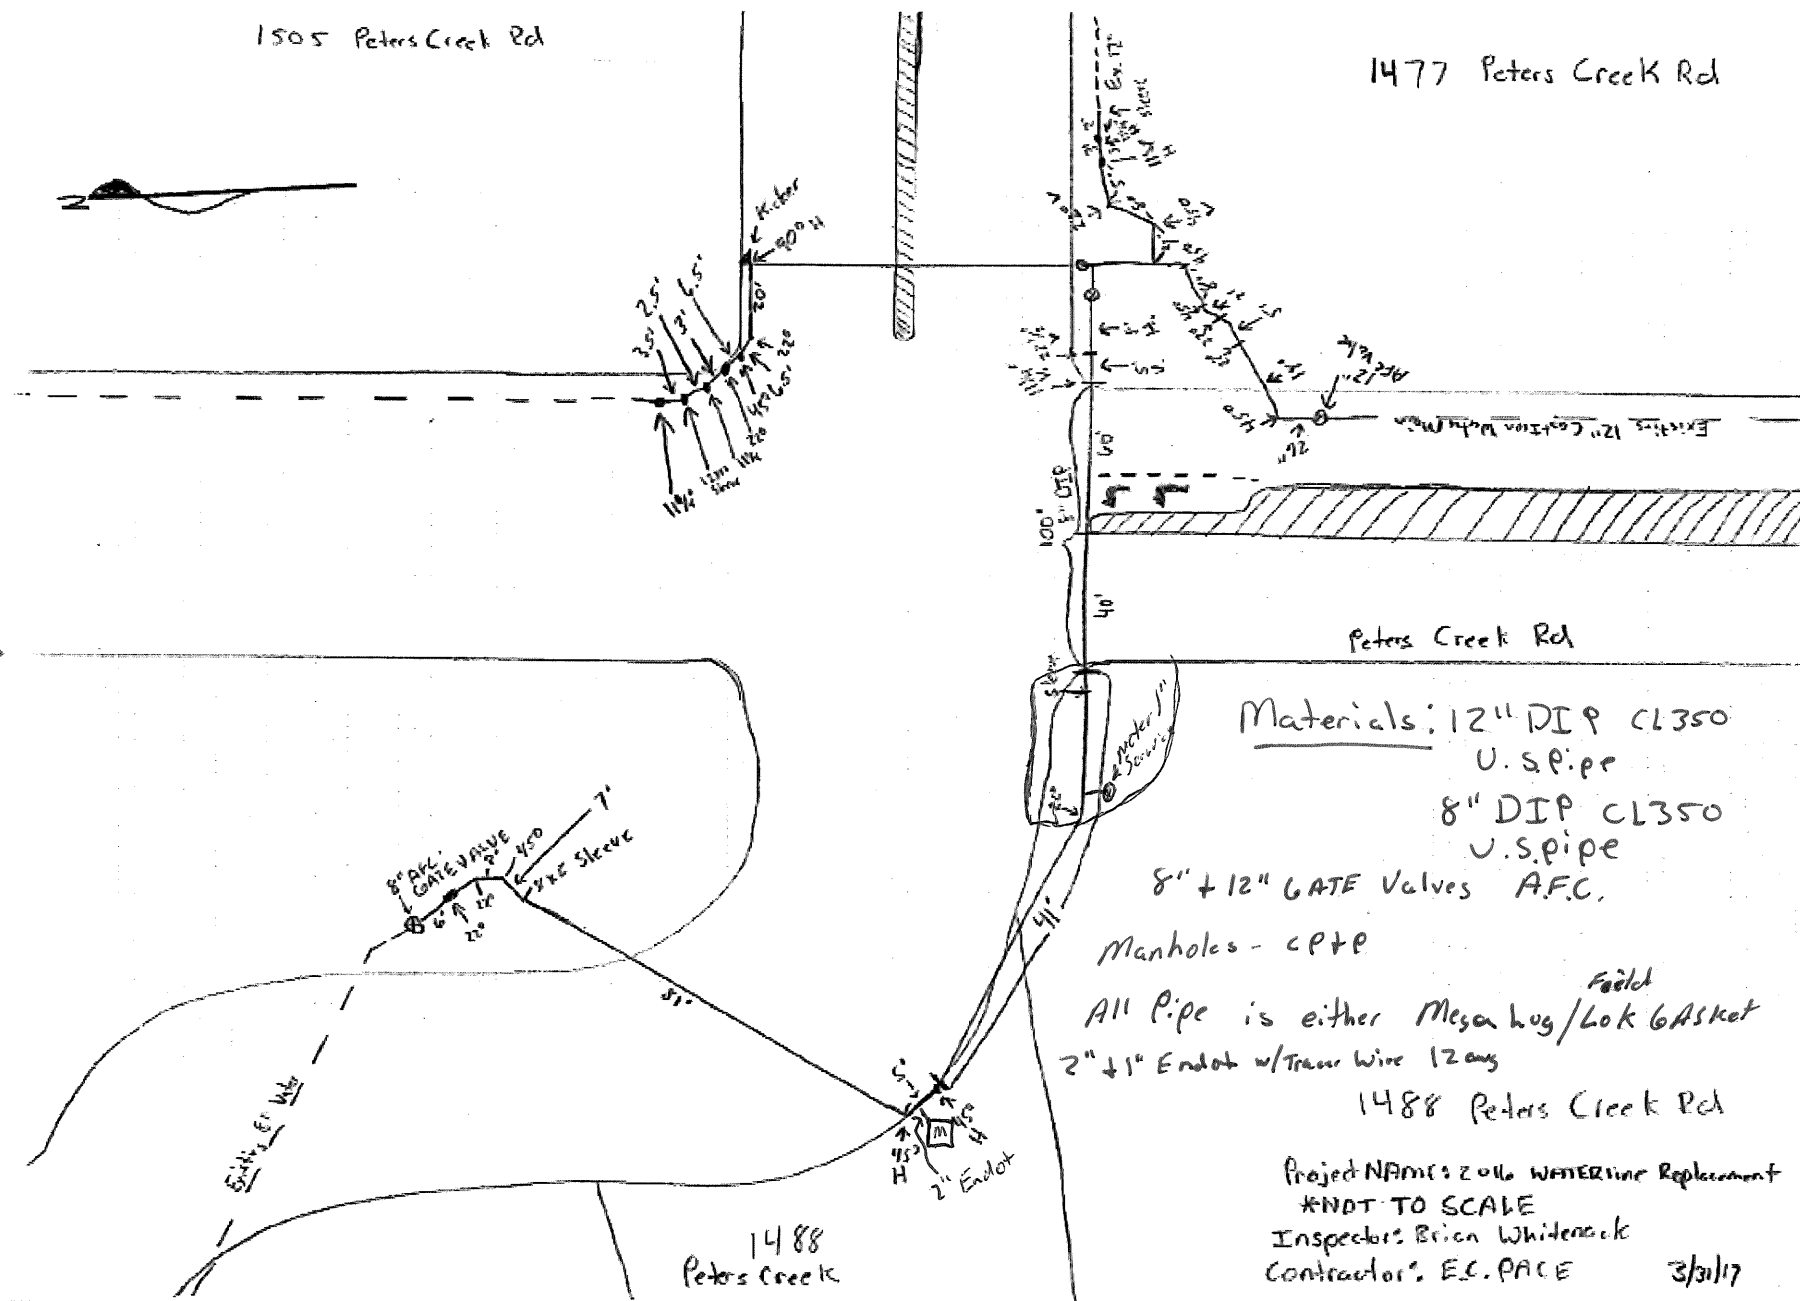

Materials: 12" DIP CL350
U.S.Pipe
8" DIP CL350
U.S.Pipe

8" + 12" GATE Valves A.F.C.

Manholes - C.P.P.

All Pipe is either Mesa hug/^{Field}Lok Gasket
2" + 1" Endot w/Truss Wire 12 ang

1488 Peters Creek Rd

Project Name: 2016 WATERLINE Replacement
*NOT TO SCALE
Inspector: Brian Whitenack
Contractor: E.C. PACE 3/31/17

