

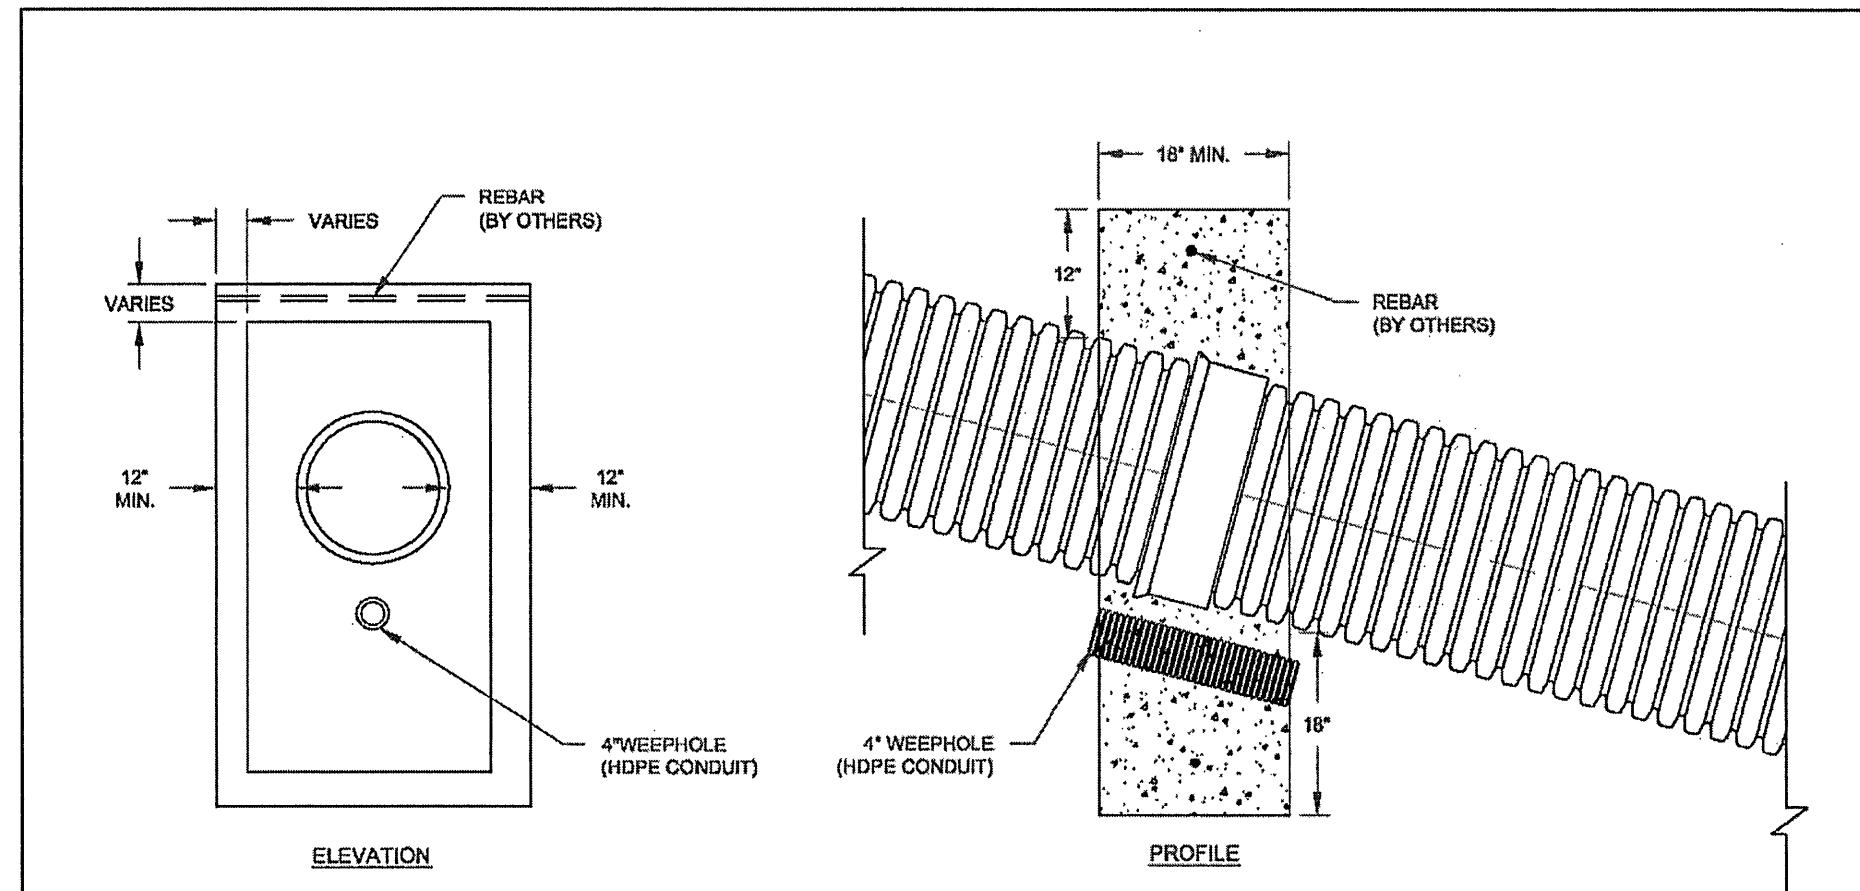
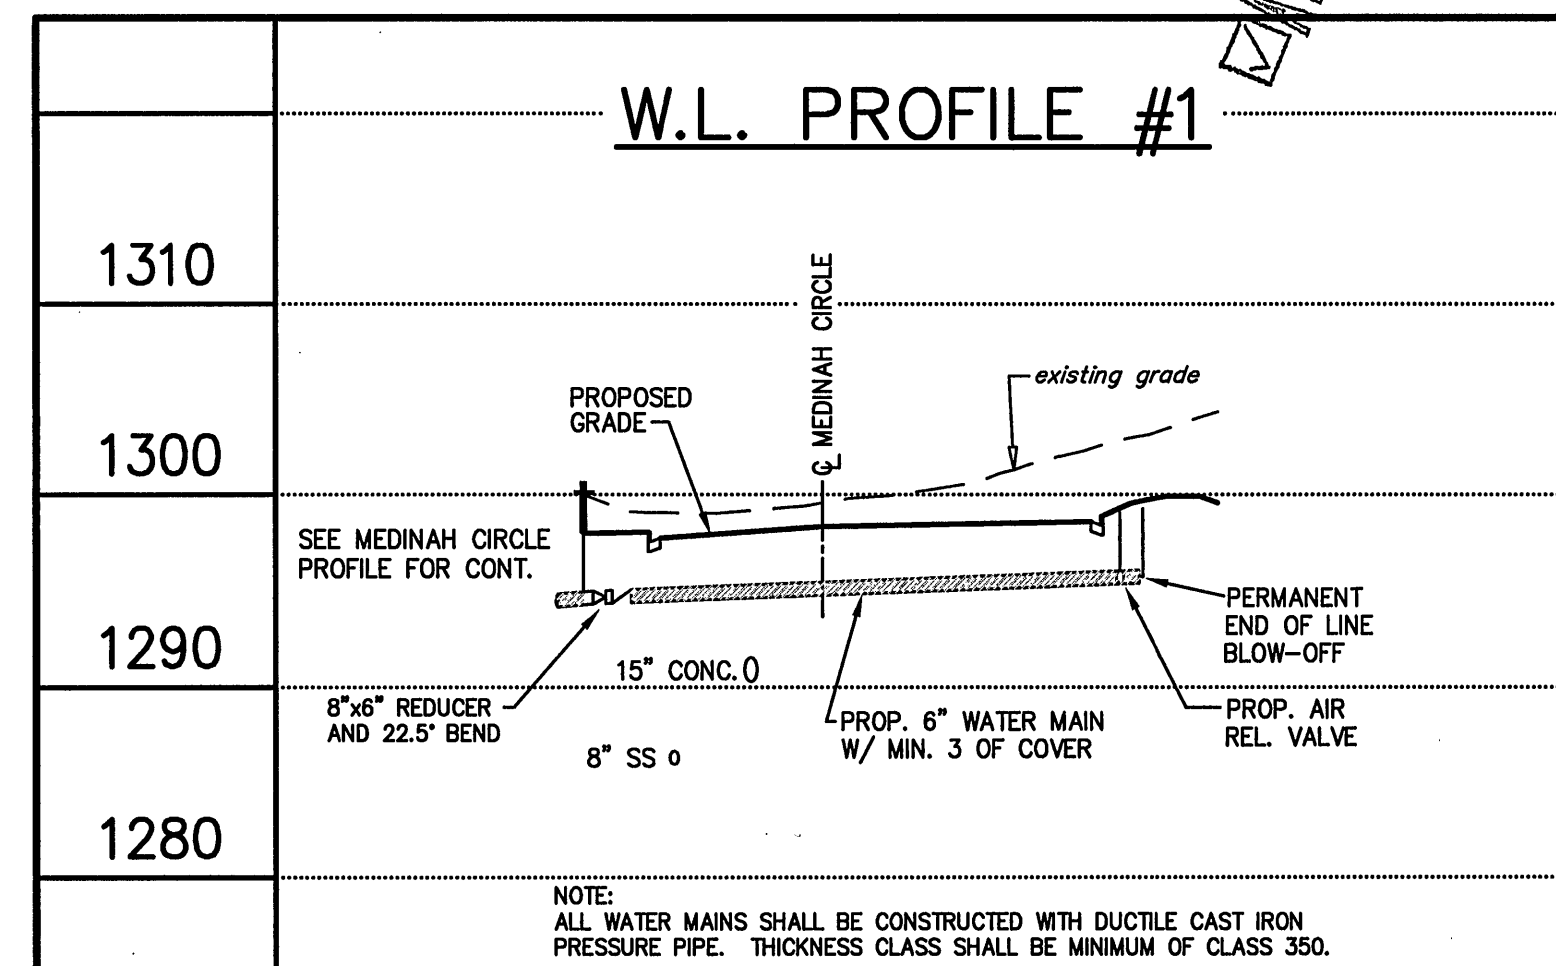
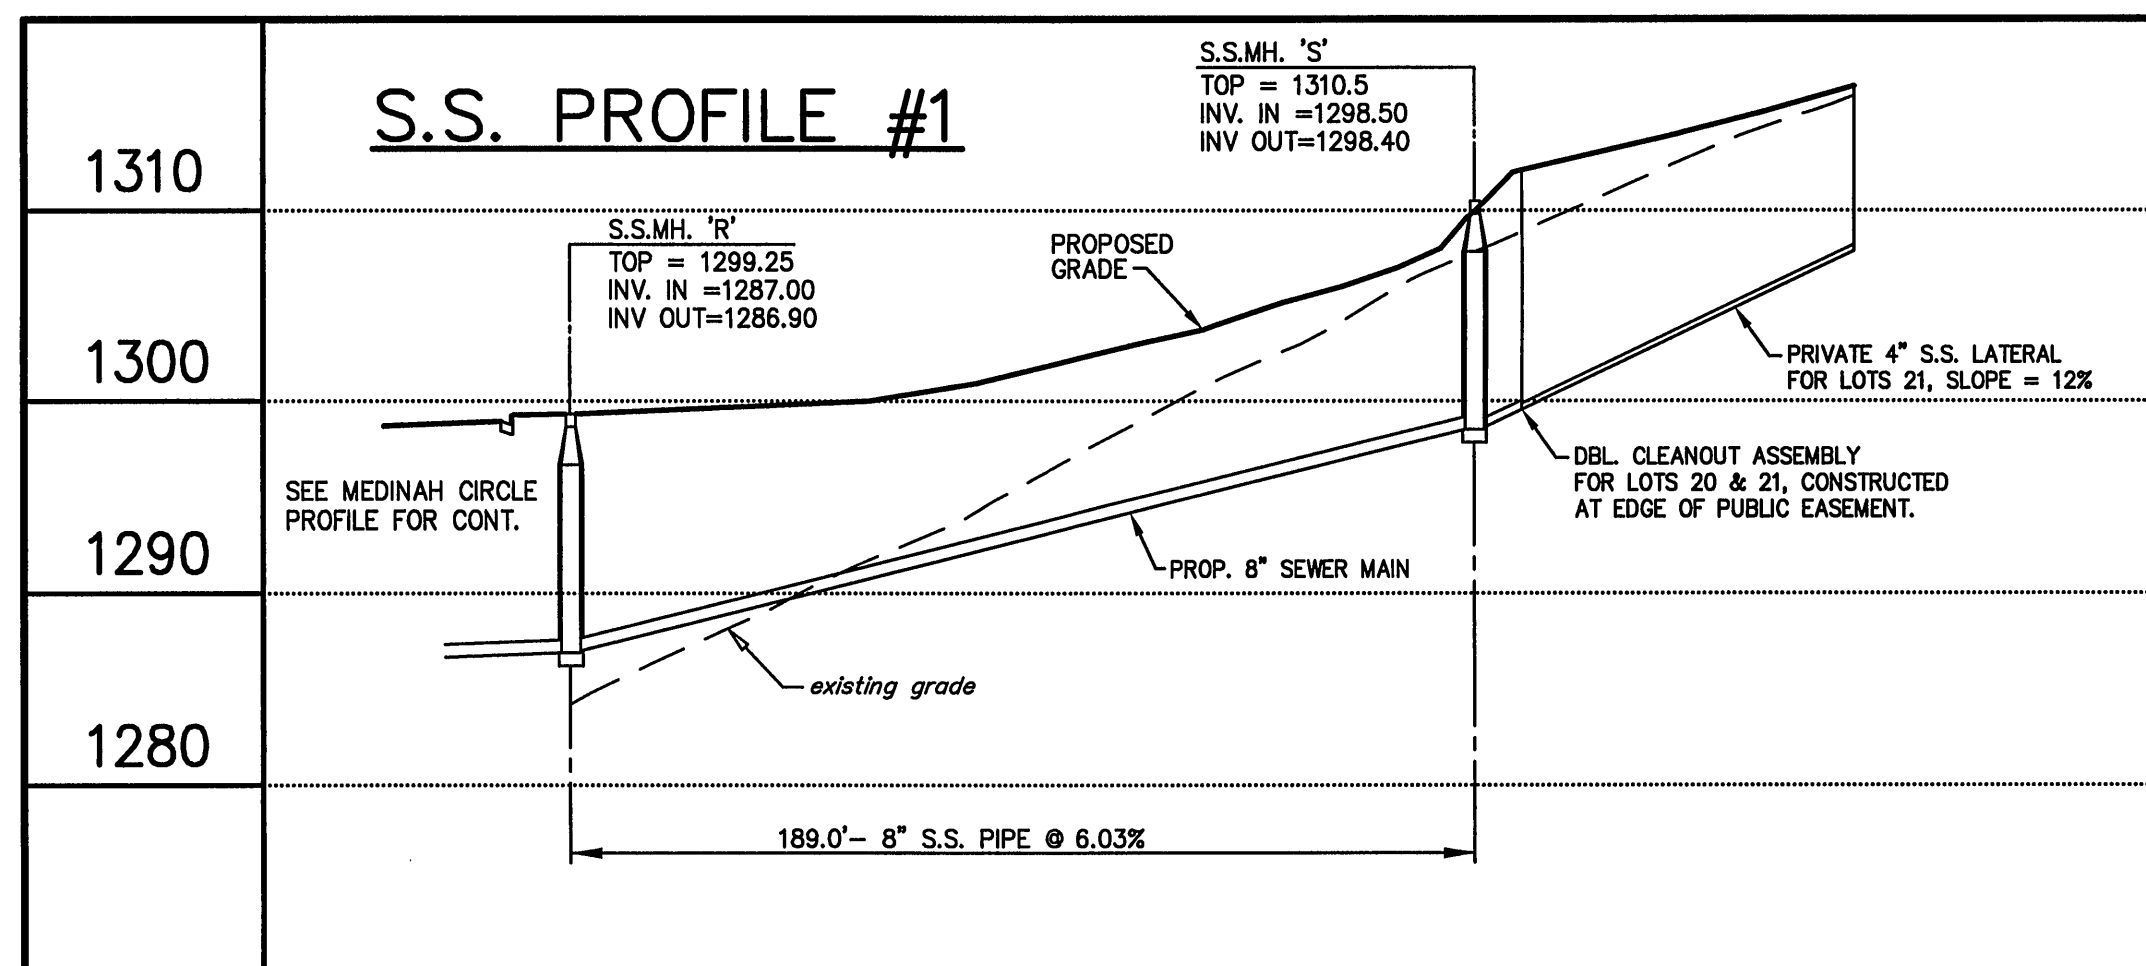
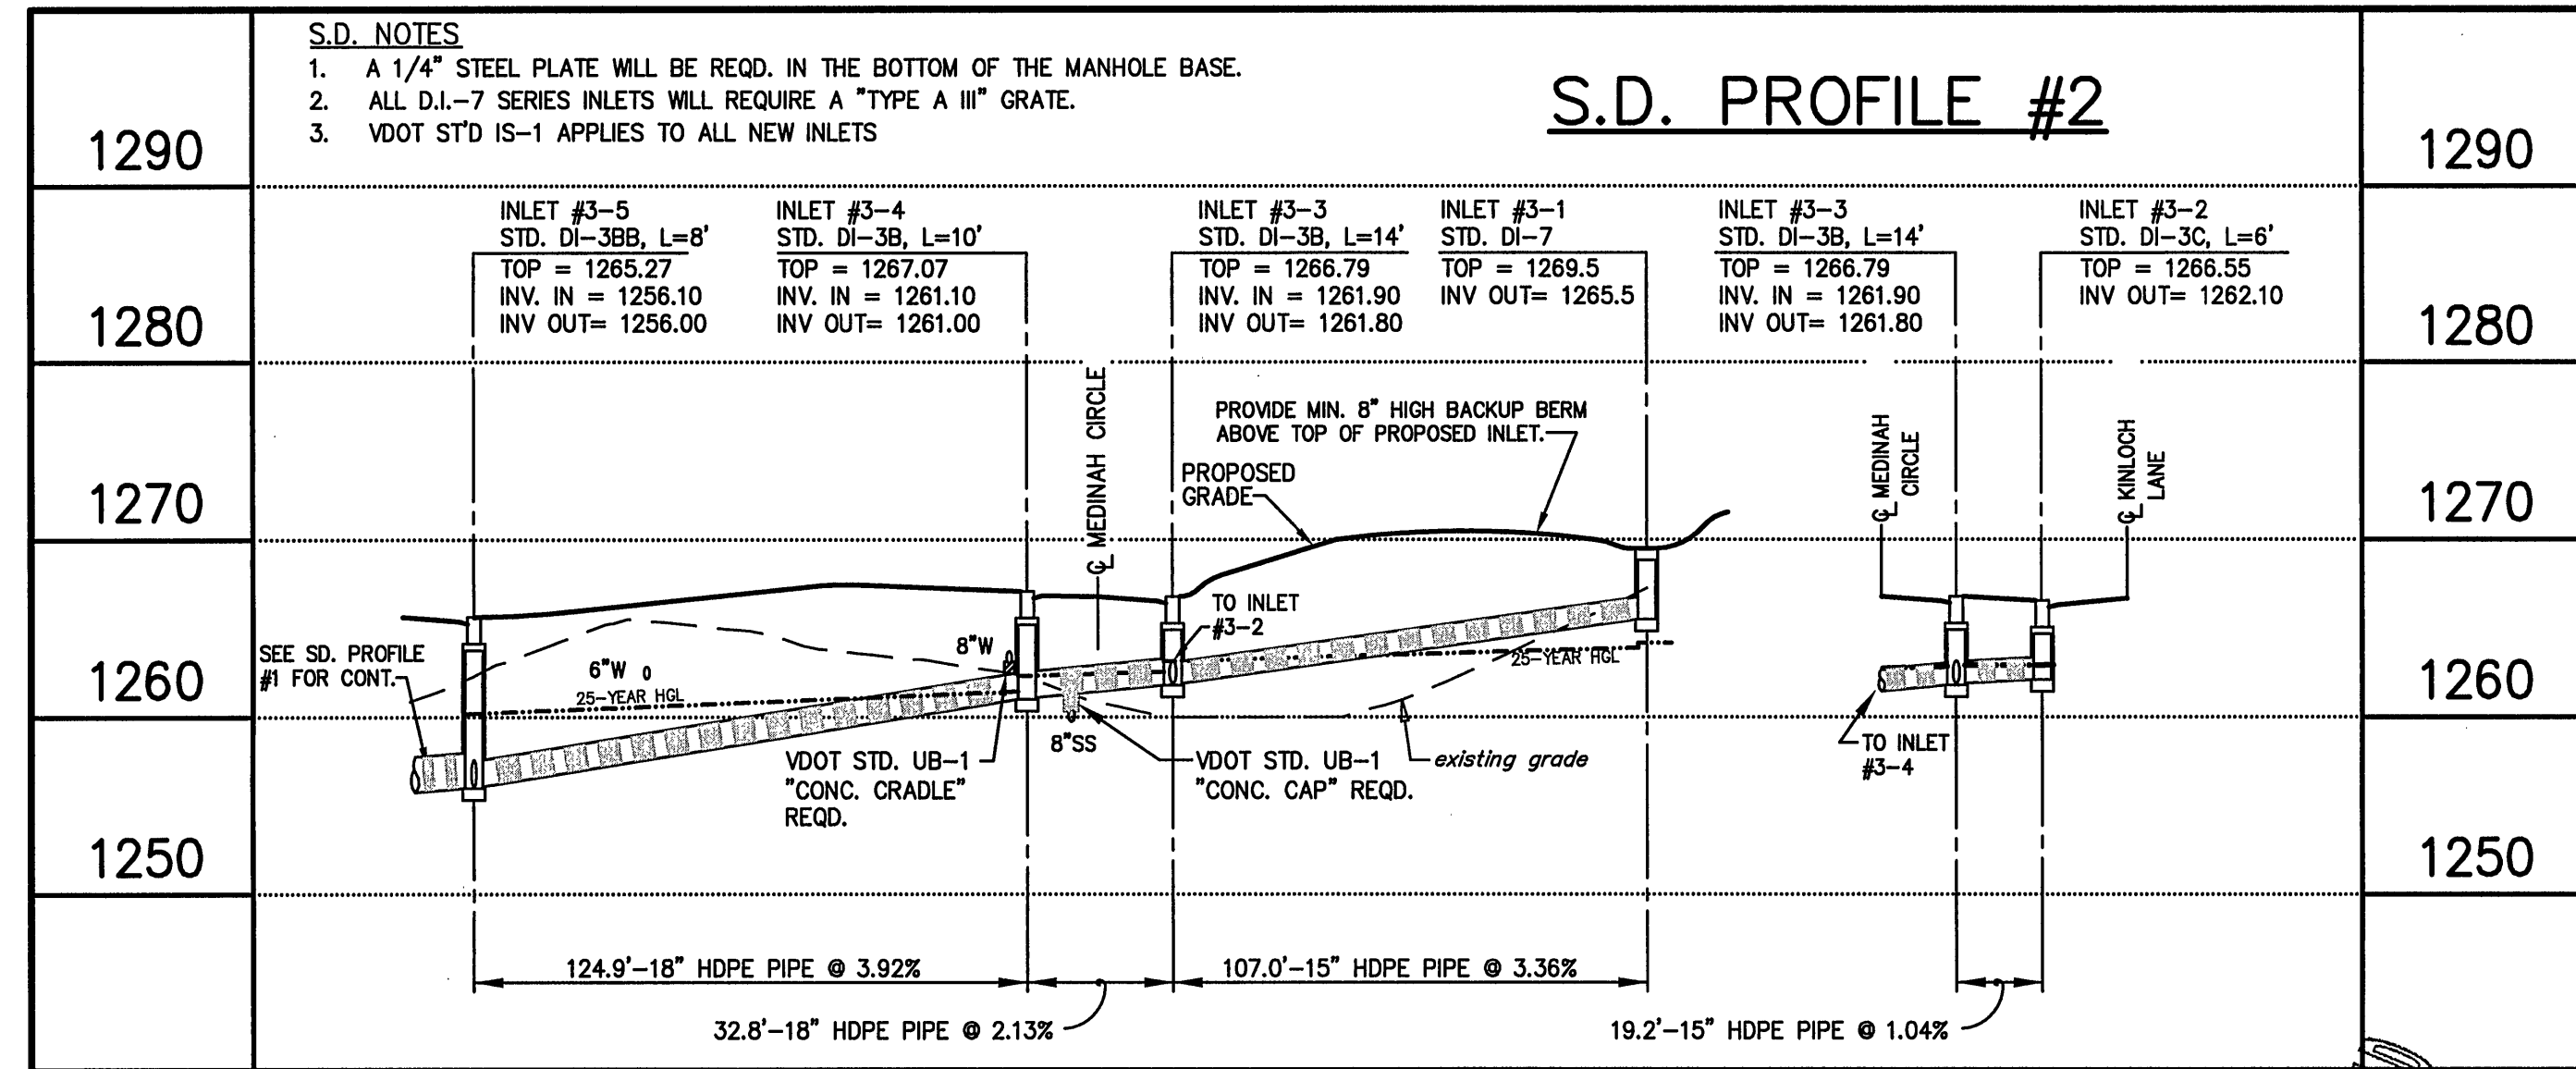


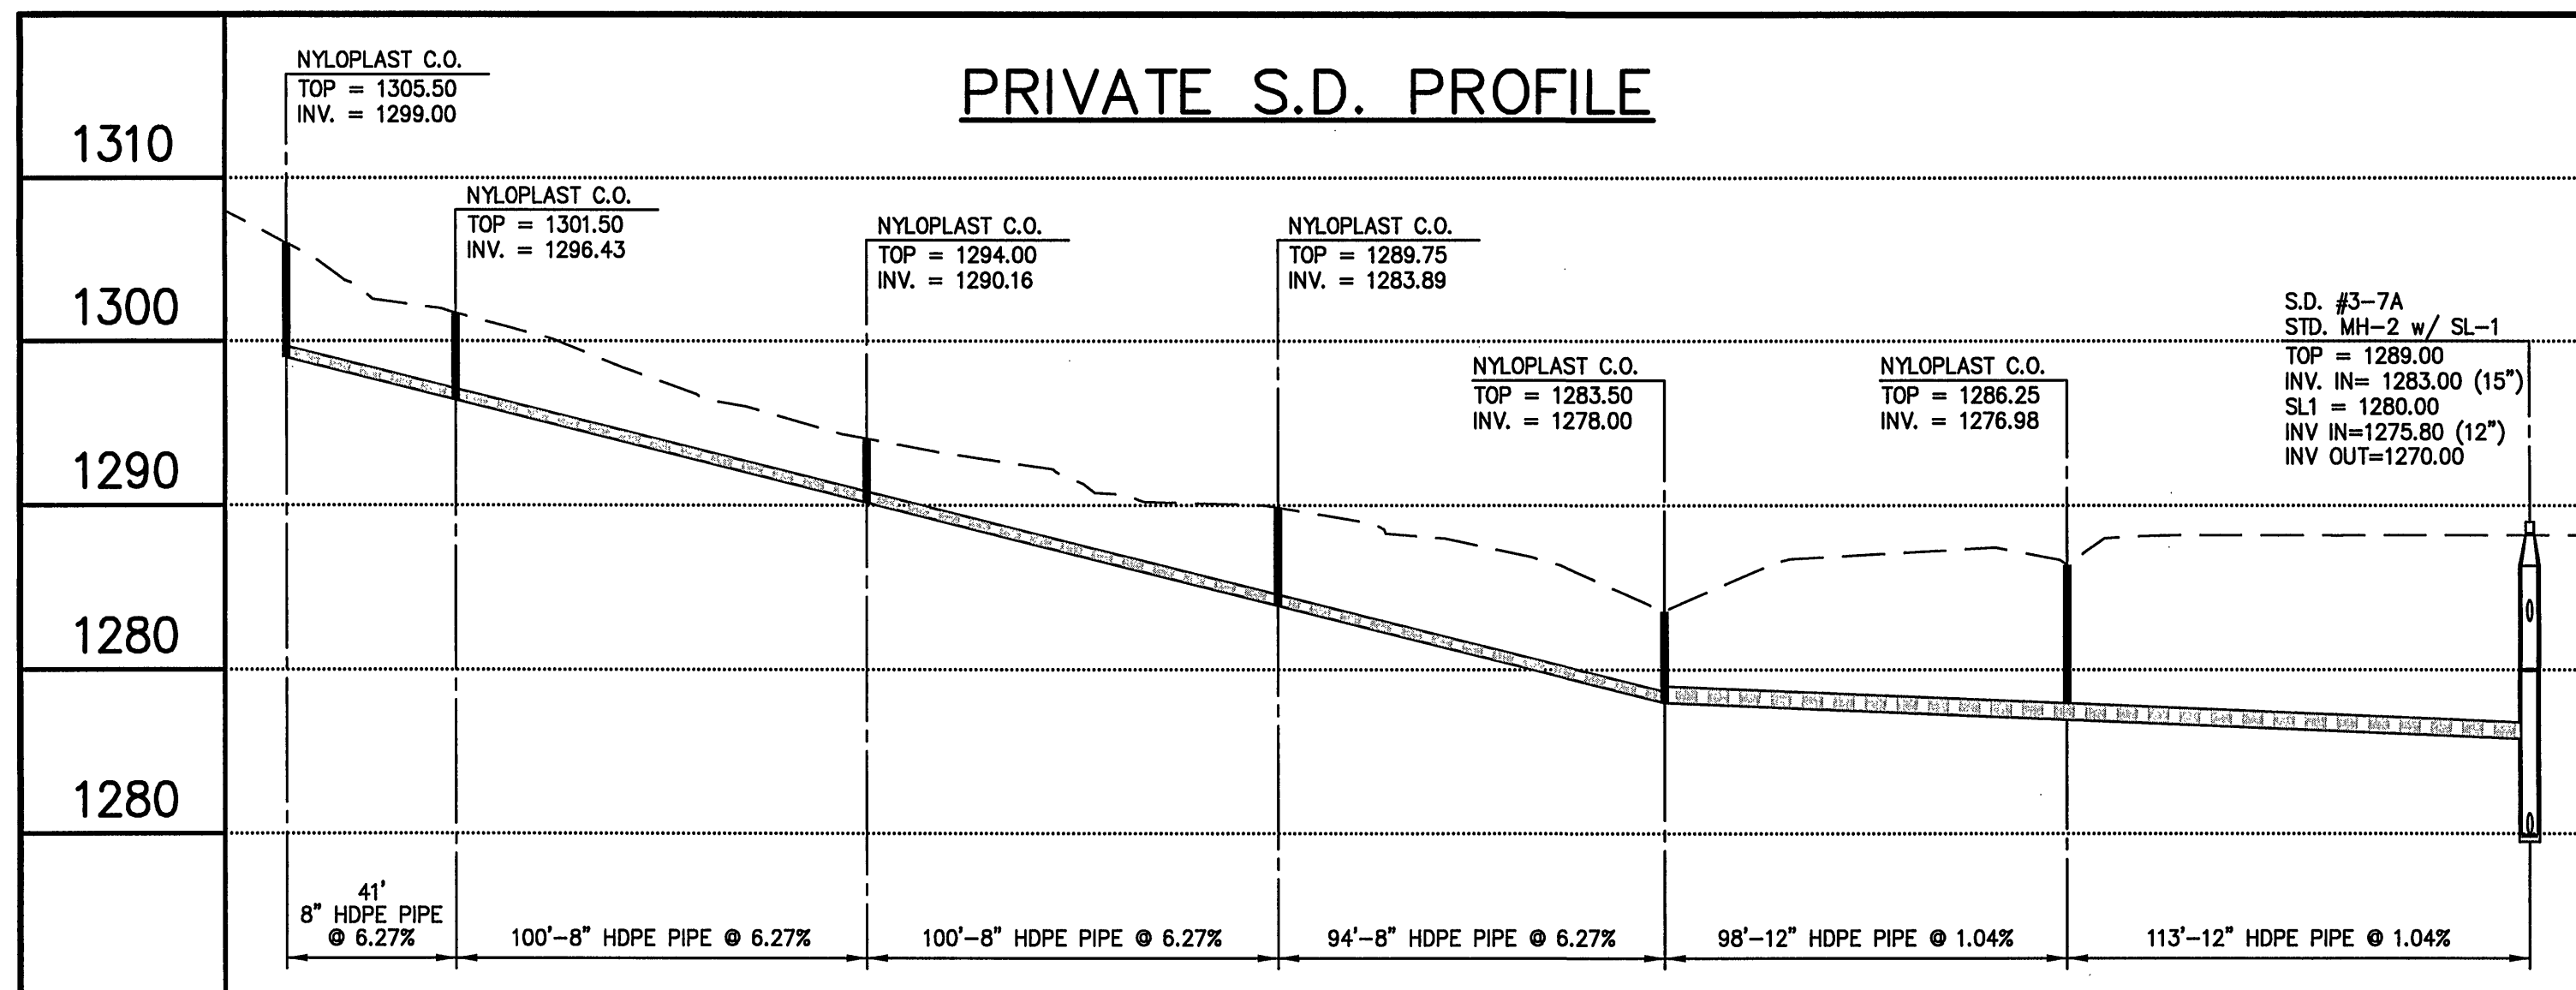

- NOTES:
1. PIPE TO BE INSTALLED PER MANUFACTURER'S RECOMMENDATIONS. SEE STD-101.
 2. ANCHORS SHALL BE PLACED EVERY JOINT.
 3. VELOCITY REDUCTION METHODS SHALL BE TAKEN WHEN SLOPE CREATES VELOCITY GREATER THAN 20 FPS.

REV.	DESCRIPTION	BY	DATE	CHKD
1	UPDATED DRAWING	TJR	06/20/09	CJS
2	CONCRETE ANCHORS FOR STEEP SLOPED PIPE INSTALLATION	WDS	06/22/09	

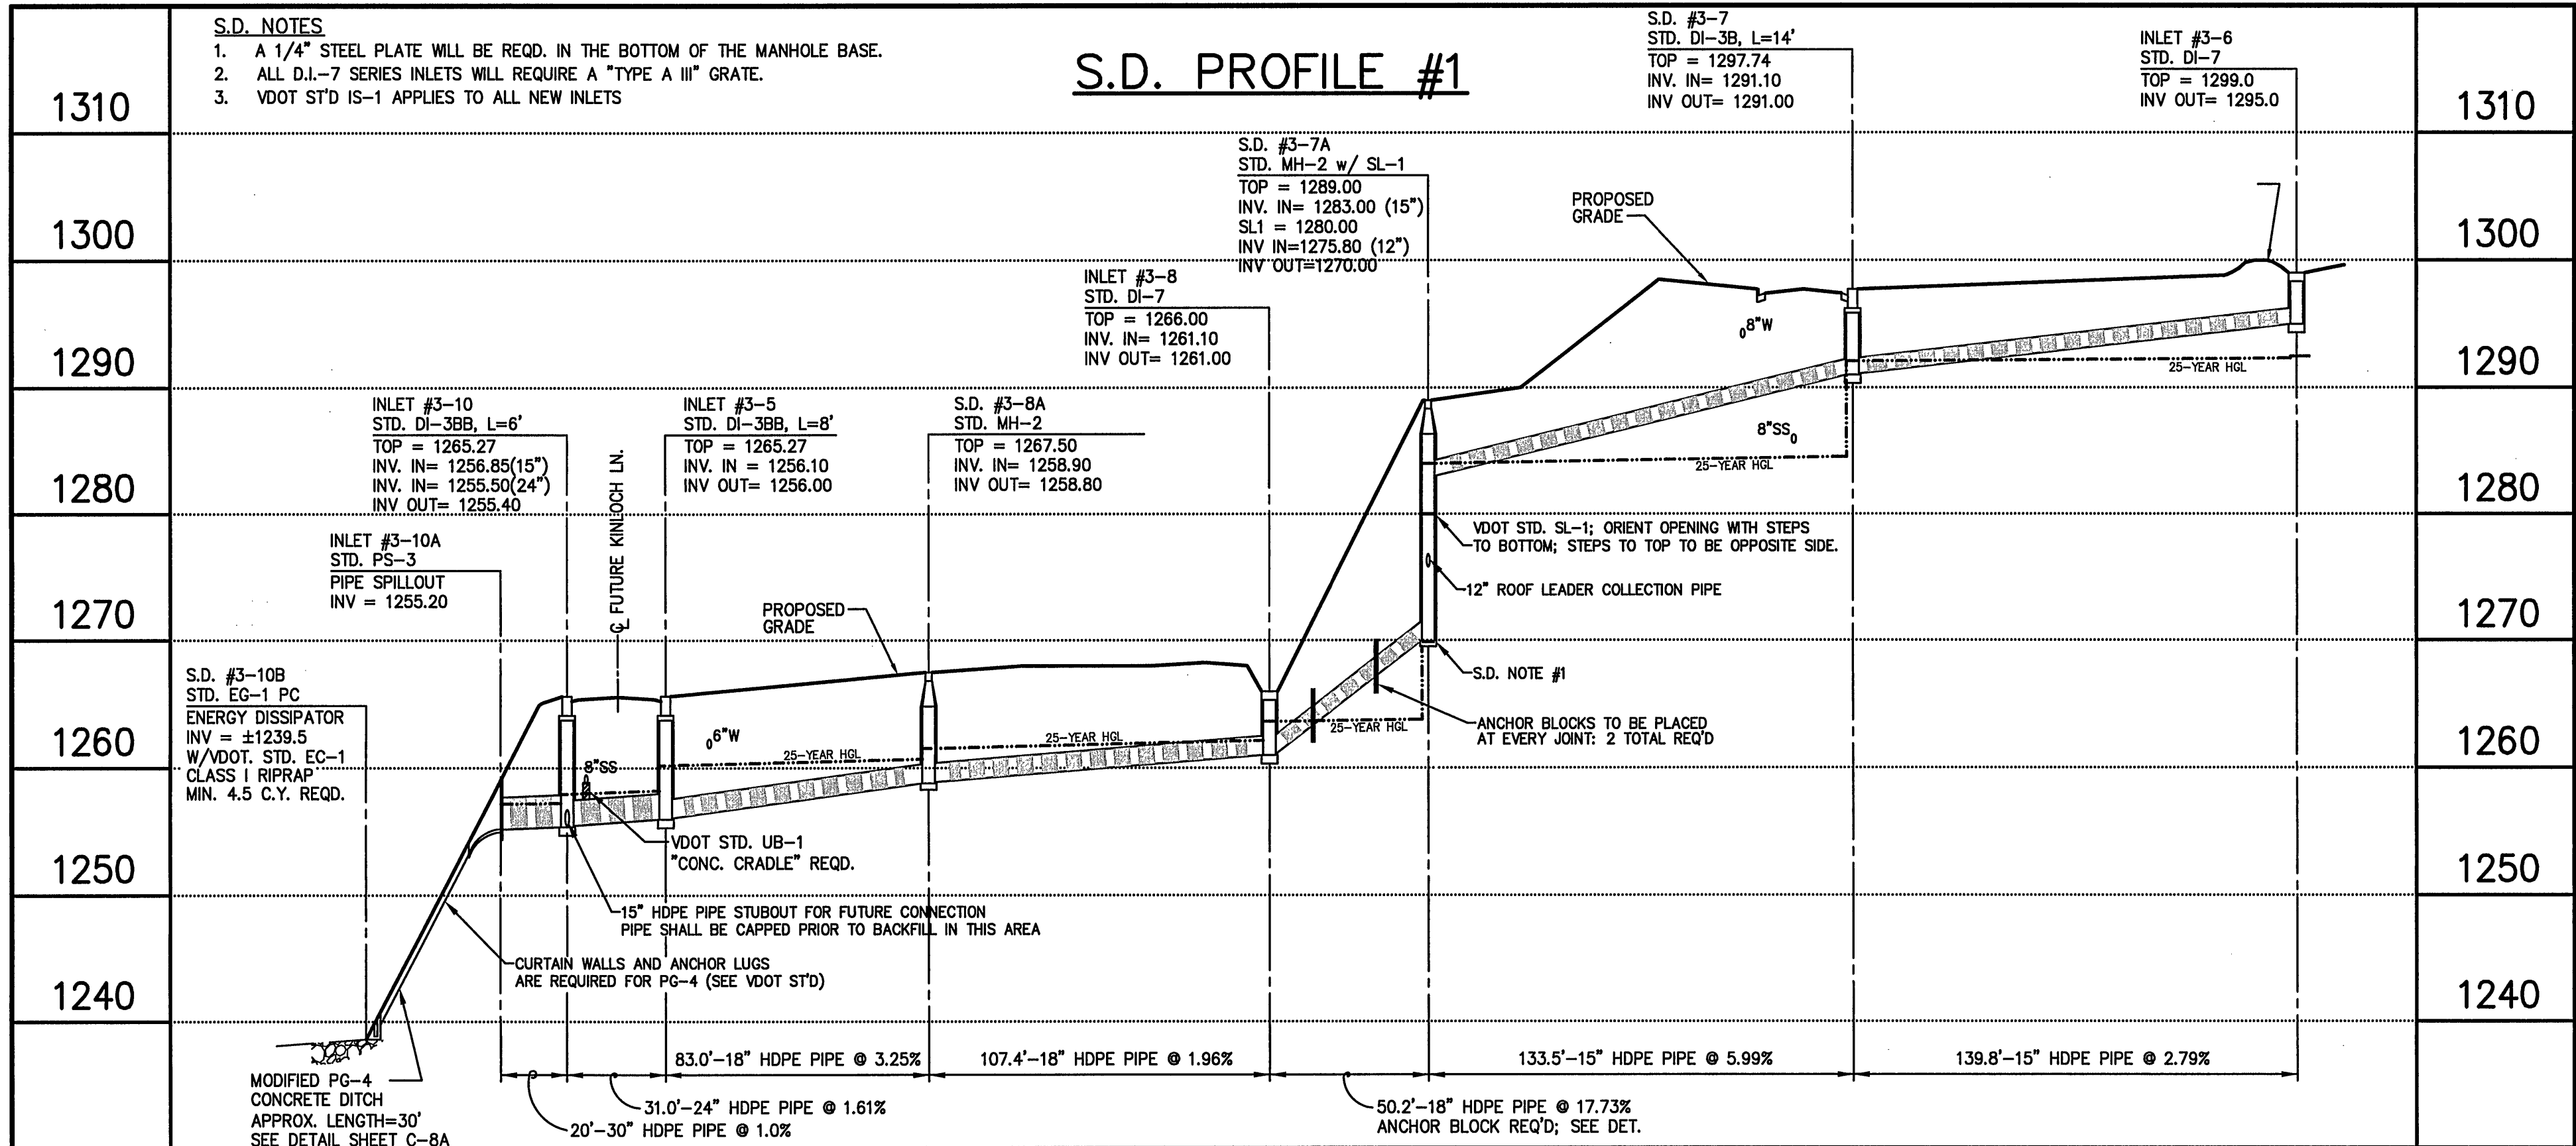

SCALES:
HORIZONTAL - 1" = 40'
VERTICAL - 1" = 10'