
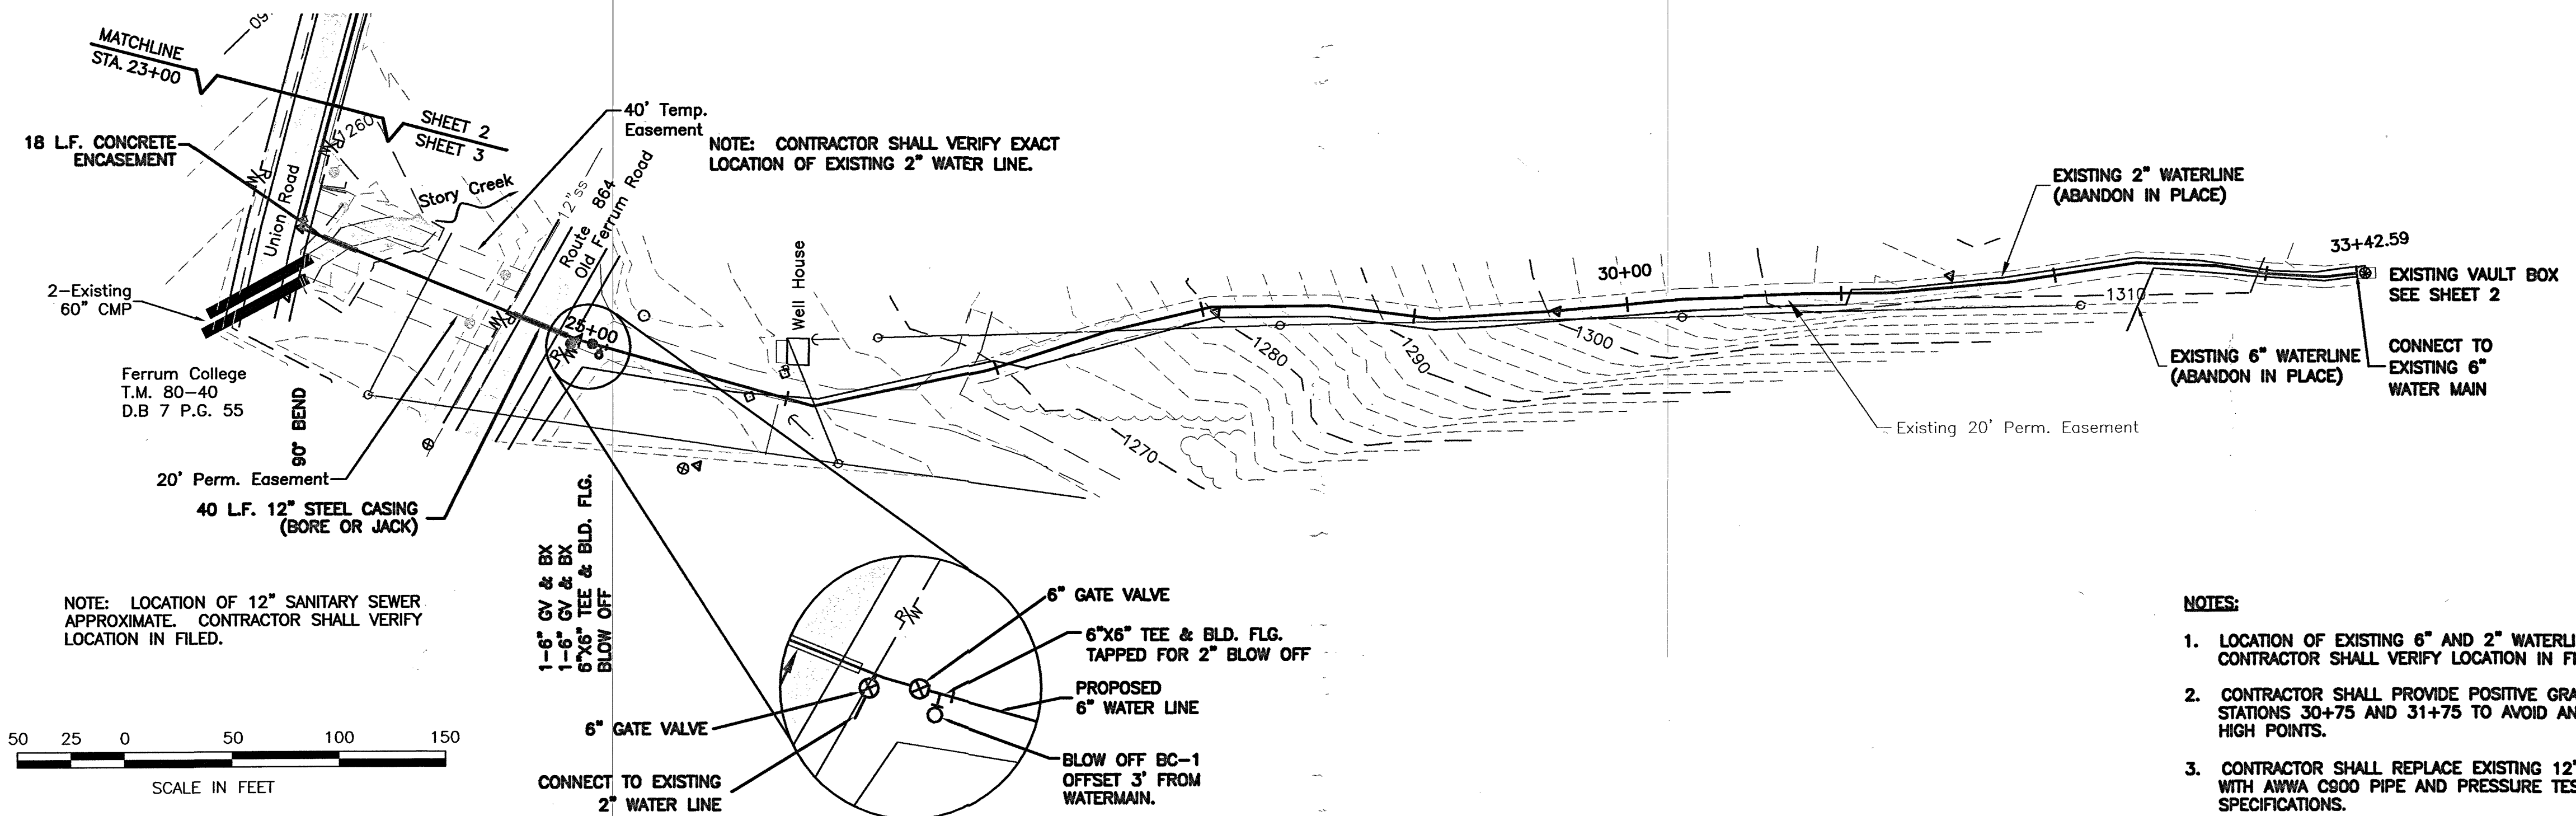


- NOTES:**
1. LOCATION OF EXISTING 6" AND 2" WATERLINE APPROXIMATE. CONTRACTOR SHALL VERIFY LOCATION IN FIELD.
  2. CONTRACTOR SHALL PROVIDE POSITIVE GRADE BETWEEN STATIONS 30+75 AND 31+75 TO AVOID ANY INTERMEDIATE HIGH POINTS.
  3. CONTRACTOR SHALL REPLACE EXISTING 12" SANITARY SEWER WITH AWWA C900 PIPE AND PRESSURE TEST IN PLACE AS PER SPECIFICATIONS.

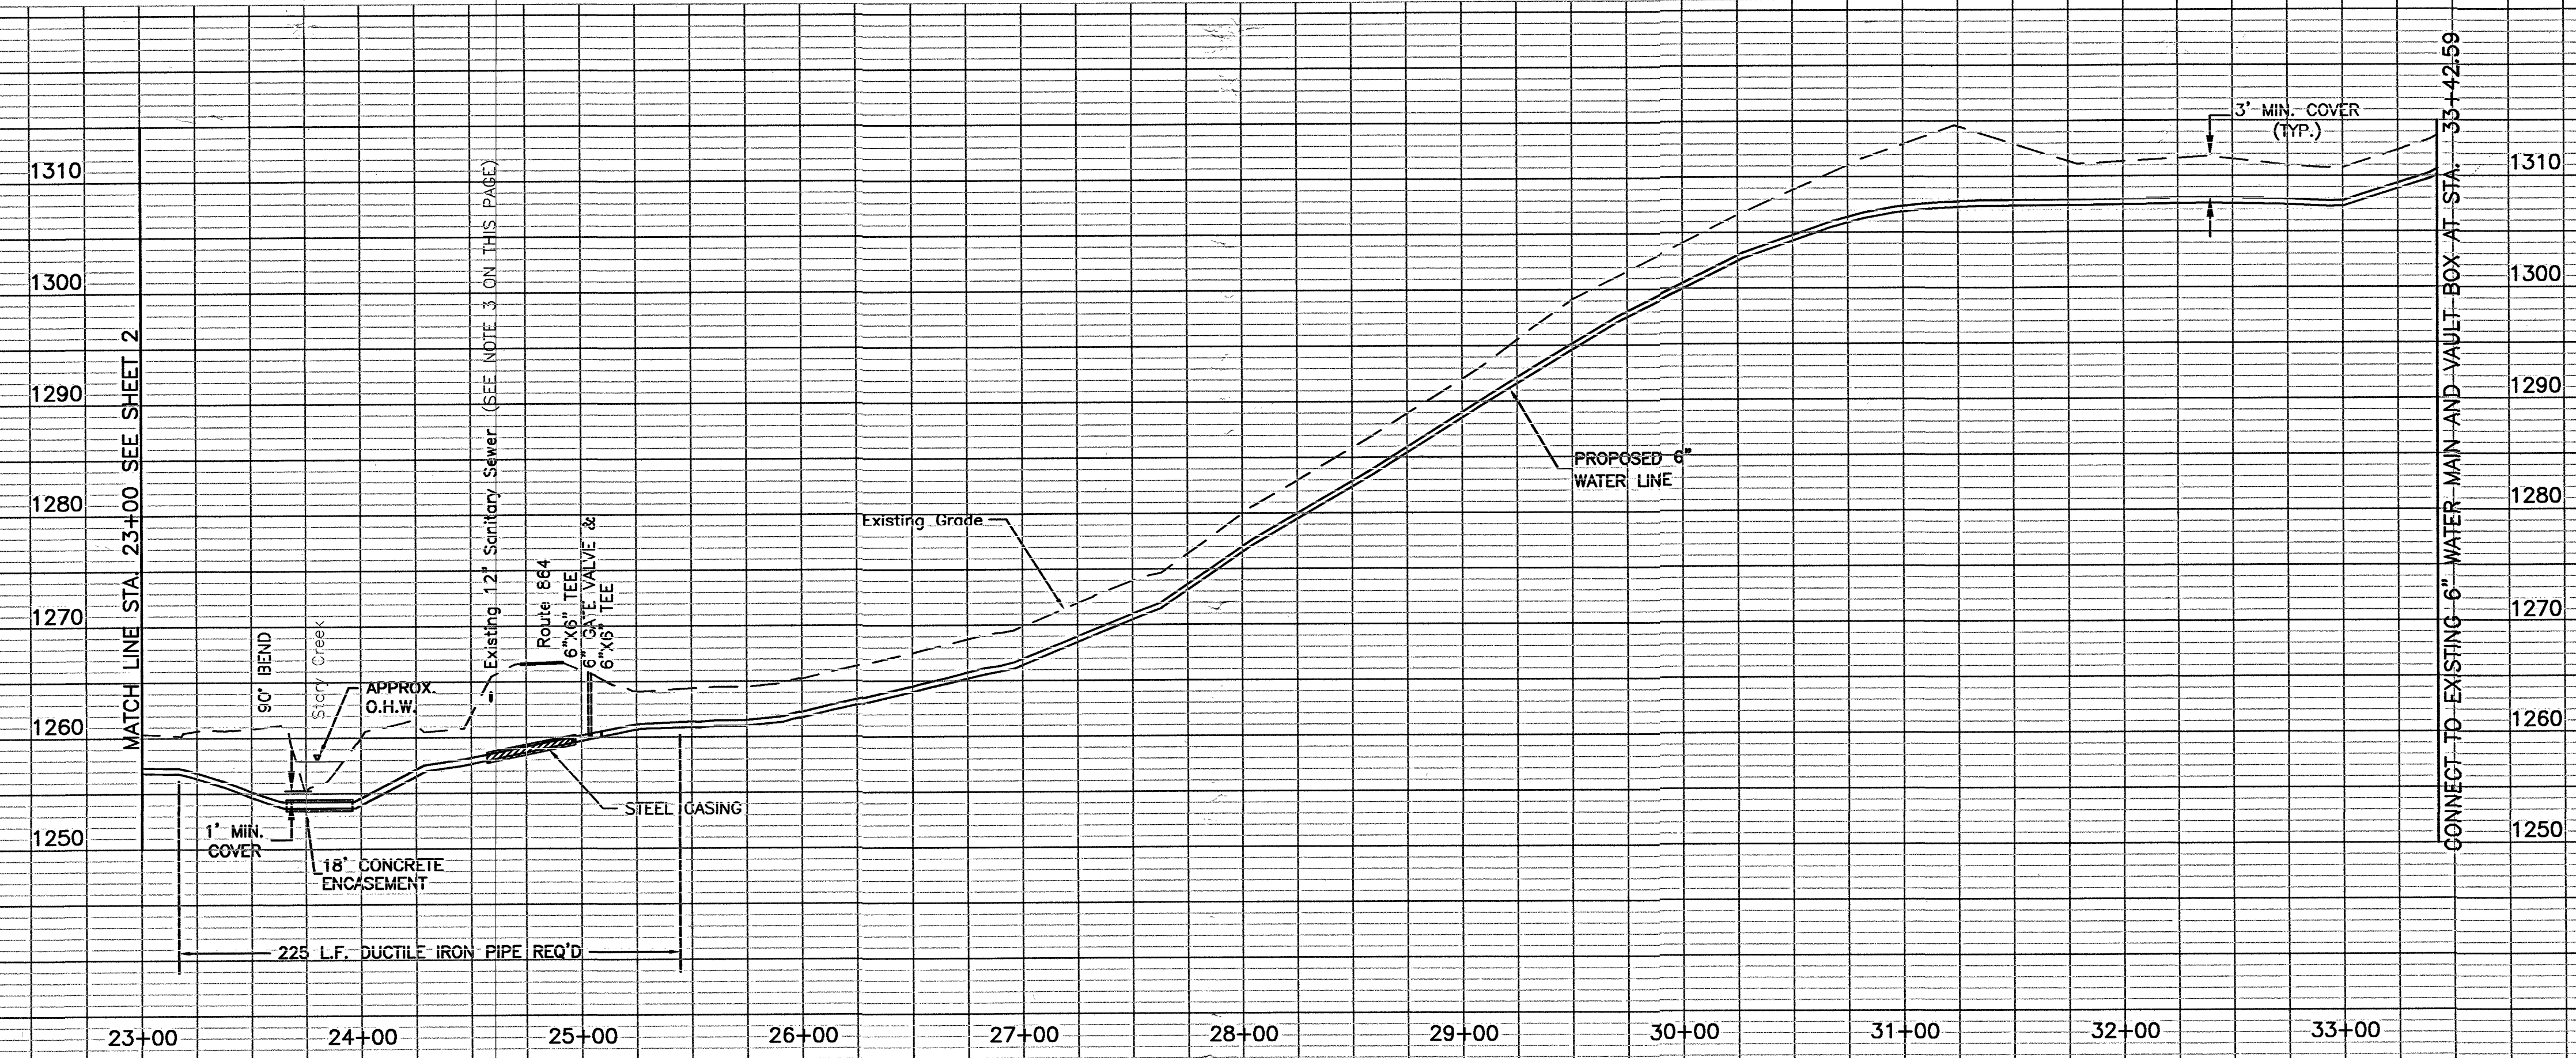

RECEIVED  
AUG 28 2002  
Division of Drinking Water  
Danville Field Office

COMMONWEALTH OF VIRGINIA  
8/12/02  
CHRIS S. FEWSTER  
No. 25125  
PROFESSIONAL ENGINEER

**ANDERSON & ASSOCIATES, INC.**  
Professional Design Services  
www.andassoc.com  
Virginia - North Carolina - Tennessee  
100 Ardmore St.  
Blacksburg, Va. 24060  
540-552-5592

DATE : 24 APR 02  
DESIGNED: CSF  
DRAWN: CLH  
CHECKED: CSF  
QA/QC :

REVISIONS:  
17 JUL 02  
12 AUG 02

**FERRUM CDBG WATER PROJECT**  
WATER MAIN EXTENSION  
FRANKLIN COUNTY, VIRGINIA

**LINE "A"**  
**STA. 23+00 TO 33+42.59**

DOCUMENT NO.  
**20114-004**  
SHEET  
**4 OF 5**

C:\DWELL / Aug 12, 2002 3:04pm / U:\20\20114\20114.01.dwg\20114waterline.dwg: Sheet\_4