

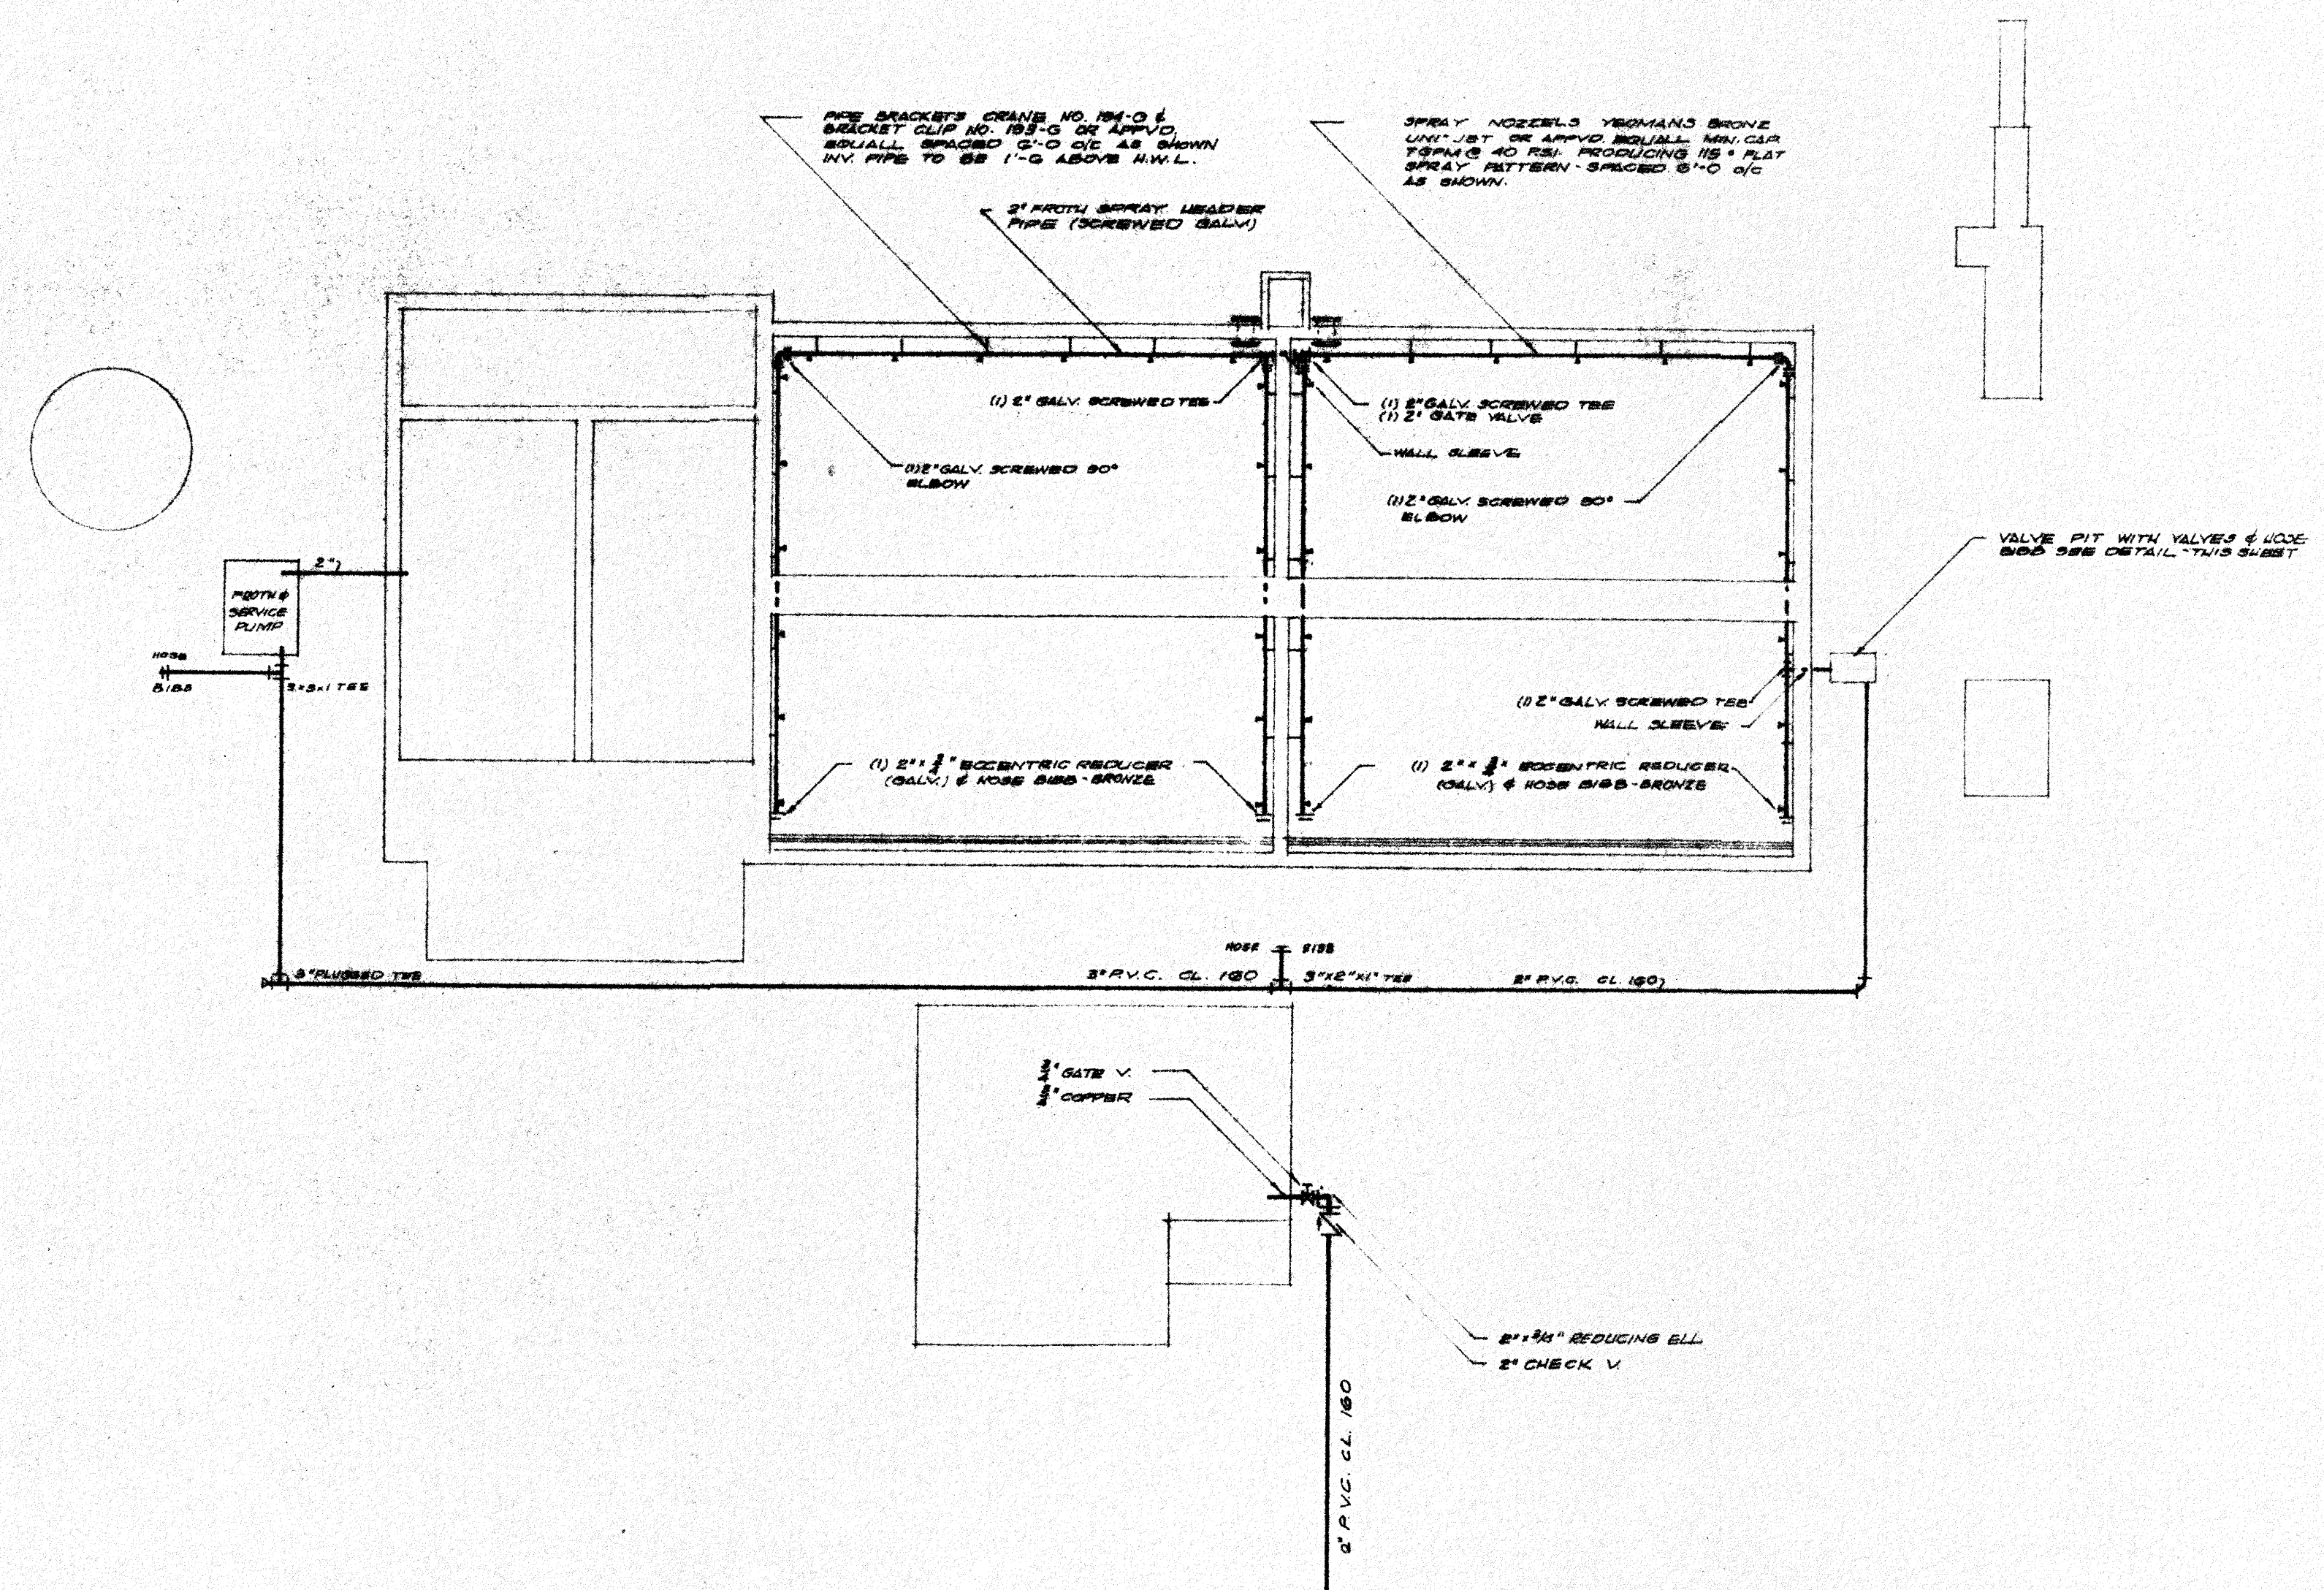
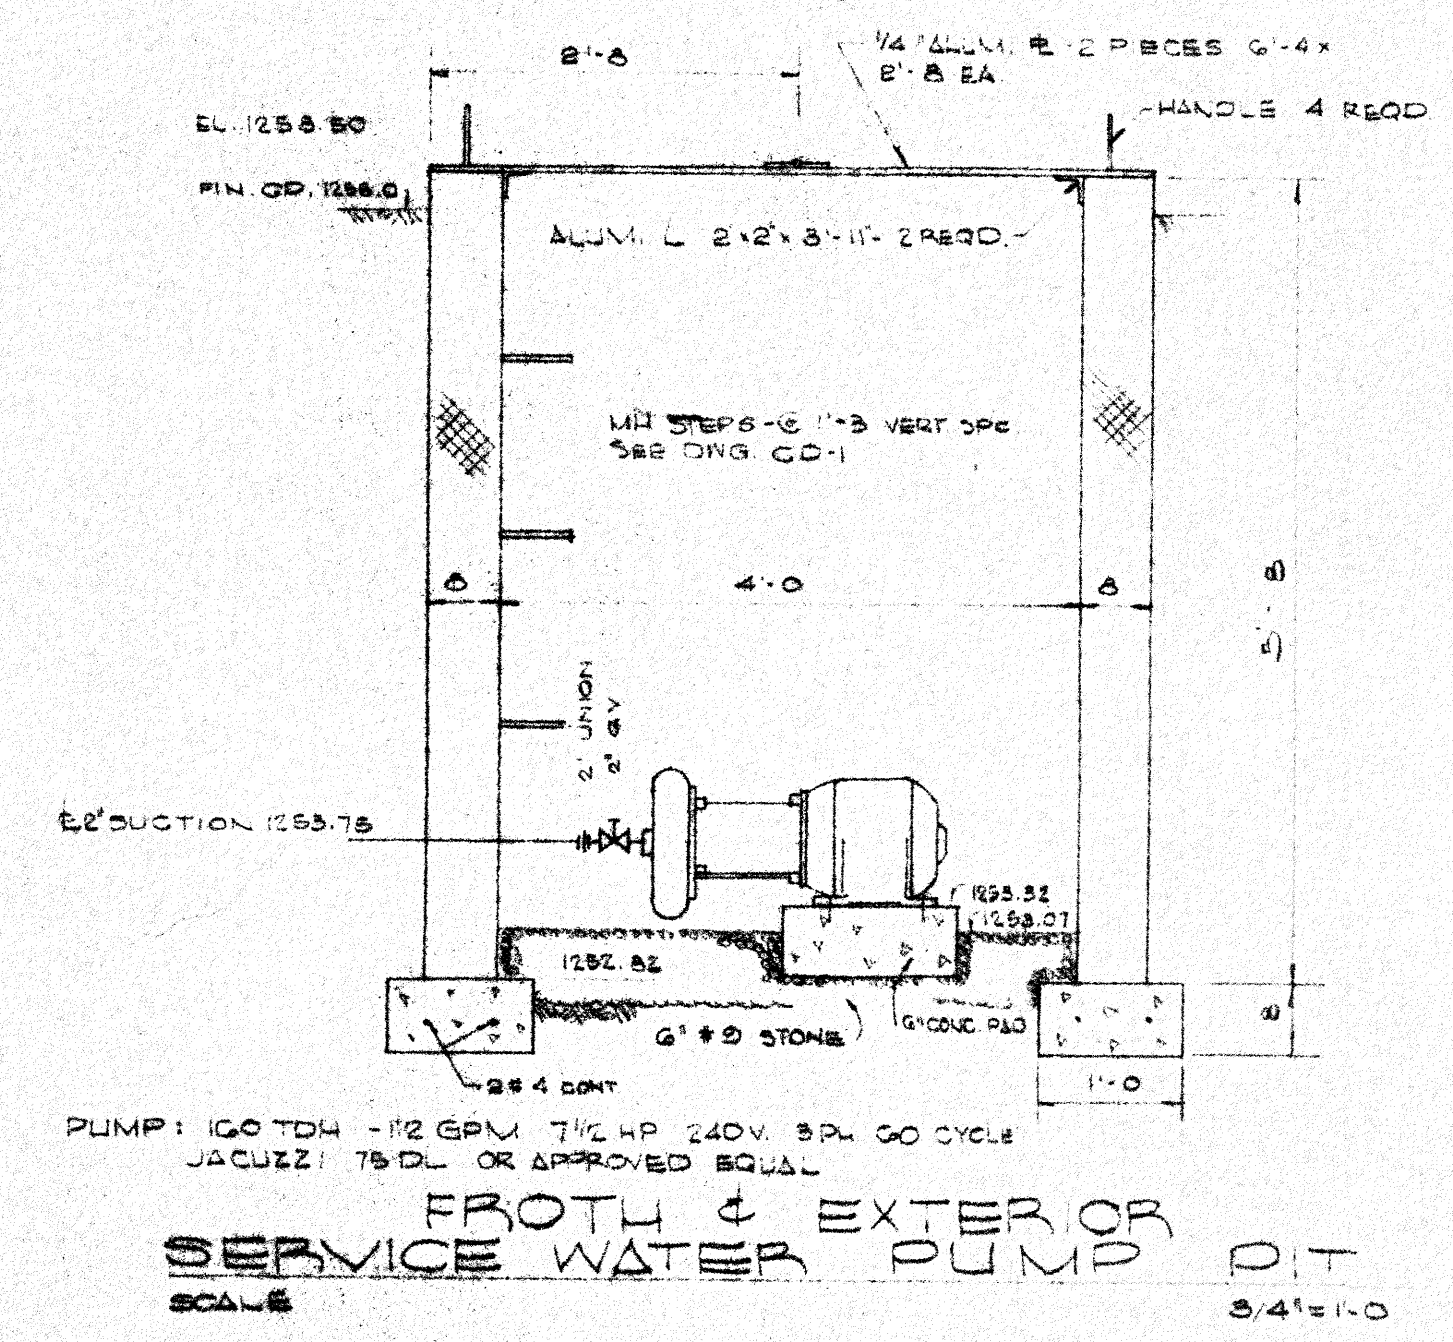


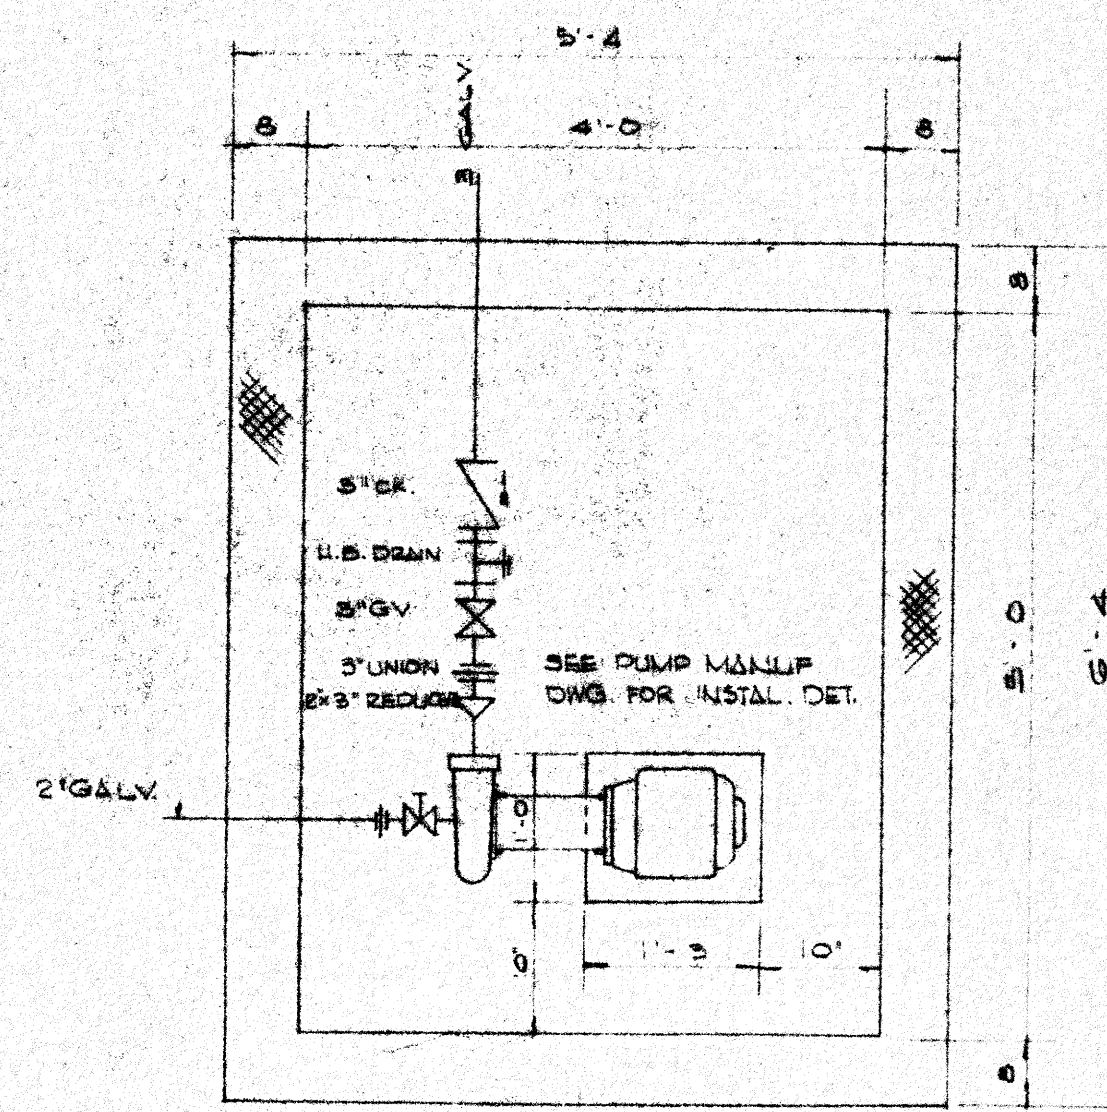

SERVICE WATER SYSTEM LAYOUT
SCALE: 1/4" = 1'-0"

- 3" ELBOW & HOSE BIBB
- 2" x 3/4" x 2" TEE
- 2" GATE VALVE
- 2" UNION
- 2" x 3/4" GATE VALVE
- 2" x 2" x 3/4" TEE

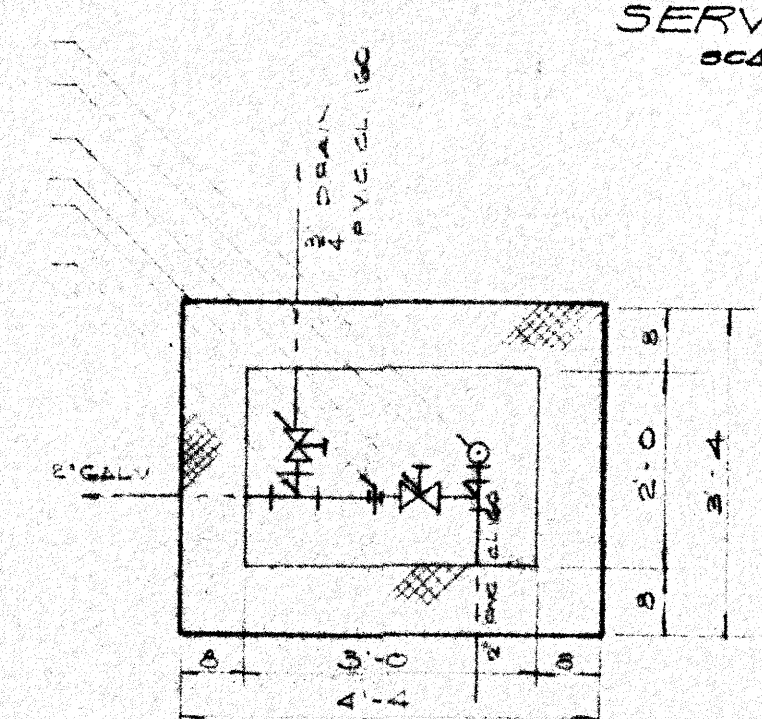

VALVE PIT
SCALE: 1/4" = 1'-0"

2" x 3/4" ECCENTRIC REDUCER
2" HOSE BIBB DRAIN
HOSE BIBB CONN. ON SUPPLY LEADER

NOTE: ALL EXPOSED LIVE WATER PIPING FOR COOLANT/ATOR SUPPLY & EXHAUST CONTROL TO BE INSULATED AGAINST FREEZING WITH 2" MIN. PEEK GLASS INSULATING WAT.

NOTE: YARD HOSE BIBBS TO BE INSTALLED IN STD. VALVE BOXES

DATE	REVISIONS
10-3-10	1
10-3-10	2
10-3-10	3
10-3-10	4

PREPARED BY
J. A. GUSTIN & ASSOCIATES
CONSULTING ENGINEERS
MARTINSVILLE, VIRGINIA

FERRUM WATER AND SEWERAGE AUTHORITY	SCALE	DRAWN BY
WASTE TREATMENT PLANT FACILITY	NOTED	J. A. K.
FRESH WATER SUPPLY & FROTH CONTROL	REVISIONS	
DATE	APPROVED BY	DRAWING NUMBER
10-20-10		TP-10