


25

30

35

40

PLAN	SURVEYED.	BY	DATE
	PLOTTED.		
	ALIGNMENT CHECKED.		
	RT. OF WAY CHECKED.		
NOTE BOOK			
No.			

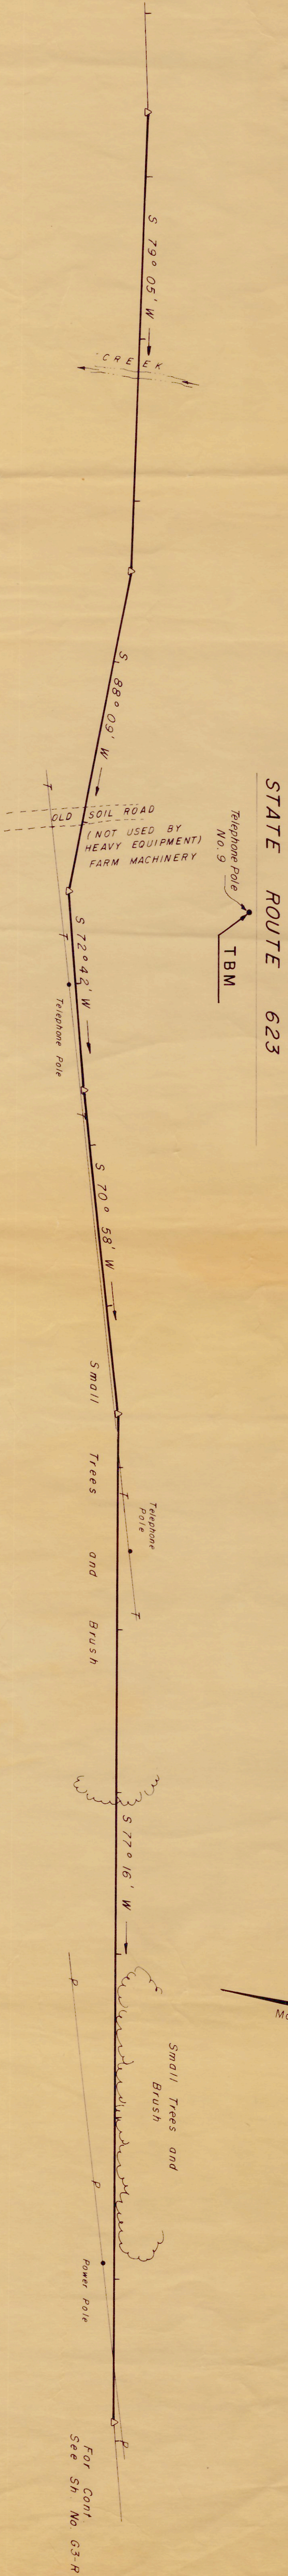

Sta. 25+60.11
 $\Delta = 3^{\circ}39' \text{ Rt.}$
Take up Δ in 2 joints

Sta. 28+43.41
 $\Delta = 9^{\circ}04' \text{ Rt.}$
Req'd. : 1-11 1/2 bend
Correct Δ in 1 joint
1 - Type "F" Anchor

Sta. 30+43.71
 $\Delta = 15^{\circ}27' \text{ Lt.}$
Req'd. : 1-11 1/2 bend
Correct Δ in 2 joints
1 - Type "F" Anchor

Sta. 31+67.73
 $\Delta = 1^{\circ}44' \text{ Lt.}$
Take up Δ in 1 joint


Sta. 33+67.97
 $\Delta = 6^{\circ}18' \text{ Rt.}$
Take up Δ in 3 joints

Sta. 39+88.39
 $\Delta = 4^{\circ}58' \text{ Lt.}$
Take up Δ in 2 joints

TEMPORARY BENCH MARKS:

Double Nail in Telephone Poles between Stations 10+00 and 47+00 along St. Rt. 623
Telephone Pole No. 1
Elev. = 1324.72
Telephone Pole No. 9
Elev. = 1364.69

PROFILE	SURVEYED.	BY	DATE
	PLOTTED.		
	GRADES CHECKED.		
	B. M.'S. NOTED.		
NOTE BOOK			
No.			

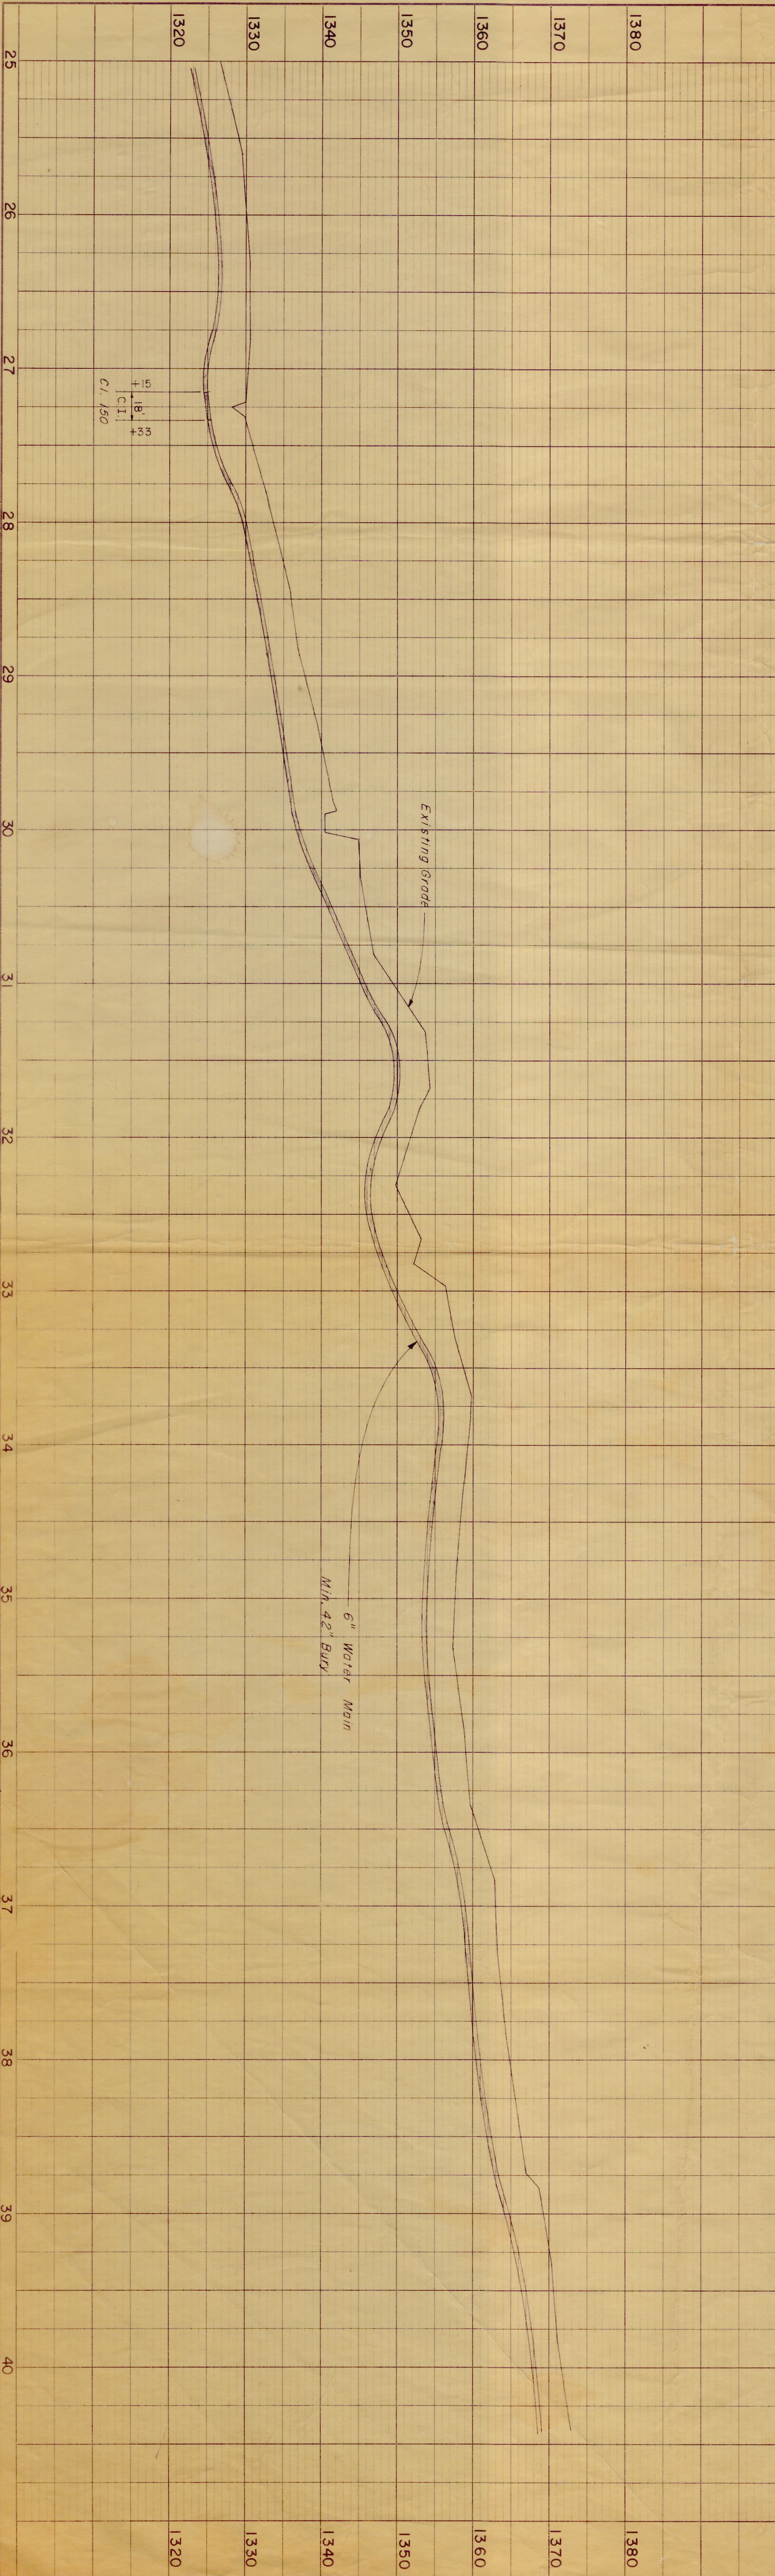

5' 1" B
1' 1" C
C/150

K&E PLATT, INC. AN PROFILE
148 7024 148 148

FERRUM WATER & SEWERAGE AUTHORITY
J. A. GUSTIN & ASSOCIATES-CONSULTING ENGINEERS
MARTINSVILLE, VIRGINIA

WATER SUPPLY SYSTEM

SCALE Horiz. : 1" = 50'
Vert. : 1" = 10'

LINE "G"
STA. 25+60.11 - 39+88.39
FEBRUARY 26, 1974

G2-R