

JAMES
D.B. 1295
D.B. 949
95



NOTE:

1. ALL SERVICE LINES SHALL BE $\frac{3}{4}$ " UNLESS OTHERWISE NOTED.
2. CONTRACTOR SHALL BE RESPONSIBLE FOR MAINTAINENCE AND UPKEEP OF E&S MEASURES.
3. SILT FENCE BARRIERS WILL BE USED AS TEMPORARY E&S CONTROL UNTIL THE PERMANENT SEEDING IS IN PLACE.
4. PIPES AT SLOPES GREATER THAN 15% SHALL BE CONSTRUCTED WITH RESTRAINED JOINTS AT EACH PIPE JOINT AND SHALL HAVE CONCRETE SLOPE ANCHORS INSTALLED AT BELL END OF EVERY FORTH PIPE. SLOPE ANCHORS SHALL BE IN ACCORDANCE WITH STANDARD DETAIL CA-3. RESTRAINED JOINT FITTINGS SHALL BE INSTALLED AN ADDITIONAL 80 FEET EACH END BEYOND THE POINTS WHERE THE SLOPE DECREASES.

WESLEY D. JAMES
D.B. 552 PG. 1295
D.B. 537 PG. 949
TAX: 80-95

JOHN R. CROOK
D.B. 650 PG. 999
D.B. 623 PG. 1836
TAX: 80-95.4

FERRUM COLLEGE
D.B. 97 PG. 143
TAX: 80-93

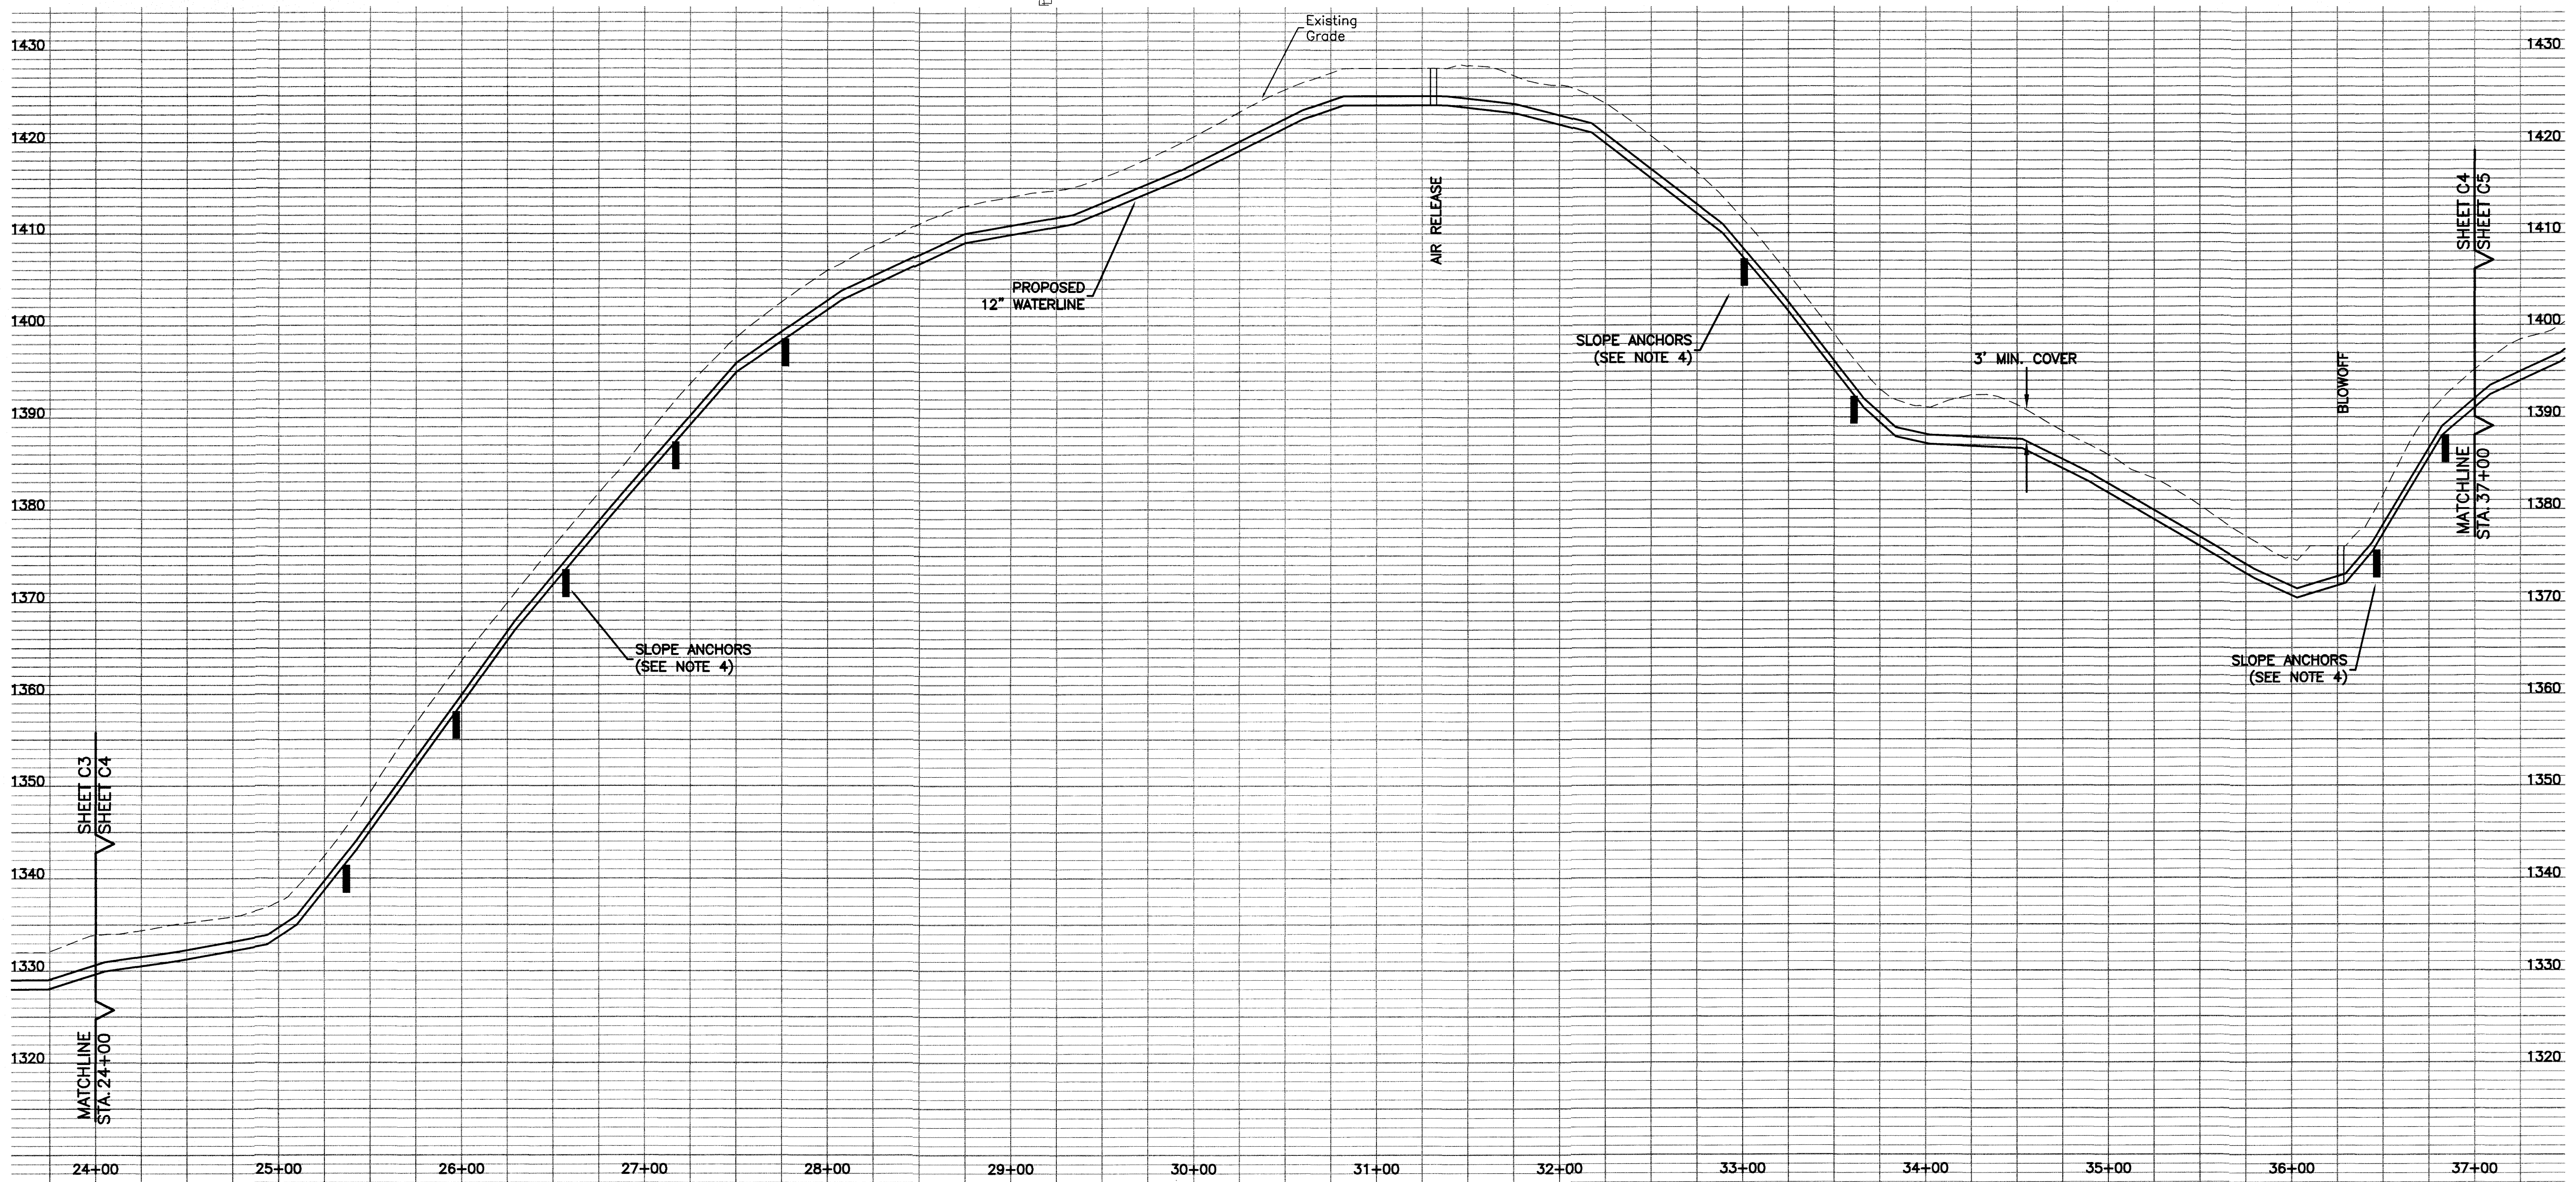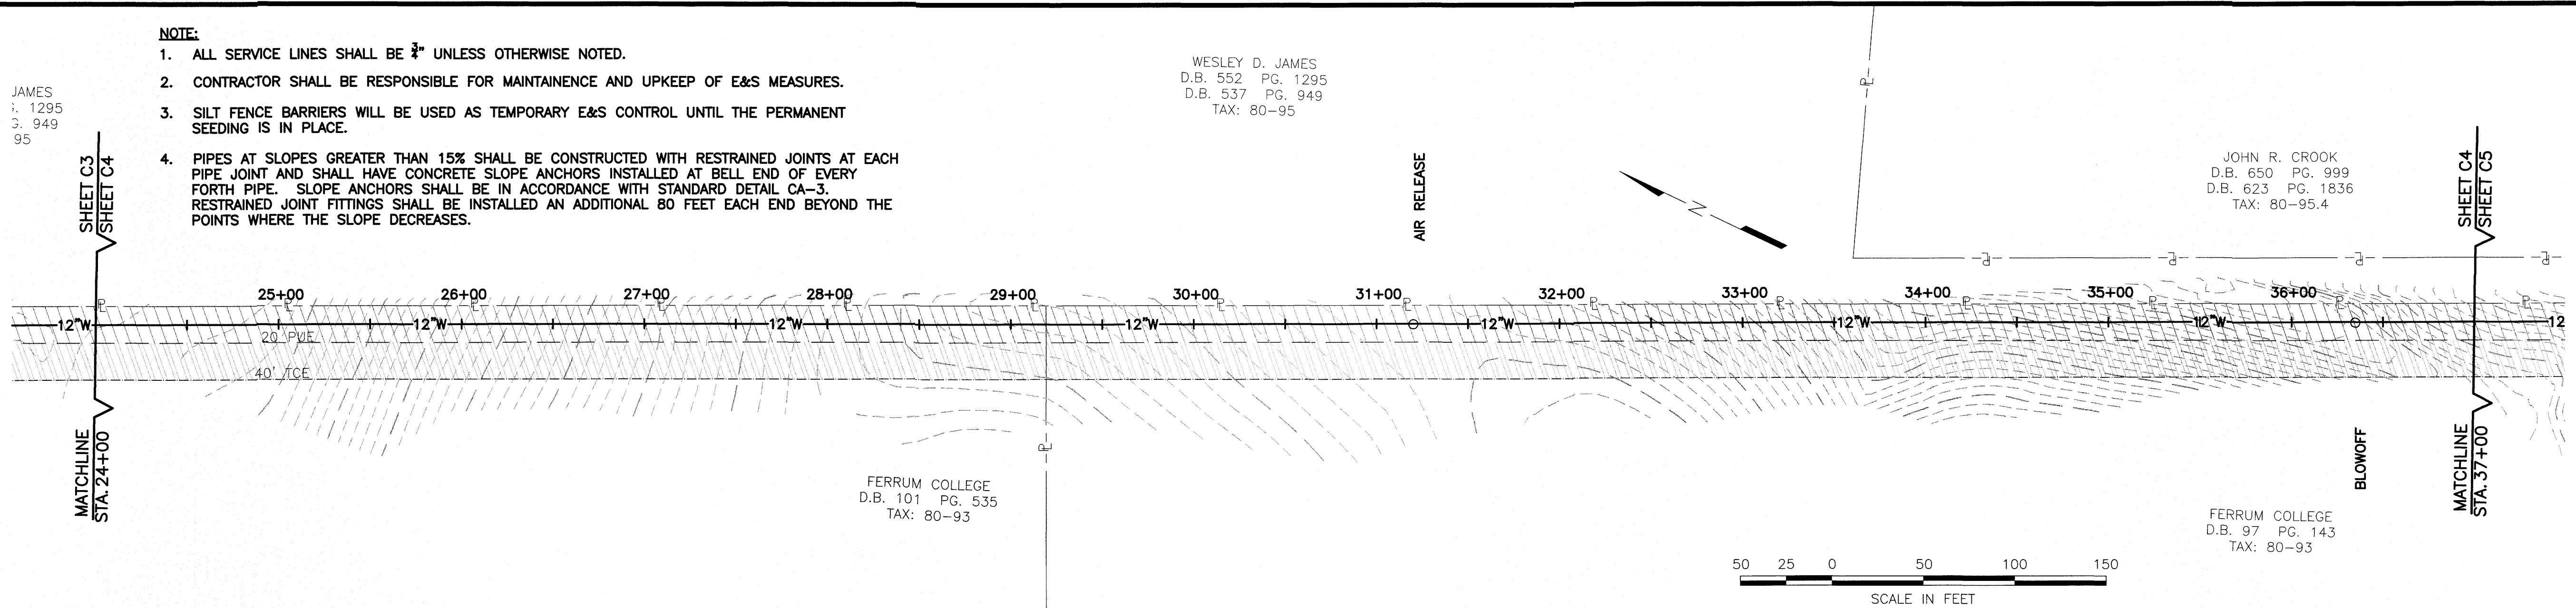

ANDERSON & ASSOCIATES, INC.

Professional Design Services
www.andassoc.com

Virginia - North Carolina - Tennessee

100 Ardmore St.
Blacksburg, Va. 24060
540-552-5592

DATE : 08 SEP 04
DESIGNED: CSF
DRAWN : SEC
CHECKED : CSF, RNJ
QA / QC :

REVISIONS:
31 JAN 05
19 APR 05
RECORD

FERRUM WATER SYSTEM IMPROVEMENTS
FERRUM, VIRGINIA

LINE "B"
PLAN & PROFILES - STA. 24+00 TO STA. 37+00