

JAMES  
D.B. 1295  
C. 949  
95

**NOTE:**



1. ALL SERVICE LINES SHALL BE  $\frac{3}{4}$ " UNLESS OTHERWISE NOTED.
2. CONTRACTOR SHALL BE RESPONSIBLE FOR MAINTAINENCE AND UPKEEP OF E&S MEASURES.
3. SILT FENCE BARRIERS WILL BE USED AS TEMPORARY E&S CONTROL UNTIL THE PERMANENT SEEDING IS IN PLACE.
4. PIPES AT SLOPES GREATER THAN 15% SHALL BE CONSTRUCTED WITH RESTRAINED JOINTS AT EACH PIPE JOINT AND SHALL HAVE CONCRETE SLOPE ANCHORS INSTALLED AT BELL END OF EVERY FORTH PIPE. SLOPE ANCHORS SHALL BE IN ACCORDANCE WITH STANDARD DETAIL CA-3. RESTRAINED JOINT FITTINGS SHALL BE INSTALLED AN ADDITIONAL 80 FEET EACH END BEYOND THE POINTS WHERE THE SLOPE DECREASES.

WESLEY D. JAMES  
D.B. 552 PG. 1295  
D.B. 537 PG. 949  
TAX: 80-95

JOHN R. CROOK  
D.B. 650 PG. 999  
D.B. 623 PG. 1836  
TAX: 80-95.4

FERRUM COLLEGE  
D.B. 97 PG. 143  
TAX: 80-93

FERRUM COLLEGE  
D.B. 101 PG. 535  
TAX: 80-93

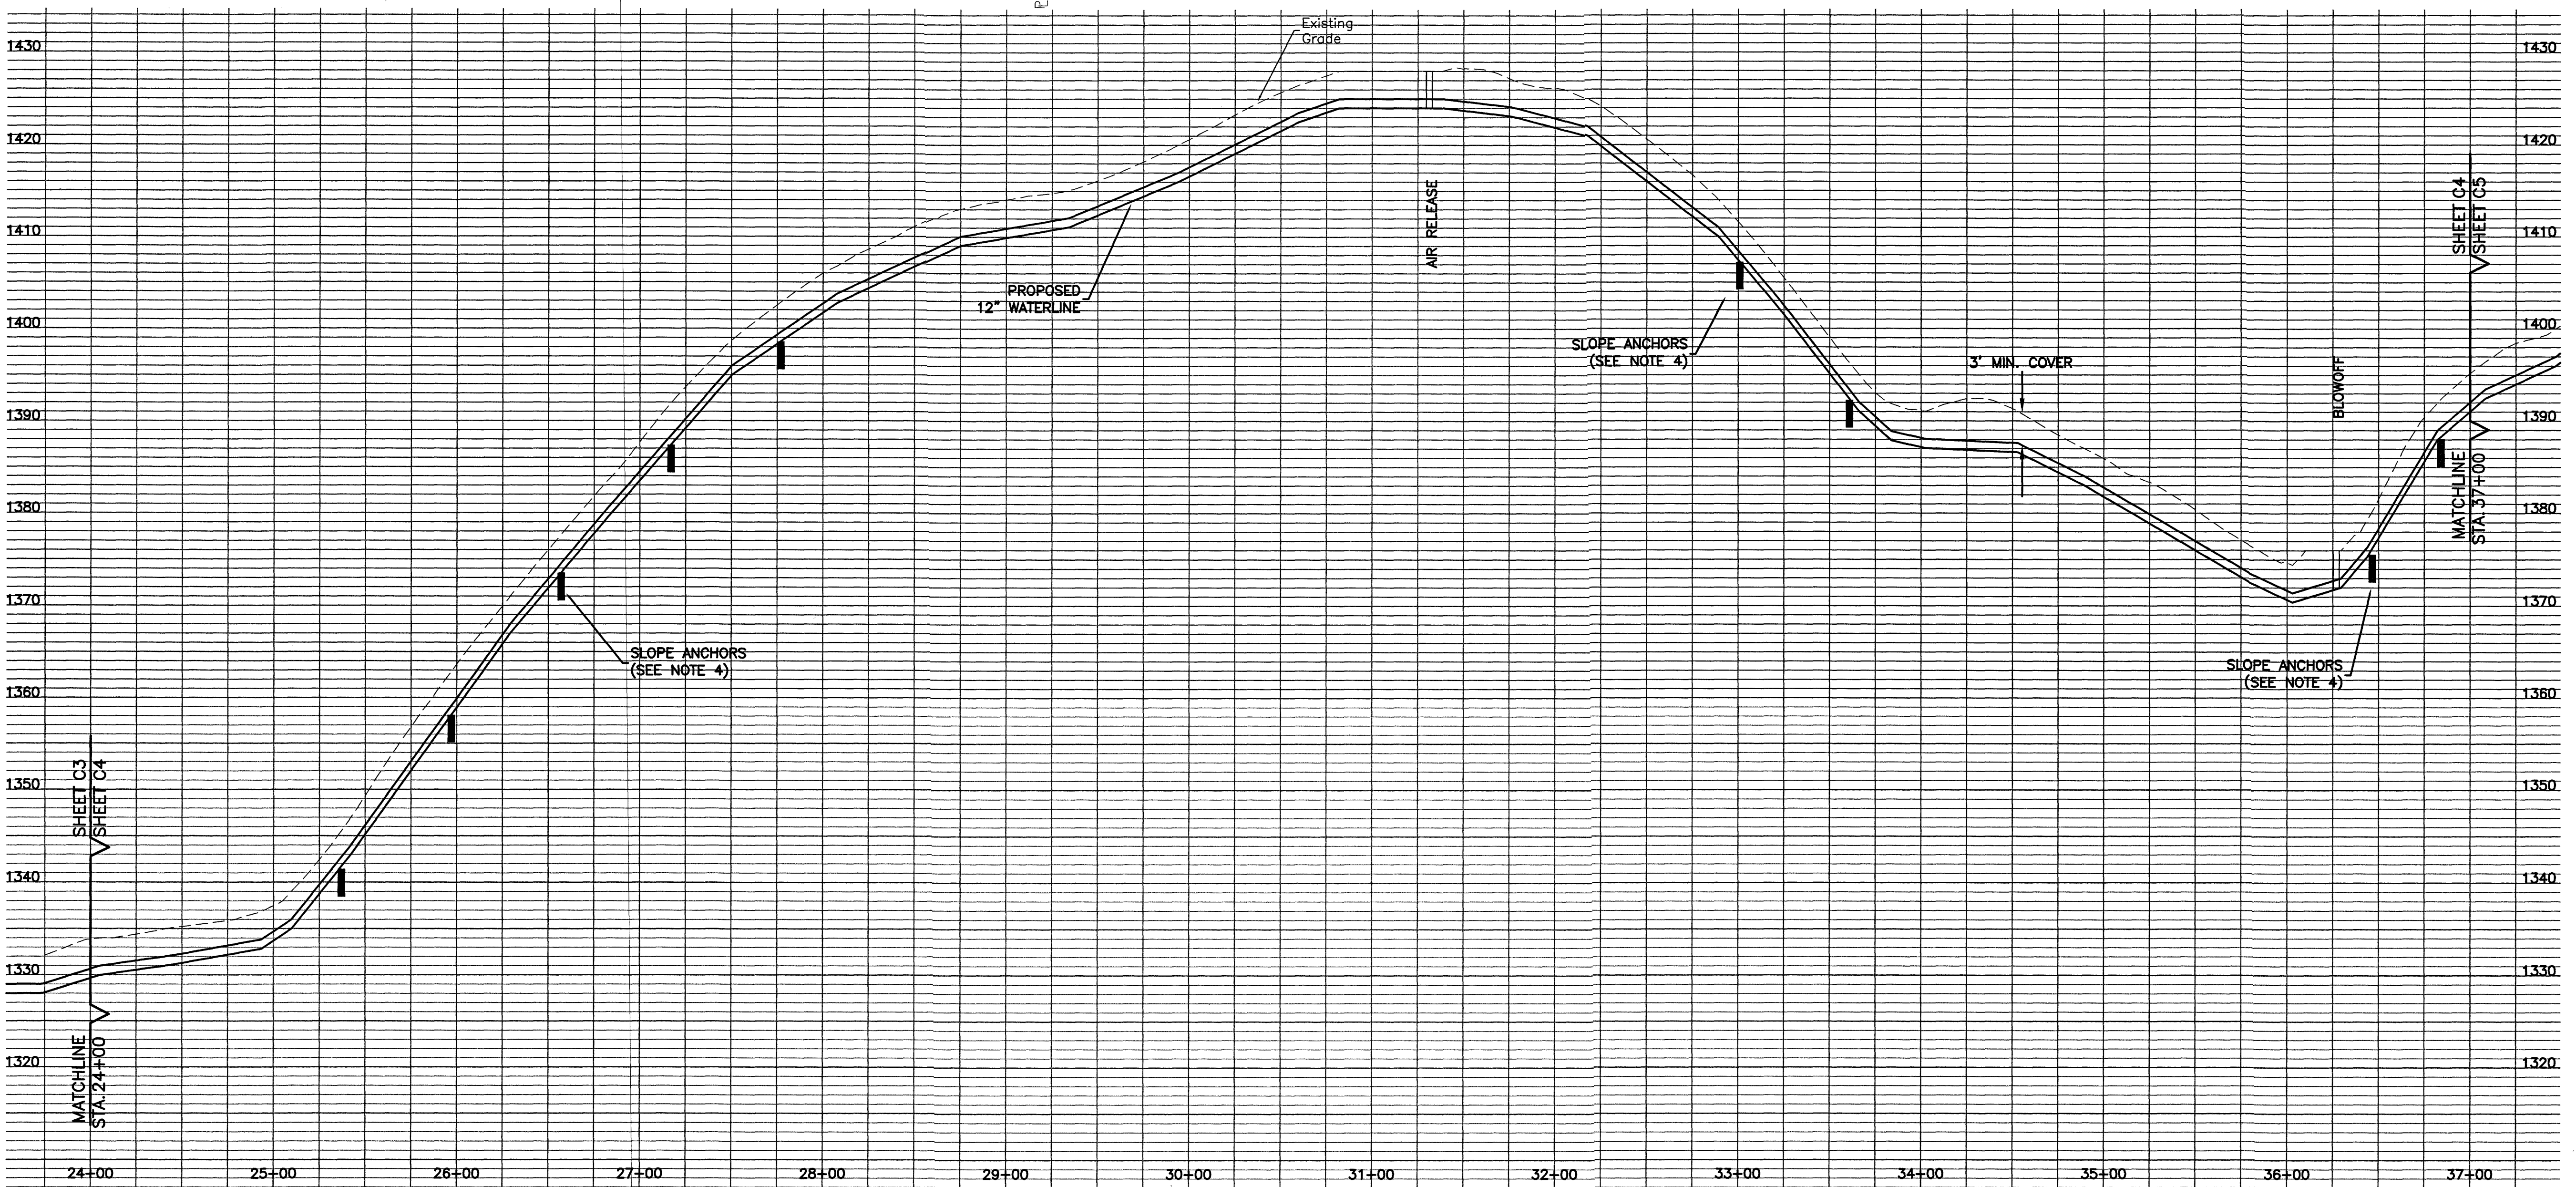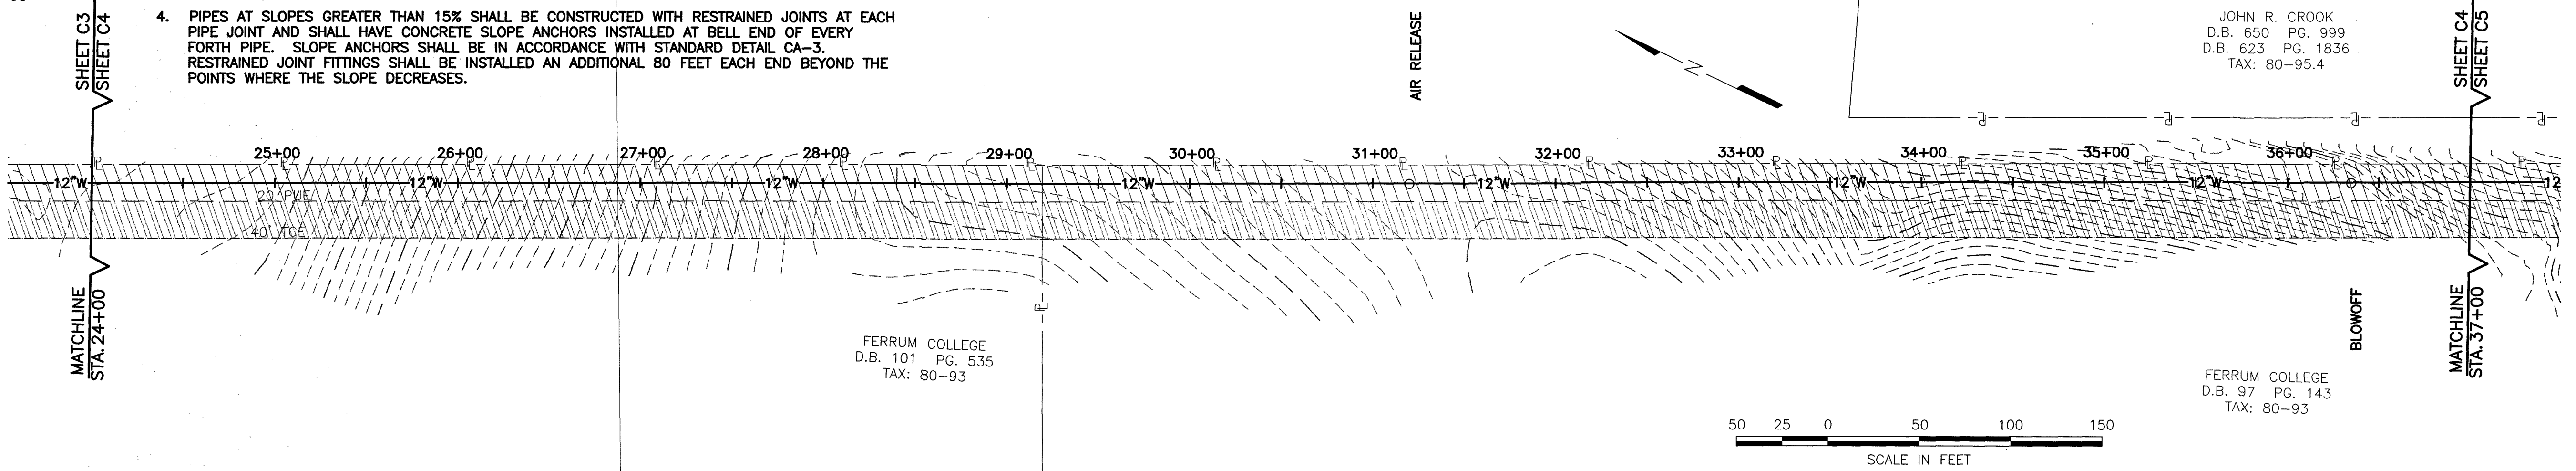

**ANDERSON & ASSOCIATES, INC.**  
Professional Design Services  
www.andassoc.com  
Virginia - North Carolina - Tennessee

100 Ardmore St.  
Blacksburg, Va. 24060  
540-552-5592

DATE : 08 SEP 04  
DESIGNED: CSF  
DRAWN : SEC  
CHECKED: CSF, RNJ  
QA/QC :

REVISIONS:  
31 JAN 05  
19 APR 05  
RECORD

**FERRUM WATER SYSTEM IMPROVEMENTS**  
FERRUM, VIRGINIA

**LINE "B"**  
**PLAN & PROFILES - STA. 24+00 TO STA. 37+00**

DOCUMENT NO.  
**21136-002**  
SHEET  
**C4** OF **19**