
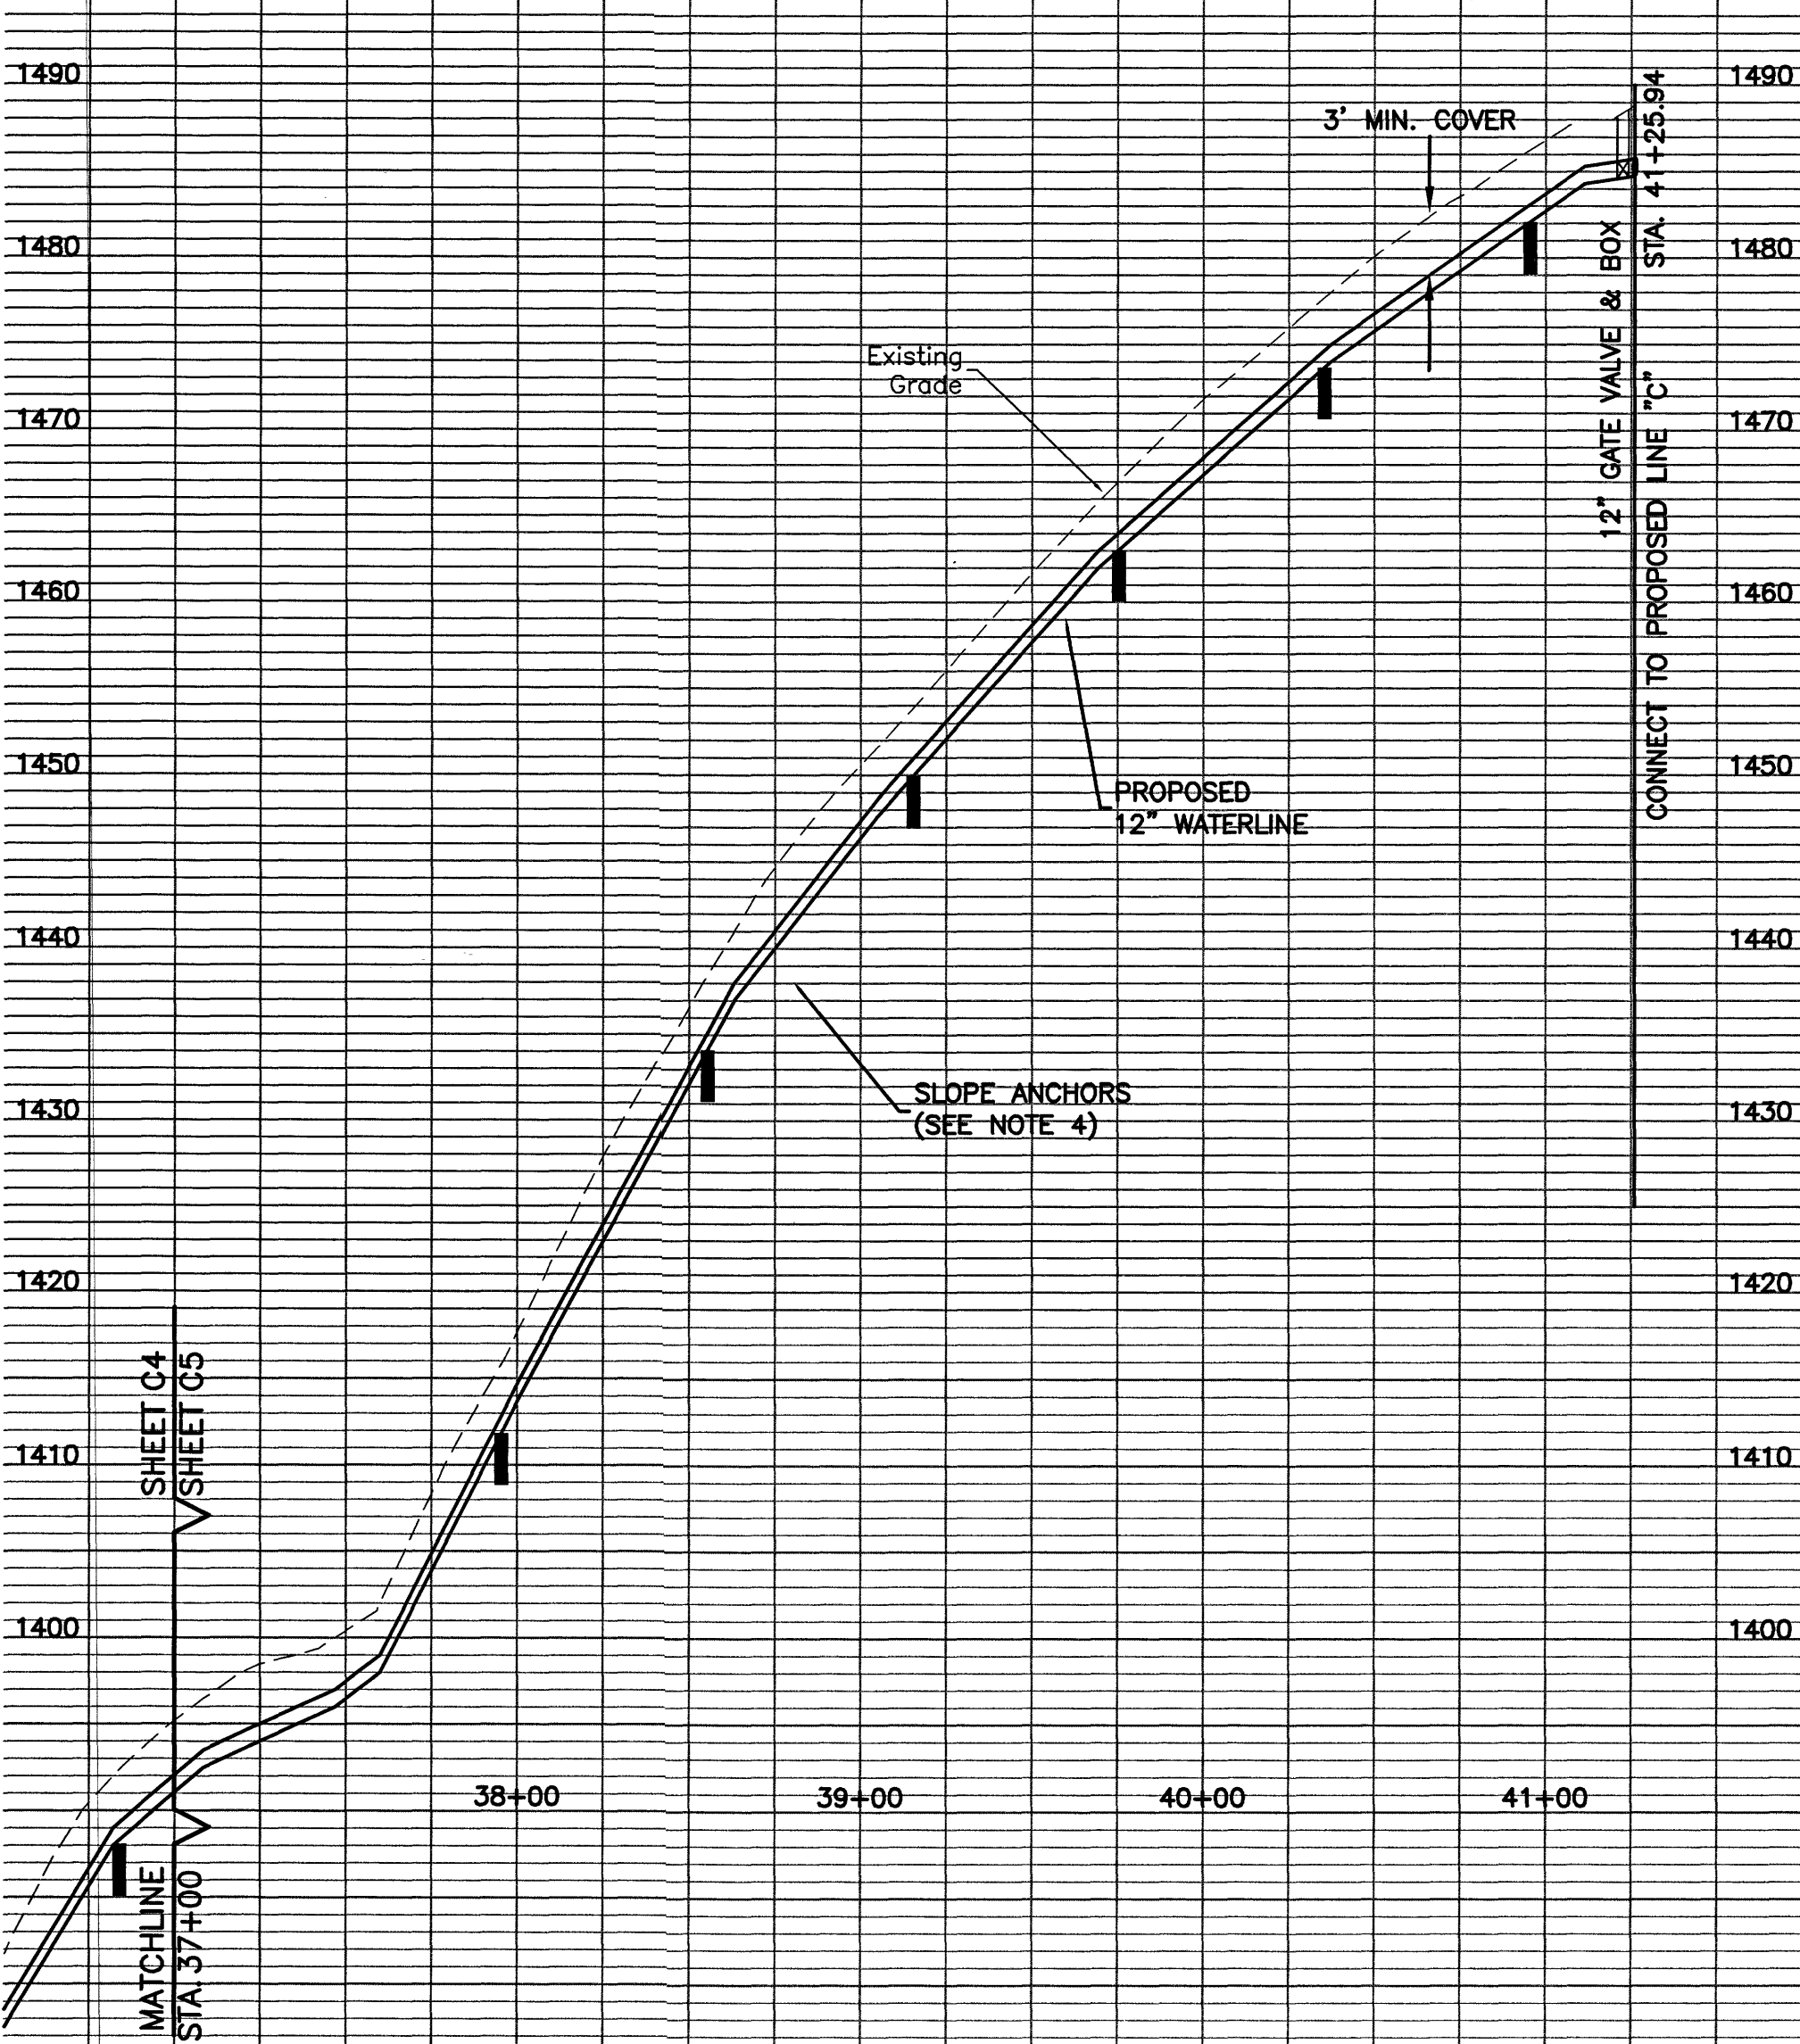


NOTE:

1. ALL SERVICE LINES SHALL BE 3" UNLESS OTHERWISE NOTED.
2. CONTRACTOR SHALL BE RESPONSIBLE FOR MAINTAINENCE AND UPKEEP OF E&S MEASURES.
3. SILT FENCE BARRIERS WILL BE USED AS TEMPORARY E&S CONTROL UNTIL THE PERMANENT SEEDING IS IN PLACE.
4. PIPES AT SLOPES GREATER THAN 15% SHALL BE CONSTRUCTED WITH RESTRAINED JOINTS AT EACH PIPE JOINT AND SHALL HAVE CONCRETE SLOPE ANCHORS INSTALLED AT BELL END OF EVERY FORTH PIPE. SLOPE ANCHORS SHALL BE IN ACCORDANCE WITH STANDARD DETAIL CA-3. RESTRAINED JOINT FITTINGS SHALL BE INSTALLED AN ADDITIONAL 80 FEET EACH END BEYOND THE POINTS WHERE THE SLOPE DECREASES.

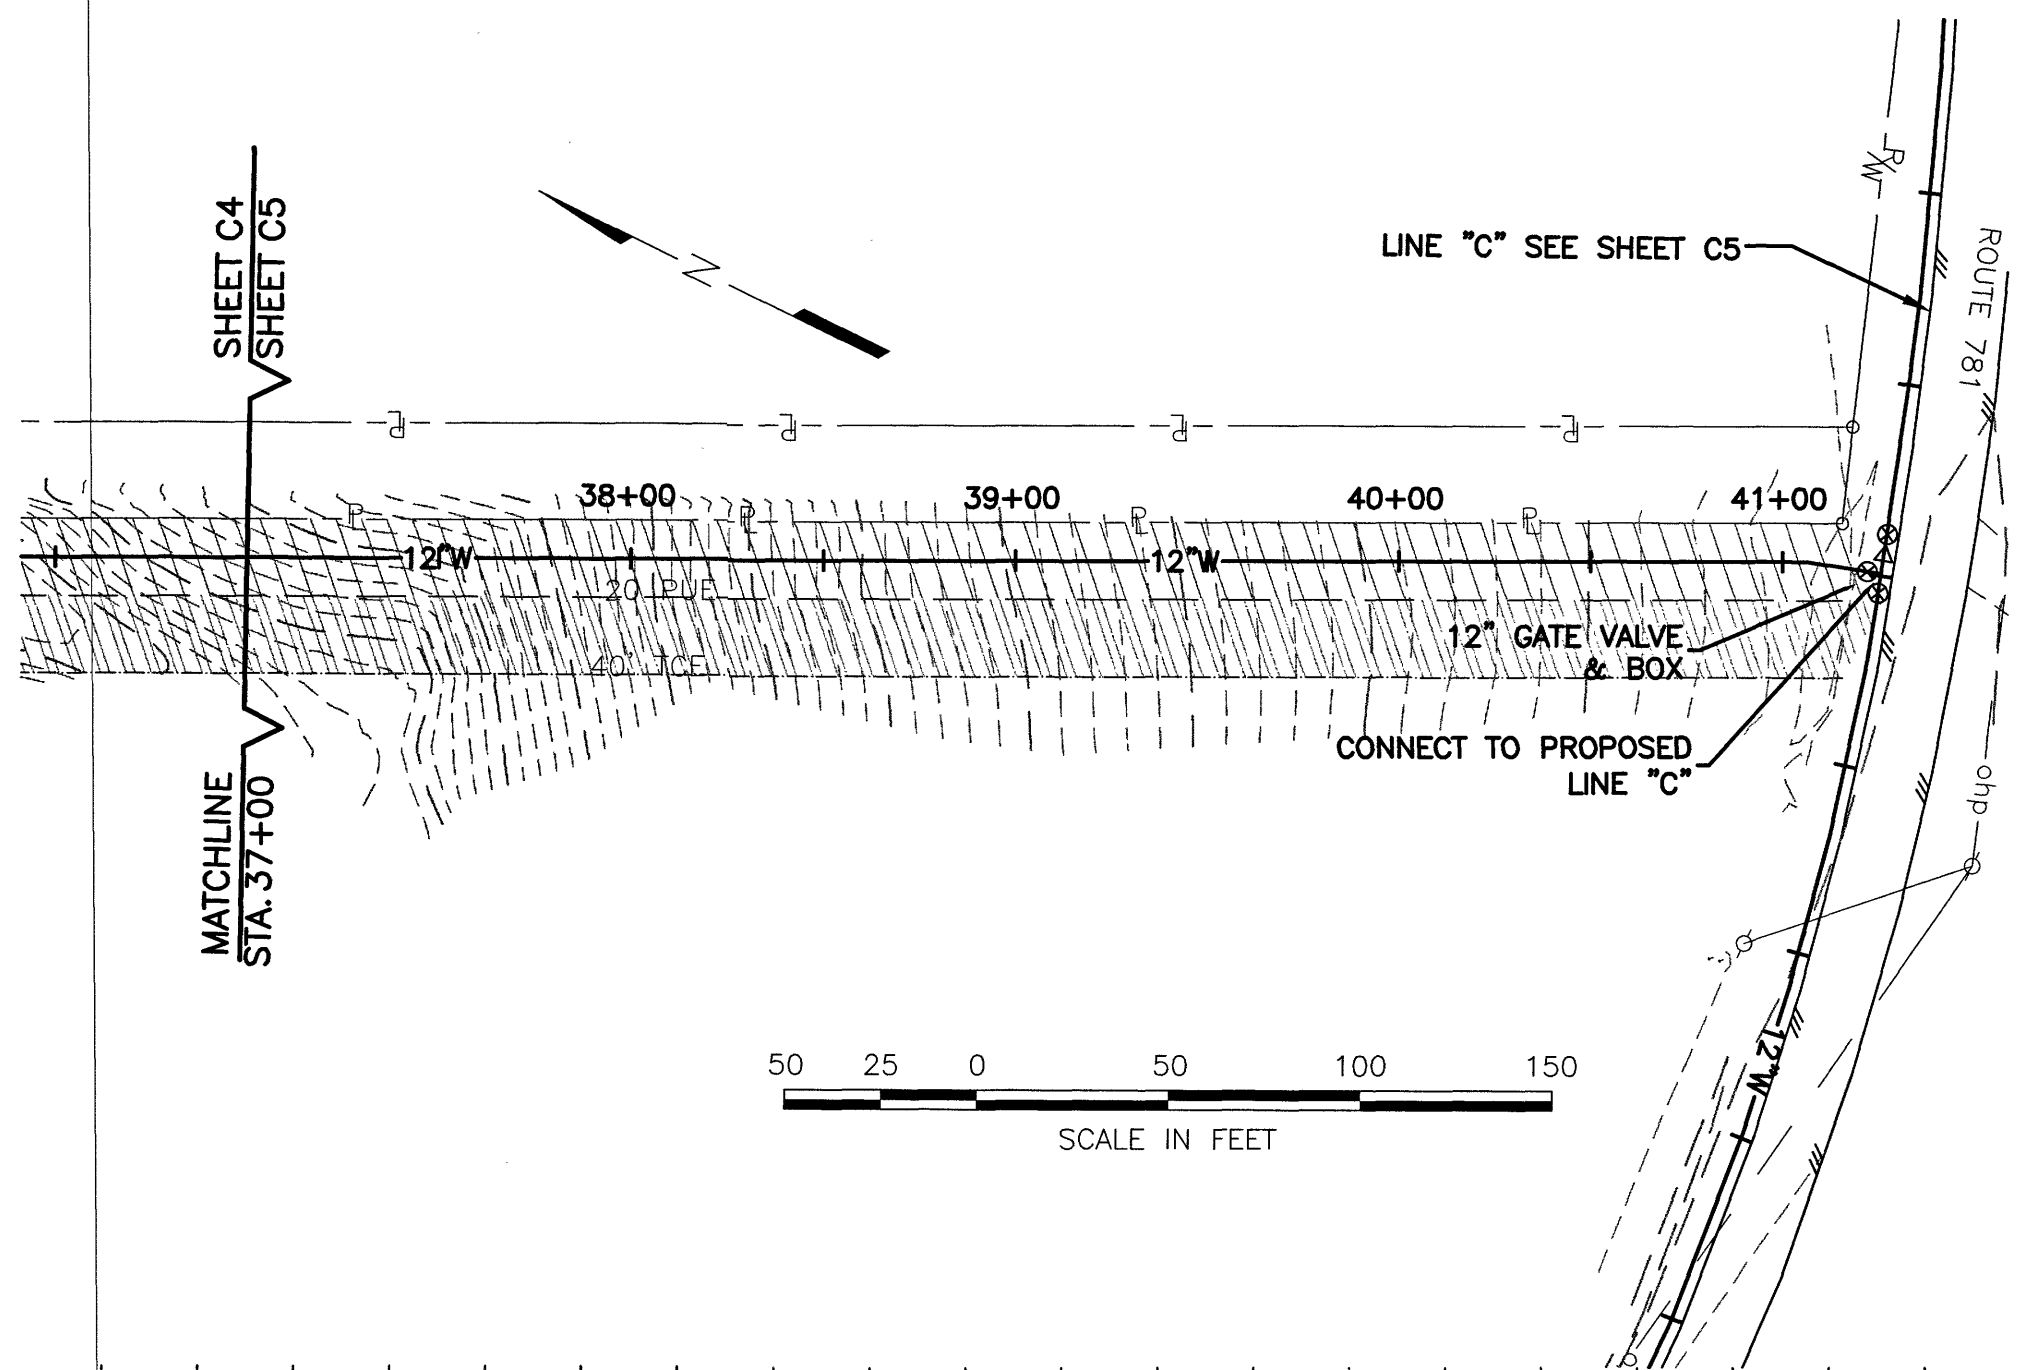

ANDERSON & ASSOCIATES, INC.
Professional Design Services
www.andassoc.com
Virginia - North Carolina - Tennessee

100 Ardmore St.
Blacksburg, Va. 24060
540-552-5592

DATE : 08 SEP 04
DESIGNED : CSF
DRAWN : SEC
CHECKED : CSF, RNJ
QA / QC :

REVISIONS:
19 APR 05
RECORD

FERRUM WATER SYSTEM IMPROVEMENTS
FERRUM, VIRGINIA

LINE "B"
PLAN & PROFILES - STA. 37+00 TO STA. 40+25.94

DOCUMENT NO.
21136 - 002
SHEET
C5 OF 19