




NOTES:

1. ALL SERVICE LINES SHALL BE 3" UNLESS OTHERWISE NOTED.
2. CONTRACTOR SHALL BE RESPONSIBLE FOR MAINTAINENCE AND UPKEEP OF E&S MEASURES.
3. SILT FENCE BARRIERS WILL BE USED AS TEMPORARY E&S CONTROL UNTIL THE PERMANENT SEEDING IS IN PLACE.
4. CONTRACTOR SHALL DOUBLE PRIME AND SEAL FULL WIDTH OF ROAD SURFACE ALONG FULL LENGTH OF ROAD WHERE UTILITIES ARE INSTALLED.

ALL GRAVITY SEWER SHALL BE DUCTILE IRON PIPE

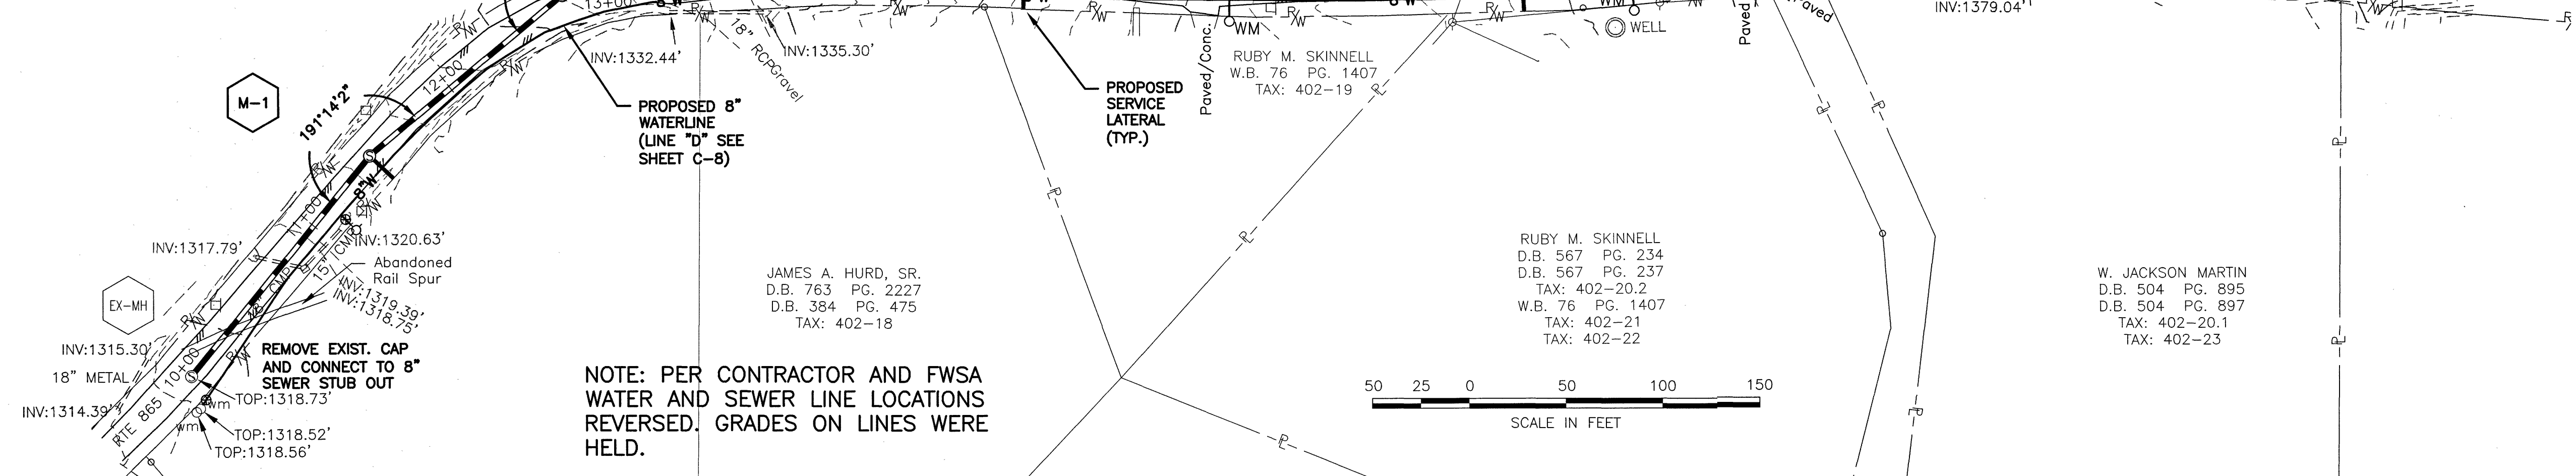

NOTE: PER CONTRACTOR AND FWSA WATER AND SEWER LINE LOCATIONS REVERSED. GRADES ON LINES WERE HELD.

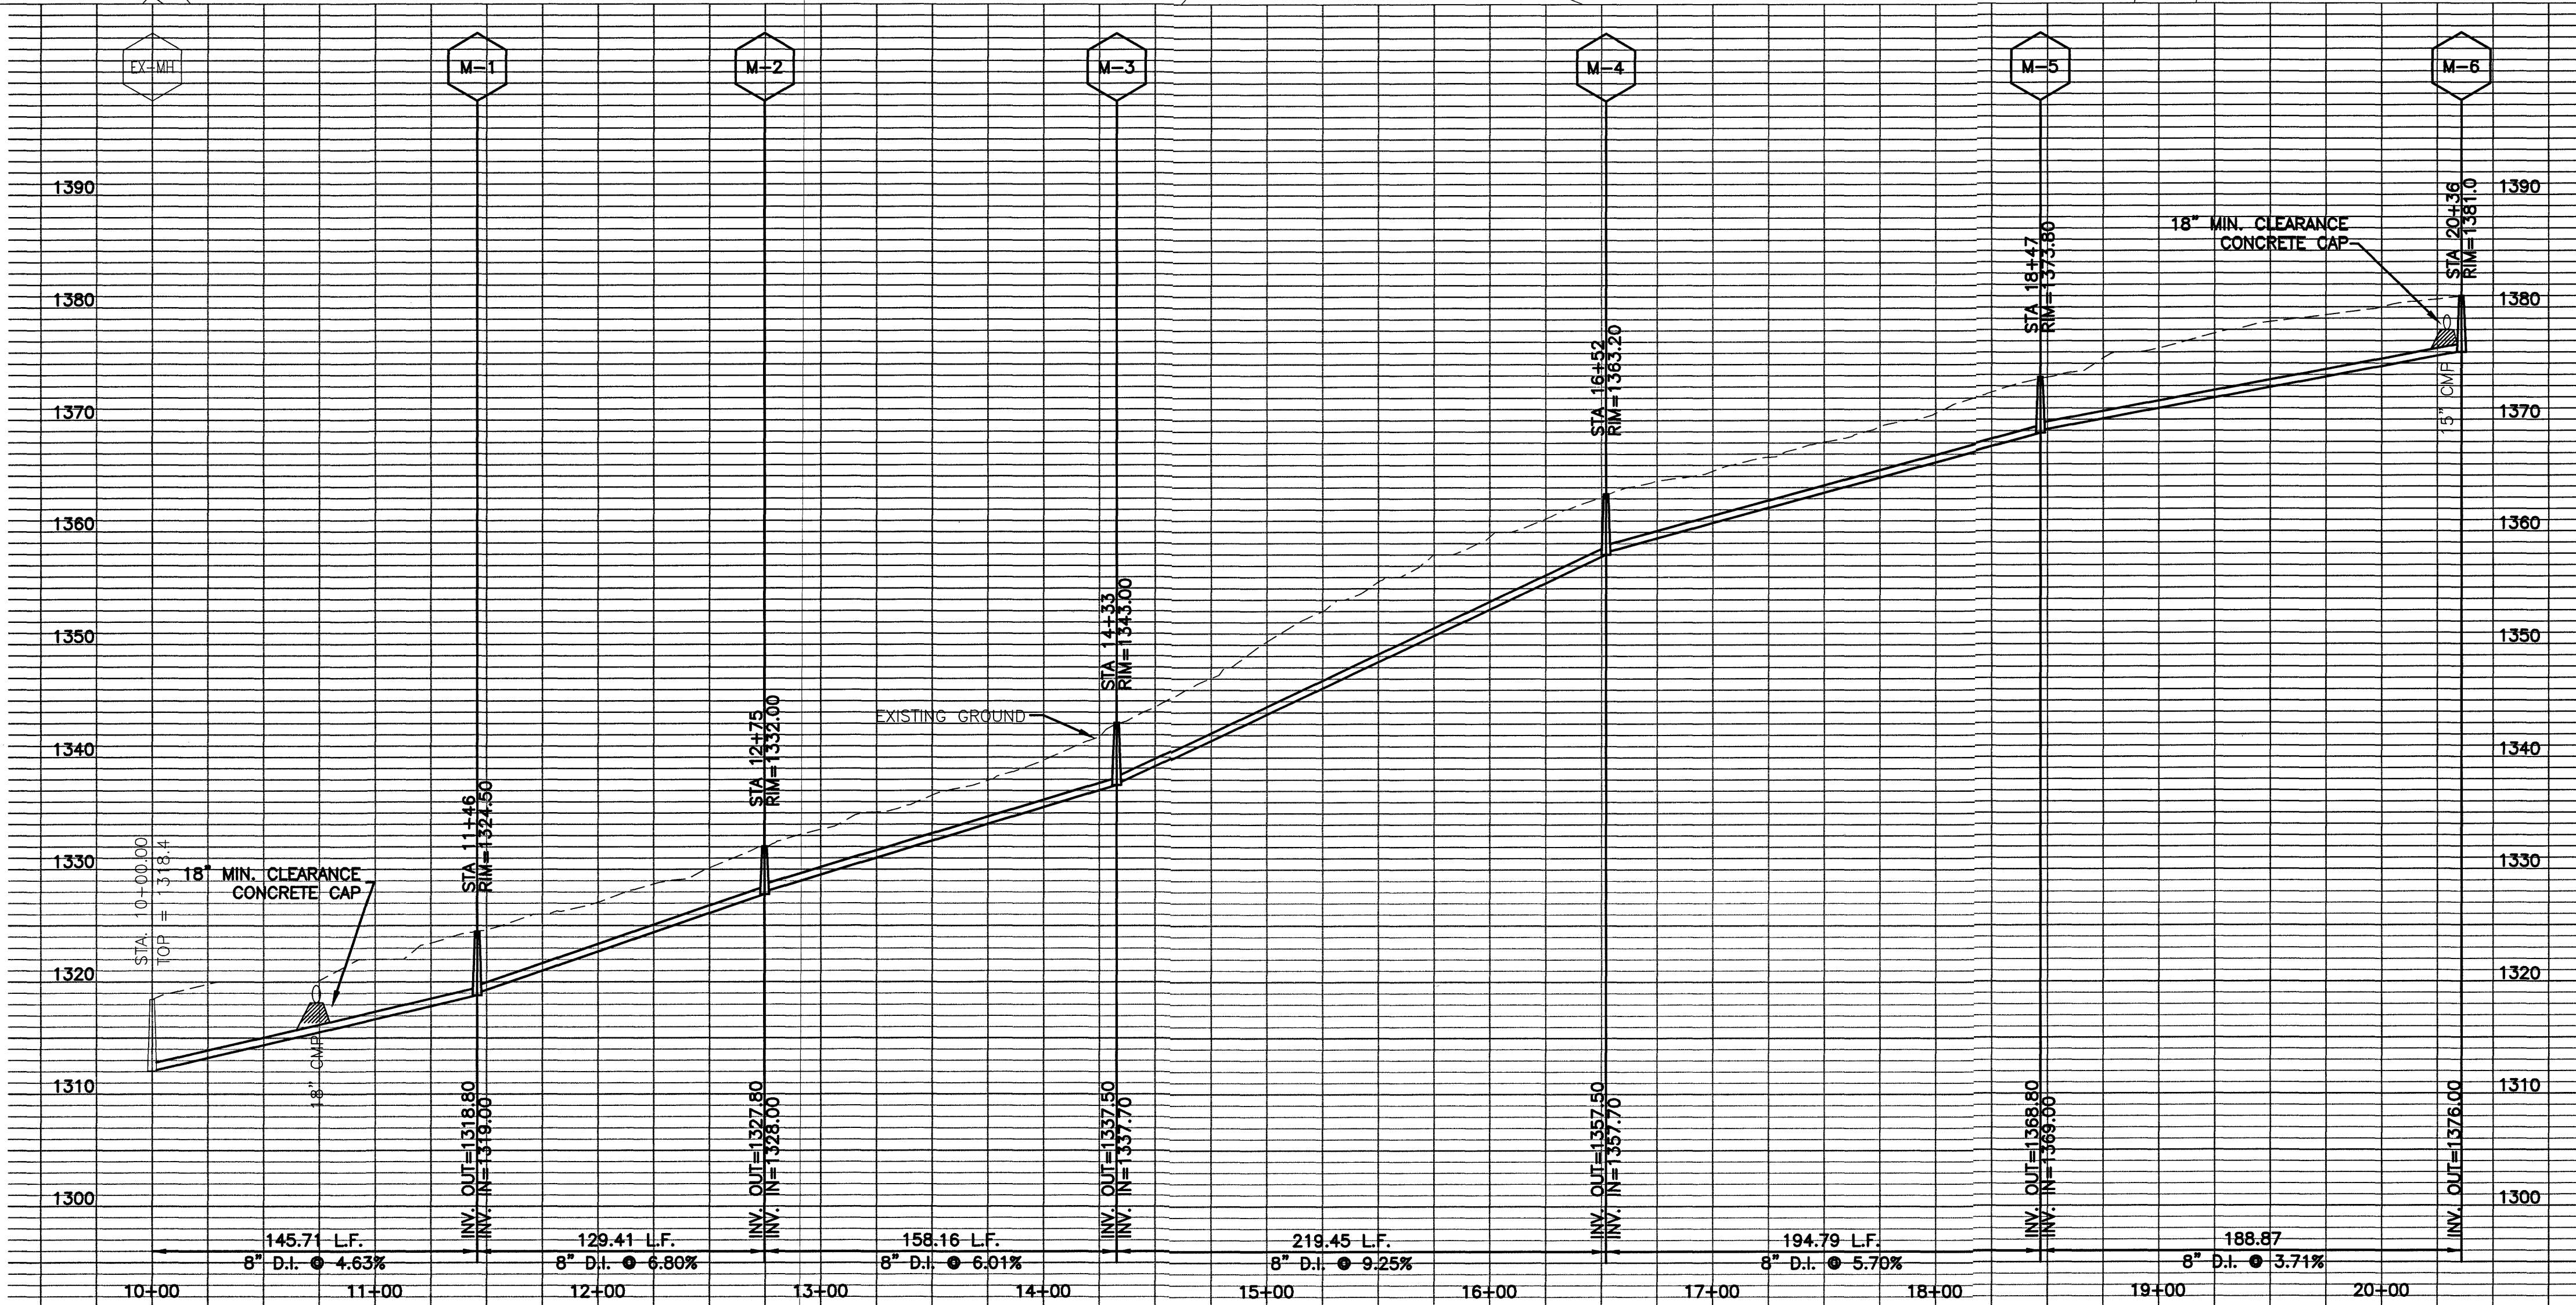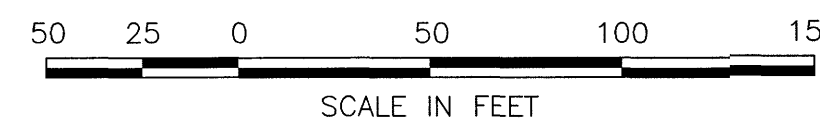

**ANDERSON & ASSOCIATES, INC.**  
Professional Design Services  
www.andassoc.com  
Virginia - North Carolina - Tennessee

100 Ardmore St.  
Blacksburg, Va. 24060  
540-552-5592

DATE : 08 SEP 04  
DESIGNED: CSF  
DRAWN : SEC  
CHECKED: CSF, RNJ  
QA / QC :

REVISIONS:  
03 NOV 04  
31 JAN 05  
RECORD

**FERRUM WATER SYSTEM IMPROVEMENTS**  
FERRUM, VIRGINIA

**TIMBERLINE ROAD**  
**LINE "A" SEWER**

DOCUMENT NO.  
**21136 - 002**  
SHEET  
**C9** OF **19**