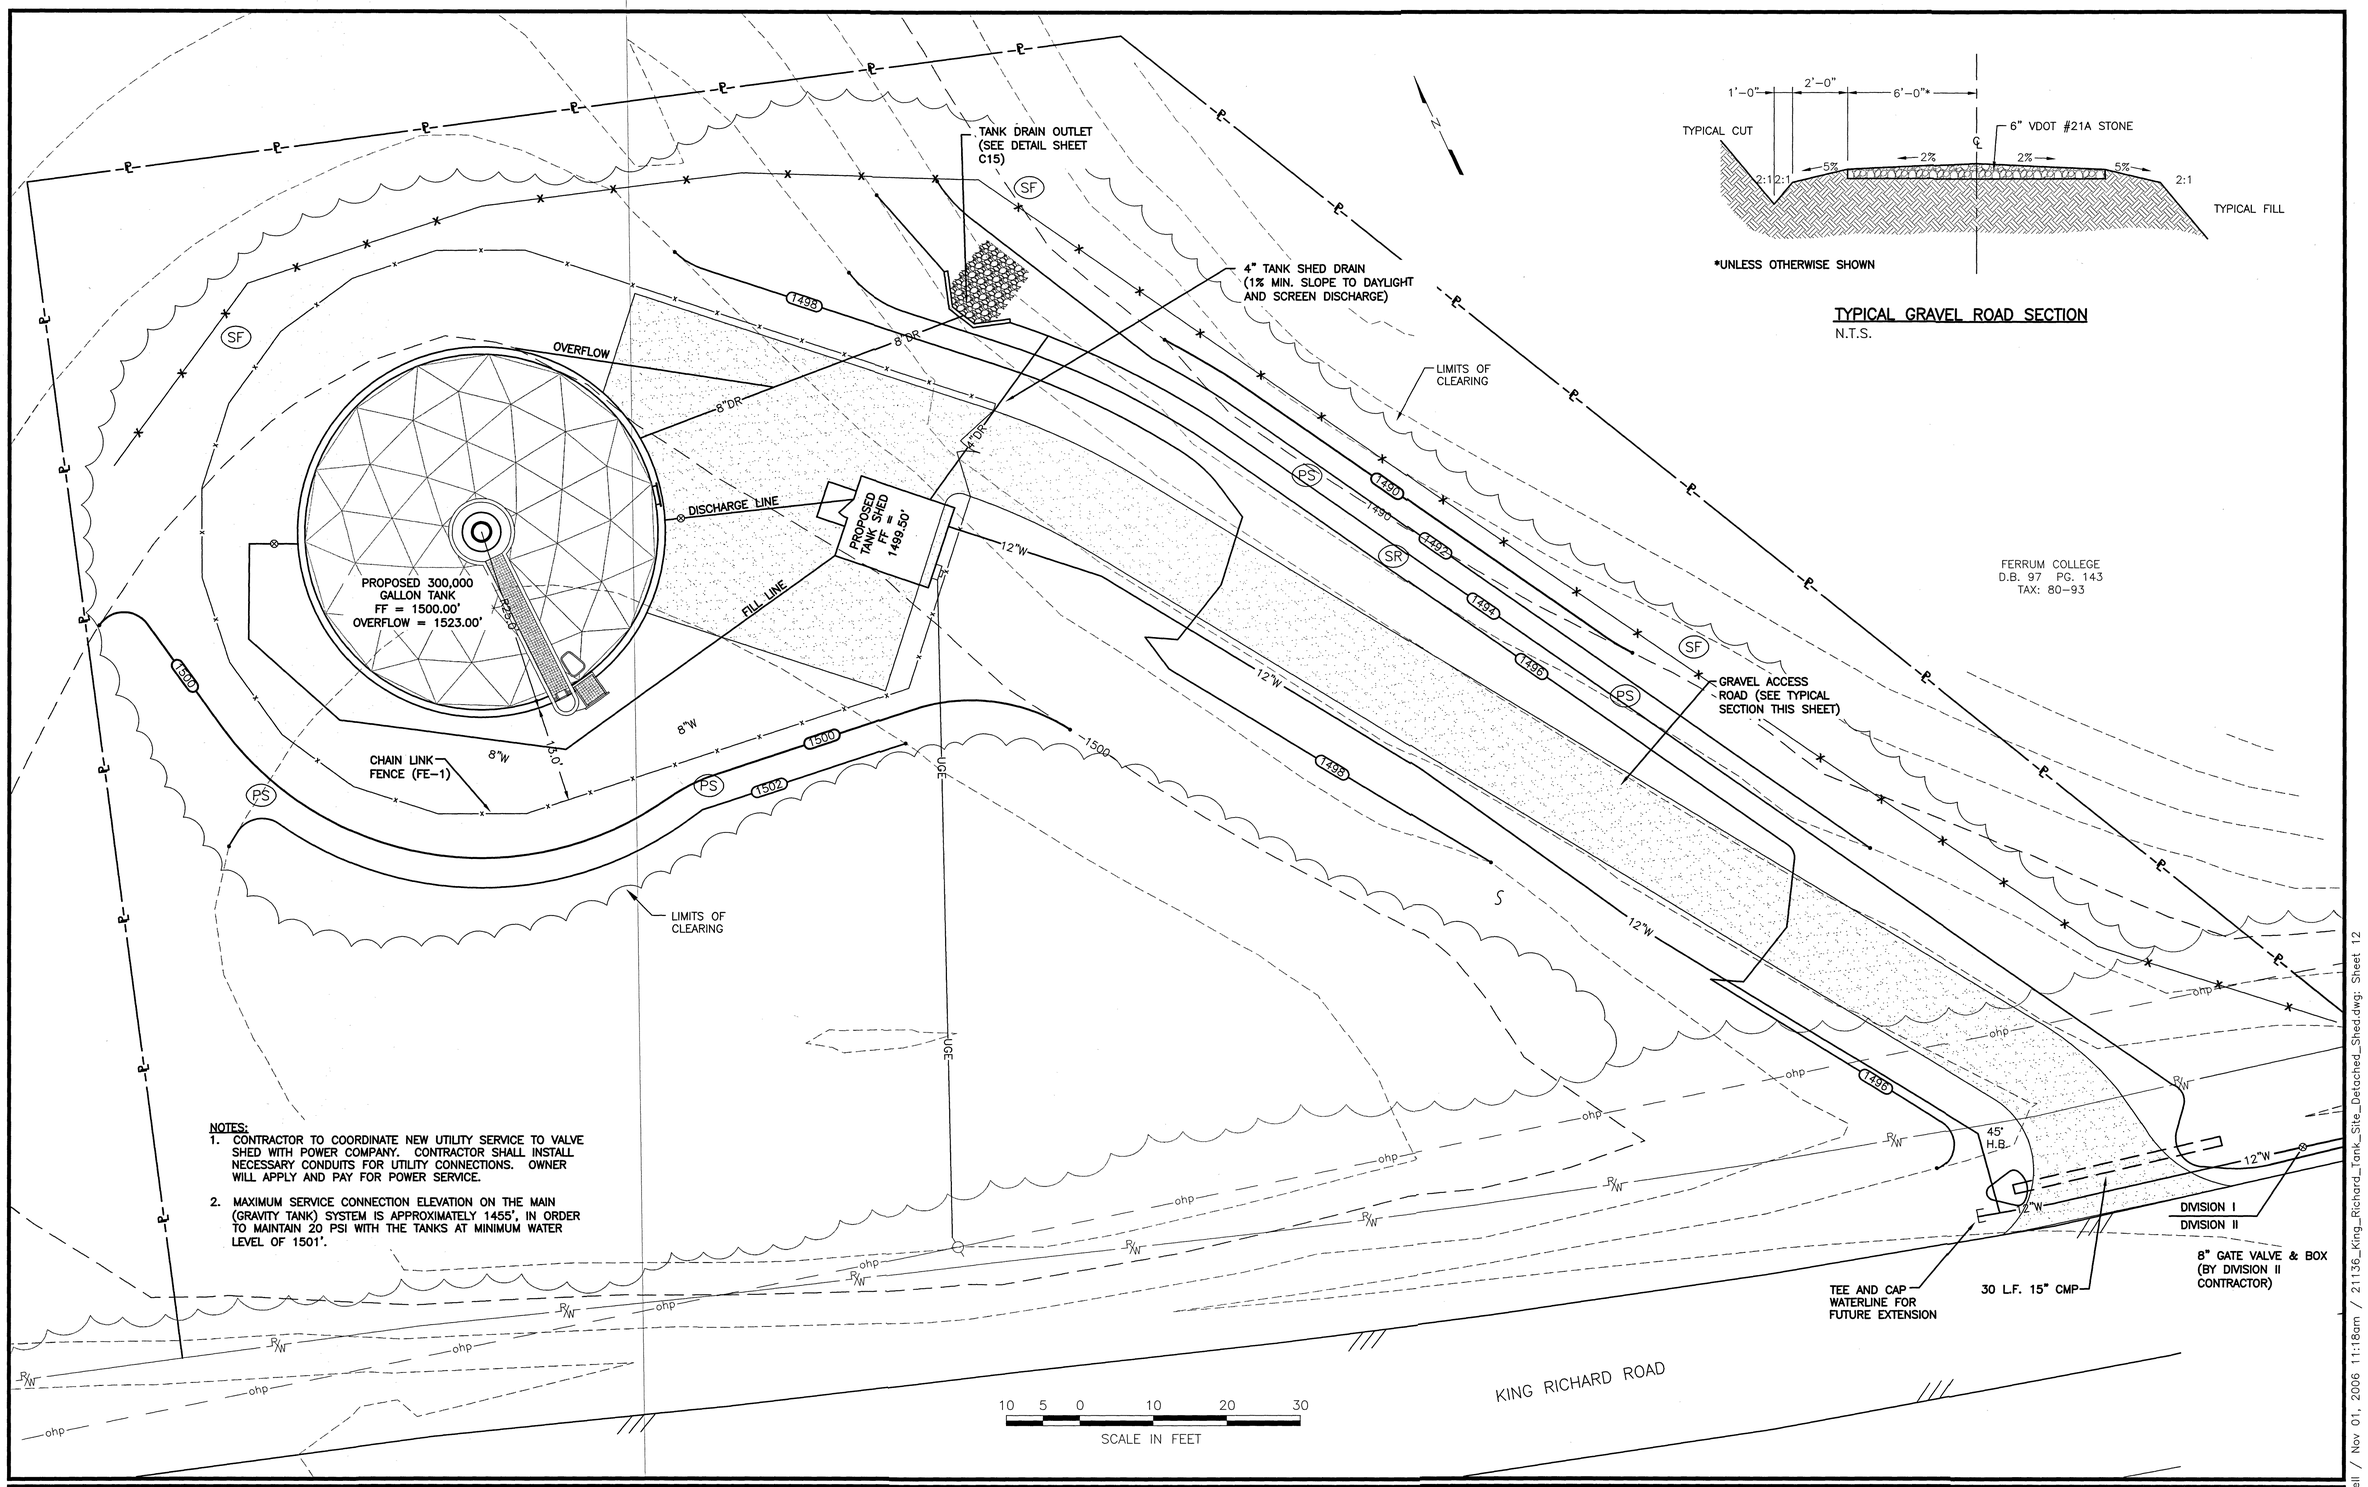

TYPICAL GRAVEL ROAD SECTION
N.T.S.

NOTES:
1. CONTRACTOR TO COORDINATE NEW UTILITY SERVICE TO VALVE SHED WITH POWER COMPANY. CONTRACTOR SHALL INSTALL NECESSARY CONDUITS FOR UTILITY CONNECTIONS. OWNER WILL APPLY AND PAY FOR POWER SERVICE.
2. MAXIMUM SERVICE CONNECTION ELEVATION ON THE MAIN (GRAVITY TANK) SYSTEM IS APPROXIMATELY 1455', IN ORDER TO MAINTAIN 20 PSI WITH THE TANKS AT MINIMUM WATER LEVEL OF 1501'.

ANDERSON & ASSOCIATES, INC.
Professional Design Services
www.andassoc.com
Virginia - North Carolina - Tennessee
100 Ardmore Street
Blacksburg, Va. 24060
540-552-5592

DATE : 26 JUL 05
DESIGNED: SEC
DRAWN : SEC
CHECKED : CSF

REVISIONS:
03 NOV 04
31 JAN 05
19 APR 05
RECORD

FERRUM WATER SYSTEM IMPROVEMENTS
FERRUM, VIRGINIA

KING RICHARD TANK SITE PLAN
DEATCHED SHED LAYOUT

DOCUMENT NO. 21136 – C12A
SHEET C12A OF

coldwell / Nov 01, 2006 11:18am / 21136_King_Richard_Tank_Site_Detached_Shed.dwg: Sheet 12