

**WESTERN VIRGINIA  
WATER AUTHORITY**


**ENGINEERING SERVICES**  
601 S. JEFFERSON ST., SUITE 300  
ROANOKE, VA 24011  
540-853-5641 or 540-853-5770

BURNT CHIMNEY WATER  
STORAGE TANK

PIPE CONFIGURATION PLAN

[illegible]

Sheet 2 of 6

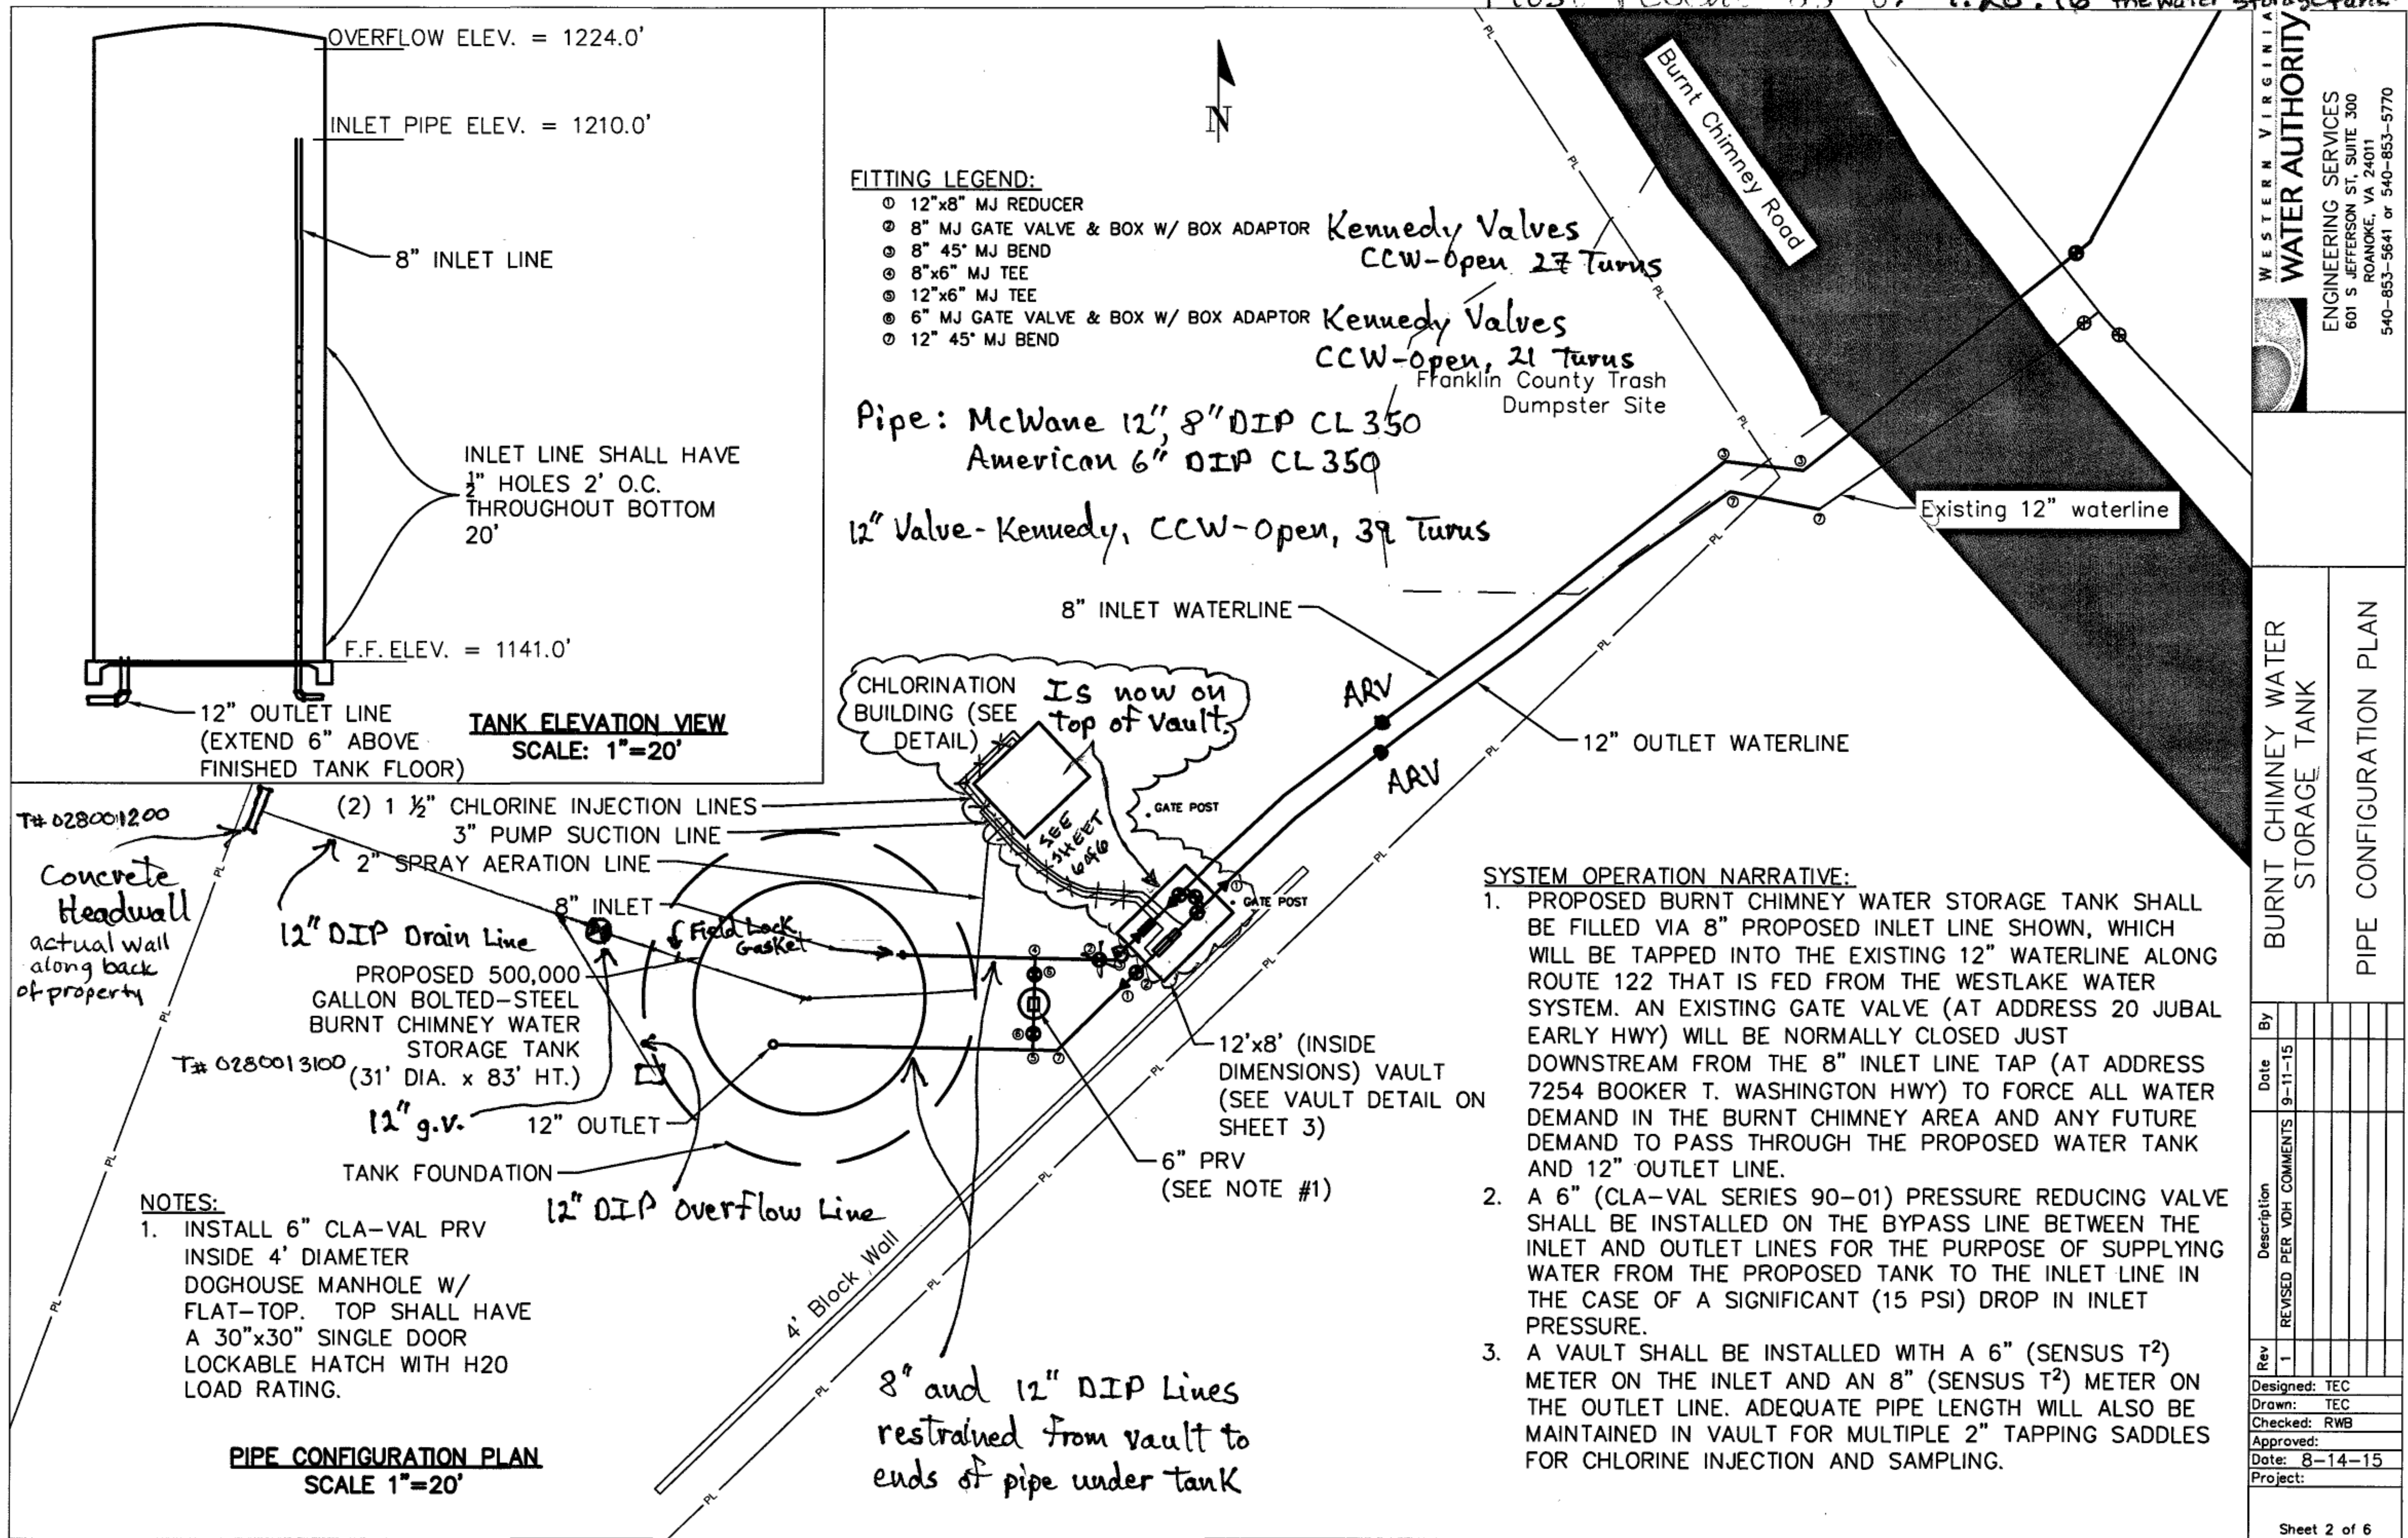

As-Built Substantial Completion 4.27.16 K. Winslow