Most recent as of 1.26.16

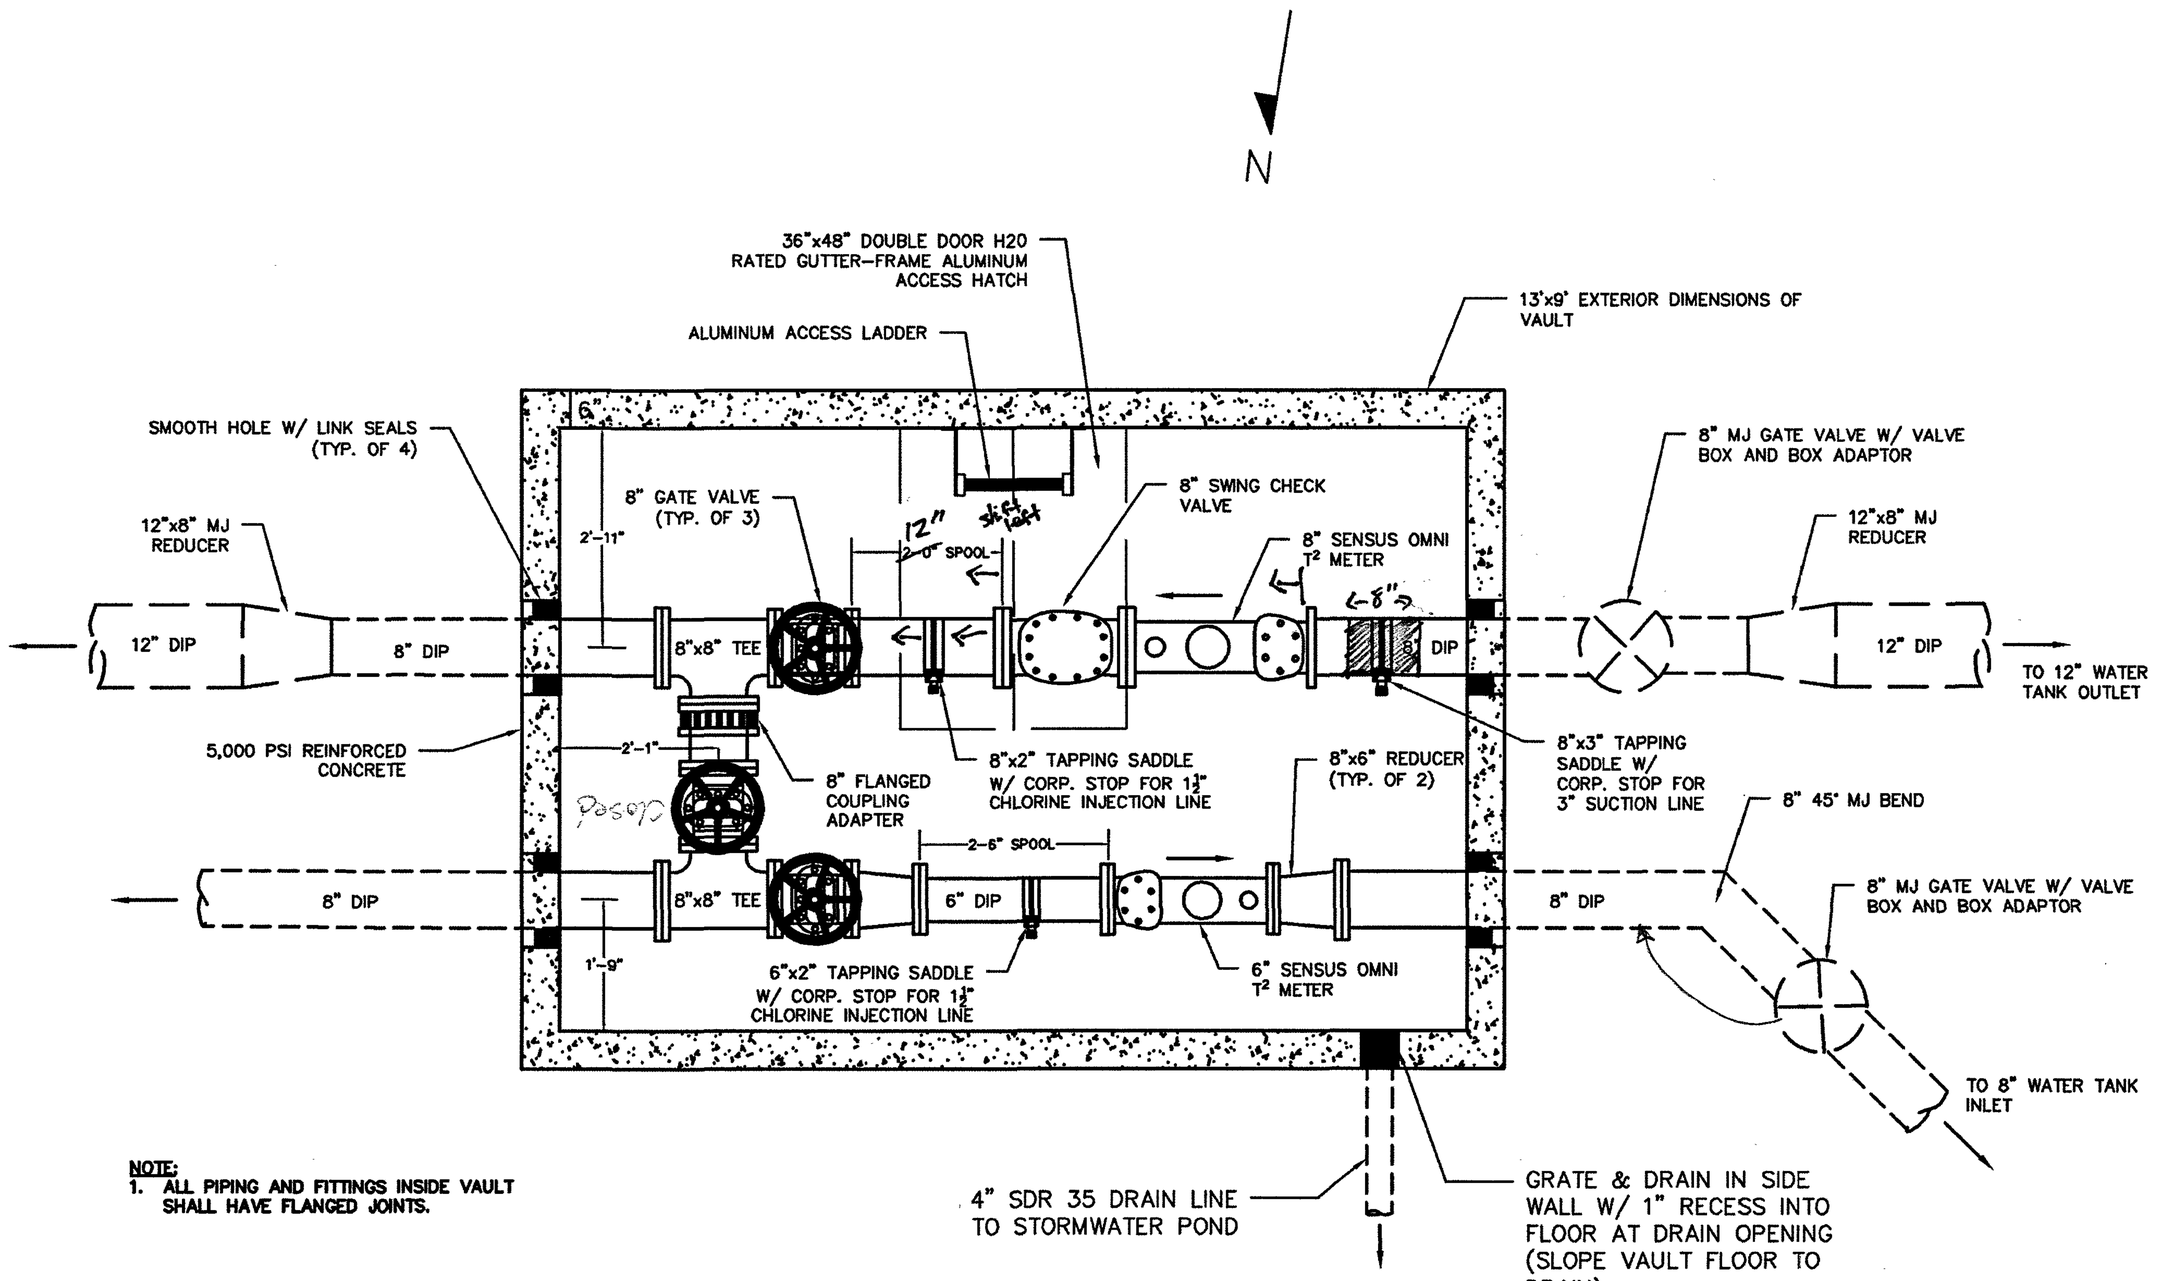

NOTE:
1. ALL PIPING AND FITTINGS INSIDE VAULT SHALL HAVE FLANGED JOINTS.

BURNT CHIMNEY TANK VAULT PLAN

½"=1'

WESTERN VIRGINIA WATER AUTHORITY
ENGINEERING SERVICES
601 S JEFFERSON ST, SUITE 300
ROANOKE, VA 24011
540-853-5641 or 540-853-5770

BURNT CHIMNEY WATER STORAGE TANK

VAULT PLAN

Rev	Description	Date	By
1	REVISED PER VDH COMMENTS	9-11-15	

Designed: TEC
Drawn: TEC
Checked: RWB
Approved:
Date: 8-14-15
Project: