


1. 1½-inch Ball Valve (Typical)
2. 1½-inch Full Union Ball Check Valve
3. 1½-inch Union
4. 2-inch Ball Valve (Typical)
5. 2-inch Full Union Ball Check Valve
6. 3-inch Ball Valve
7. Sample Tap w/ Pressure Gauge (100 PSI)  
& Vacuum Breaker
8. Water Meter

9. 3/4-HP Booster Pump
10. 1 1/2-HP Aeration System Recirculation Pump
11. Inline "Fail Safe" Flow Switch
12. Metering Pump Calibration Chamber
13. Hypochlorite Solution Injection Point
14. Hypochlorite Solution Feed Pump  
(Not Shown in Plan View)
15. 30-Gallon Hypochlorite Solution Tank

All 1-1/2" and 2" piping and fittings shall be Schedule 80 PVC

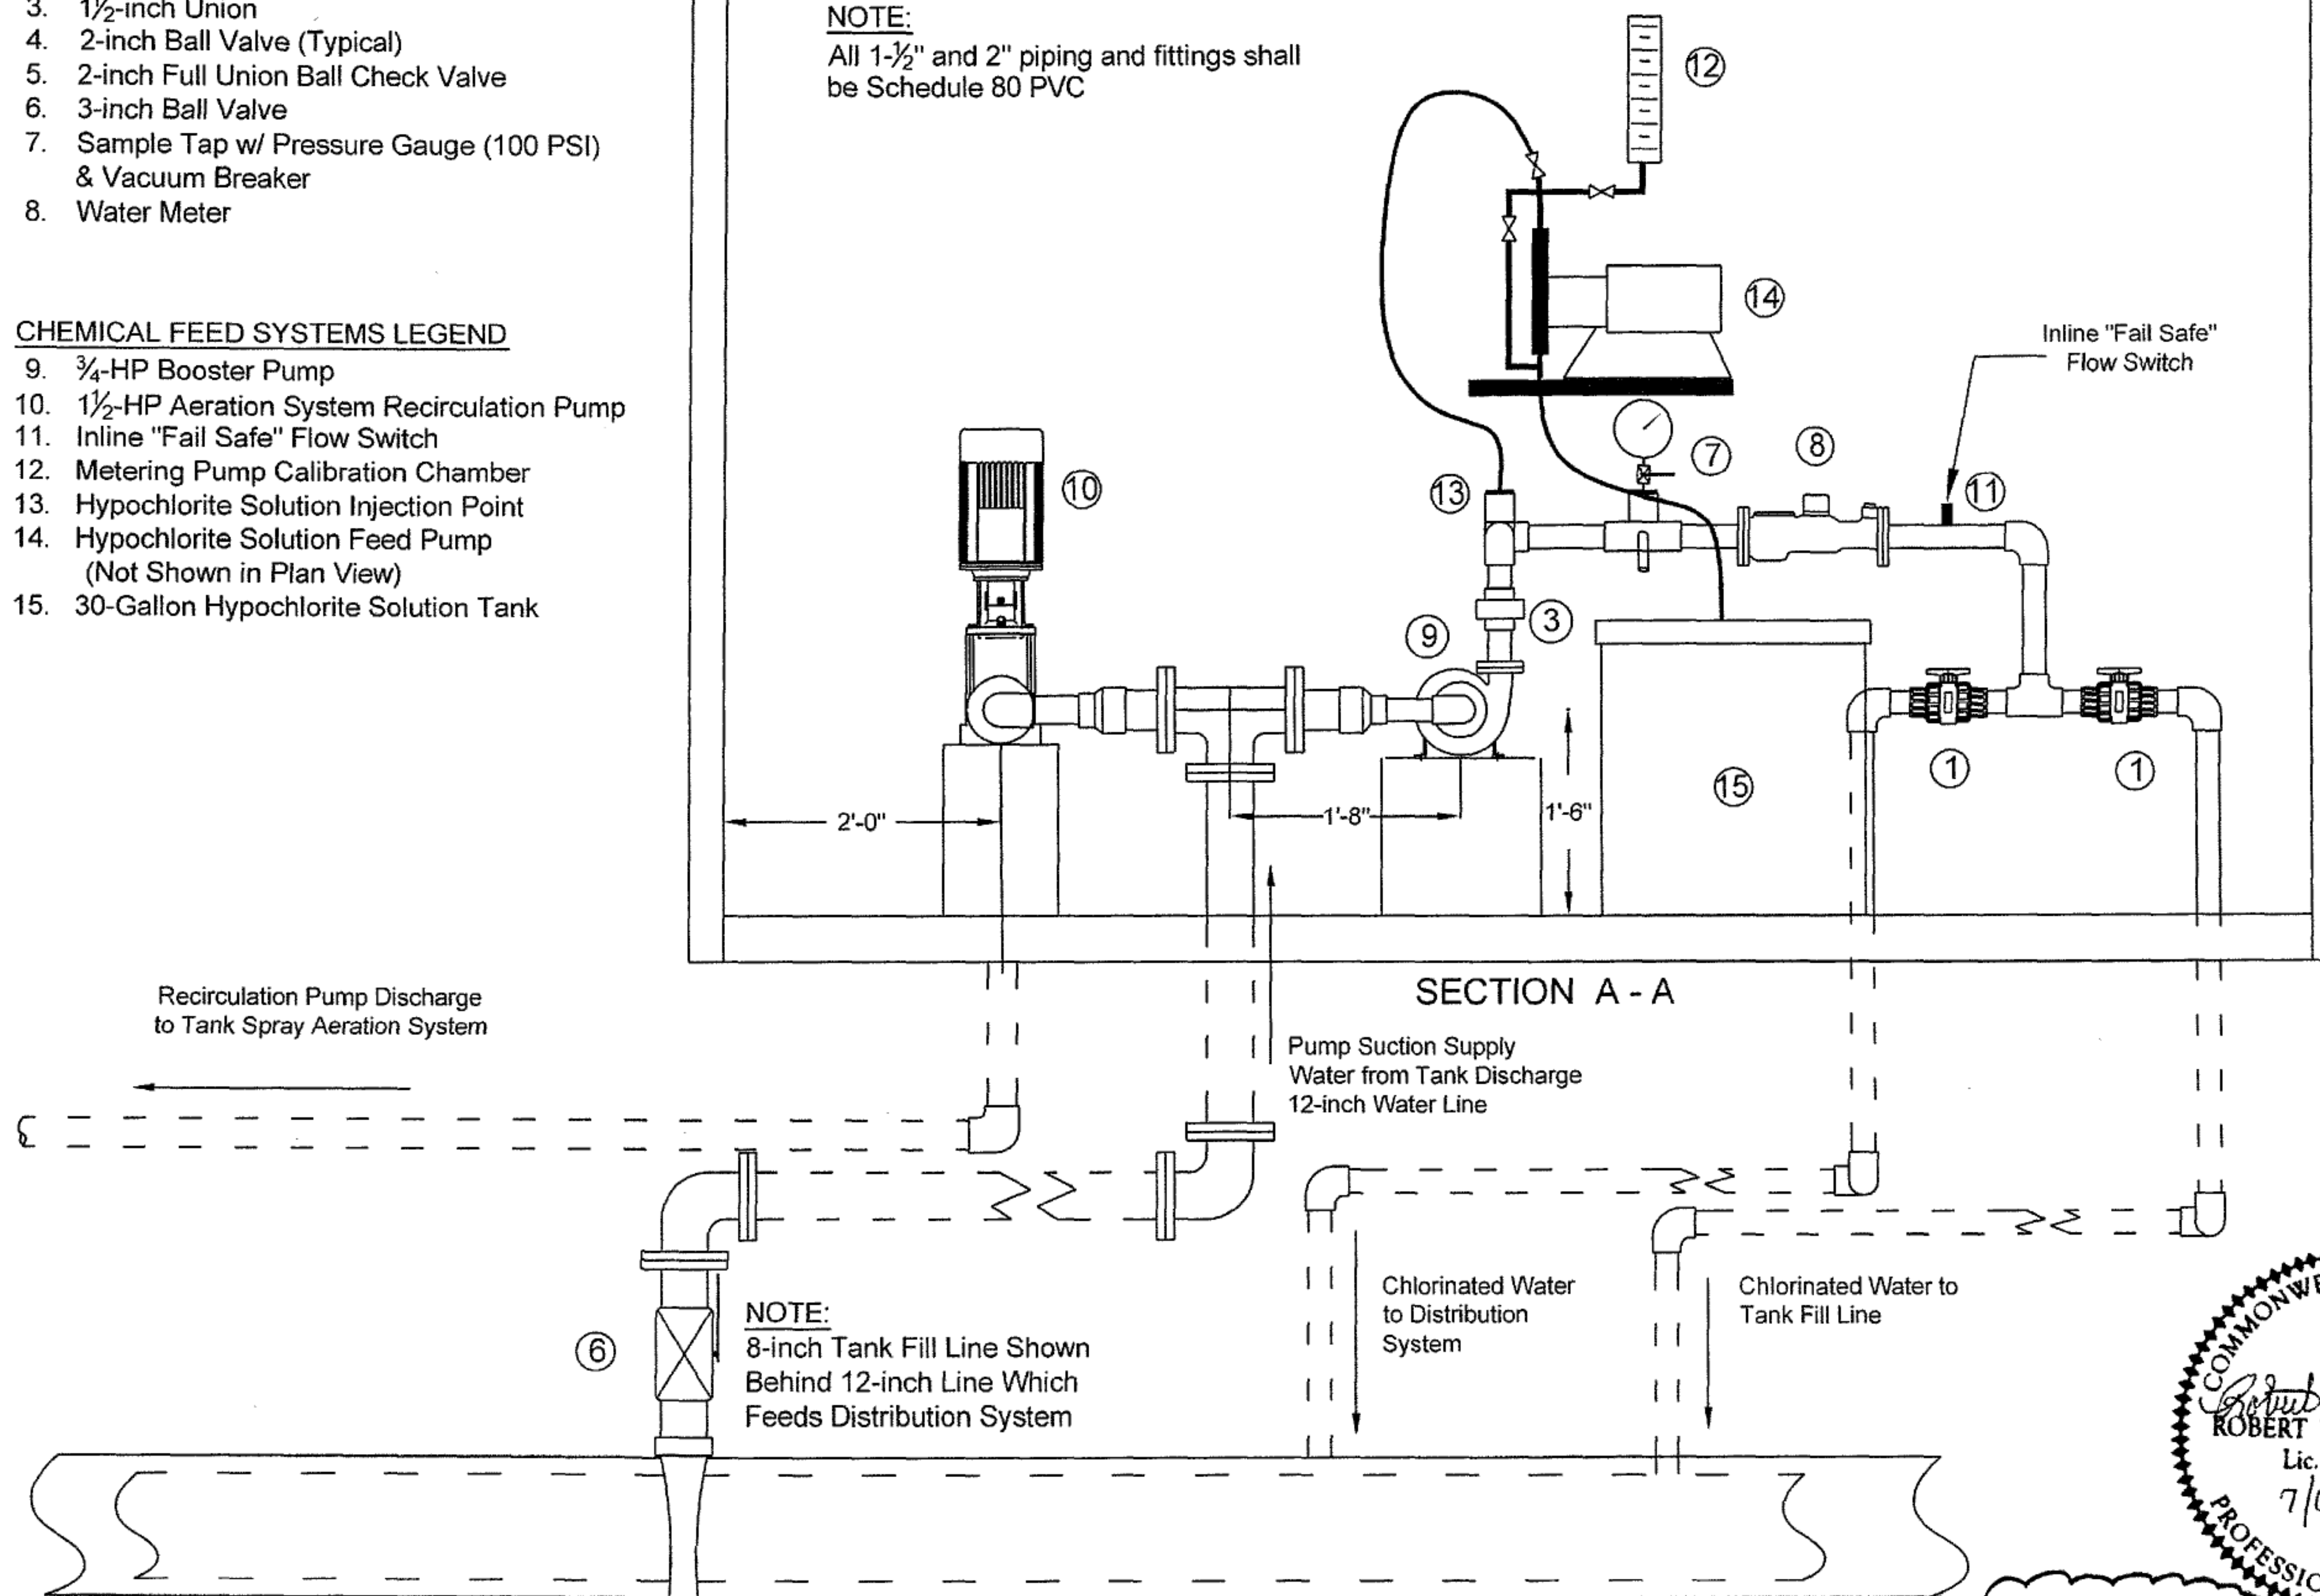

(See Sheet 6

