


TABLE A

BEND	4" & 6"	8"	10"	12"	16"
45°	A 1'-8"	3'-2"	3'-8"	4'-2"	5'-5"
	B 1'-2"	1'-4"	1'-6"	1'-10"	2'-6"
	C 8"	9"	10"	11"	1'-2"
90°	A 6"	7"	8"	8"	1'-3"
	B 1'-2"	1'-4"	1'-6"	1'-8"	2'-0"
	C 7"	8"	8"	8"	9"
11 1/4°	A 8"	1'-4"	1'-8"	1'-10"	2'-8"
	B 1'-2"	1'-4"	1'-6"	1'-8"	2'-0"
	C 8"	9"	10"	11"	1'-2"
22 1/2°	A 1'-3"	2'-3"	2'-8"	3'-2"	4'-1"
	B 1'-2"	1'-4"	1'-6"	1'-10"	2'-6"
	C 8"	9"	10"	11"	1'-2"
45°	A 2'-3"	3'-7"	5'-0"	5'-10"	7'-7"
	B 1'-2"	1'-4"	1'-6"	1'-10"	2'-6"
	C 8"	9"	10"	11'-0"	1'-2"



- NOTES:
1. ALL B&C DIMENSIONS TO BE AS REQUIRED TO REACH UNDISTURBED EARTH BUT NOT LESS THAN LISTED ON THRUST BLOCK TABLE.
 2. CAST-IN-PLACE CONCRETE SHALL BE IN ACCORDANCE WITH THE PCI TYPE 1 PORTLAND CEMENT 3,000 PSI.
 3. DIMENSIONS A, B, C, APPLY TO ALL BEND CONDITIONS SHOWN.
 4. INSTALL PLUGS AT ALL RUNS OR BRANCHES DISCONTINUED FOR FUTURE SERVICES.
 5. ALL BENDS, TEES, SLOWS, FITTINGS OR OTHER SIGNIFICANT CHANGES SHALL BE BRACED WITH POURED CONCRETE THRUST BLOCK AS SHOWN ON THIS DETAIL.
 6. ALL PLUGS SHALL BE SEPARATED FROM THE CONCRETE THRUST BLOCK BY A 5 MIL LAYER OF PLASTIC SHEETING.



BEND	4" & 6"	8"	10"	12"	16"
D	1'-8"	1'-8"	2'-0"	3'-0"	3'-6"
E	1'-3"	1'-8"	1'-8"	2'-0"	2'-3"
F	2'-0"	2'-8"	2'-8"	3'-0"	4'-0"
G	2'-0"	3'-4"	3'-8"	4'-0"	4'-4"
H	1'-8"	2'-3"	2'-6"	2'-6"	2'-6"
I	2'-6"	2'-6"	3'-10"	4'-0"	5'-6"
J	2'-6"	3'-0"	4'-0"	4'-8"	5'-2"
K	2'-6"	2'-9"	3'-0"	3'-8"	4'-0"
L	3'-0"	4'-0"	4'-8"	4'-8"	6'-6"



PIPE SIZE	ROD SIZE (IN)	NO. REQ'D.
4" & 6"	1/2"	1/2
8"	1/2"	1/2
10"	3/4"	3/4
12"	3/4"	3/4
16"	3/4"	3/4

THIS TABLE APPLIES TO VERTICAL & HORIZONTAL THRUST BLOCKS.

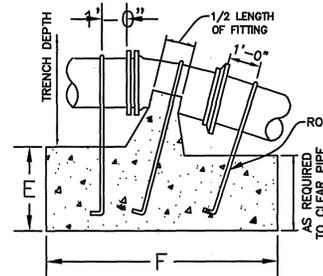



- NOTES:
1. ALL POURED CONCRETE SHALL BE LAID ON UNDISTURBED EARTH AFTER EXCAVATION ACCORDING TO DIMENSIONS INDICATED ON THRUST BLOCK DIMENSION TABLE OR IT SHALL BE LAID THE FULL WIDTH OF TRENCH FROM UNDISTURBED WALL BUT NOT LESS THAN LISTED ON THRUST BLOCK TABLE.
 2. CAST IN PLACE CONCRETE SHALL BE IN ACCORDANCE WITH THE PCI TYPE 1 PORTLAND CEMENT, 3,000 PSI.
 3. ALL RODS SHALL BE 316 OR 304 STAINLESS STEEL.

VERTICAL THRUST BLOCK
NTS

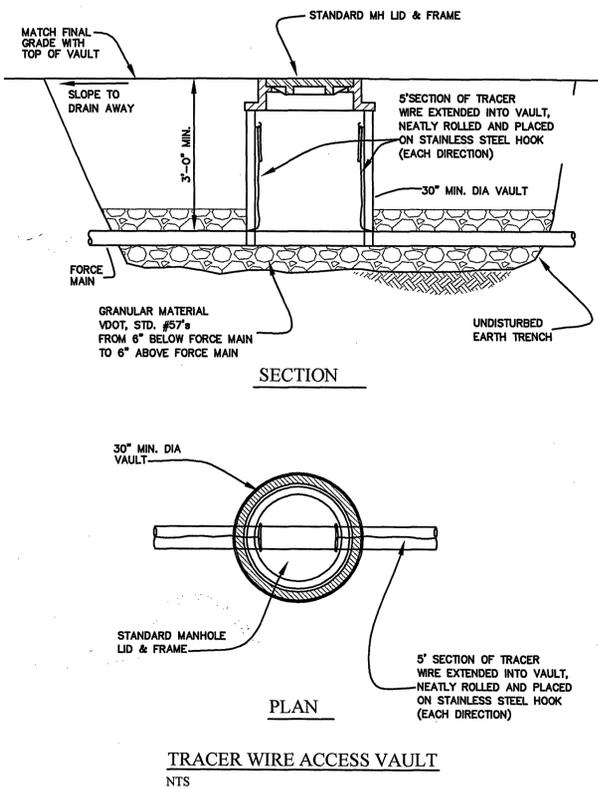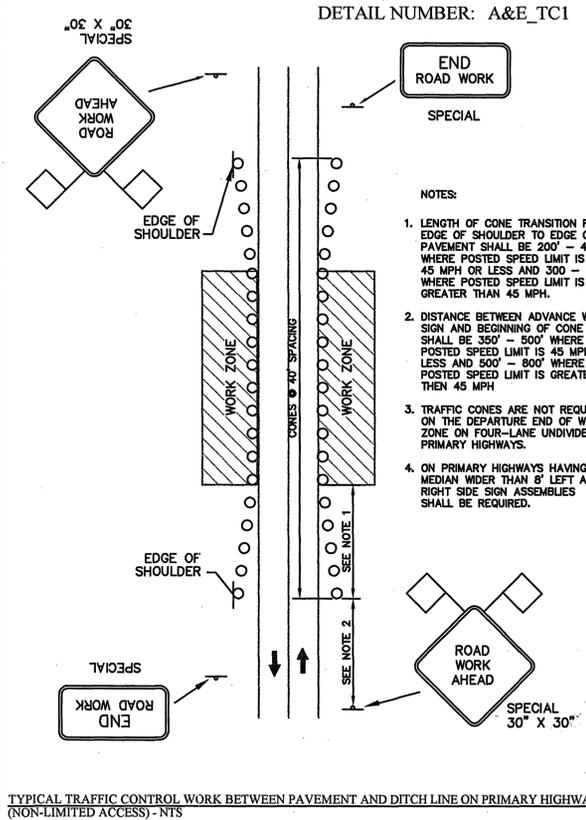


- GENERAL NOTES:
1. TRAFFIC BEARING BOX REQUIRED IN TRAFFIC AREAS.
 2. ALL PIPE AND FITTINGS SHALL BE OF SIMILAR MATERIAL.
 3. ALL PIPE SHALL BE OF SAME SIZE.
 4. NO BENDS ARE ALLOWED IN THE LATERAL FROM THE MAIN TO THE CLEAN-OUT STACK WYE. (EXCEPT AS NOTED)
 5. MINIMUM COVER FOR ALL SEWER LATERALS SHALL BE THREE (3) FEET

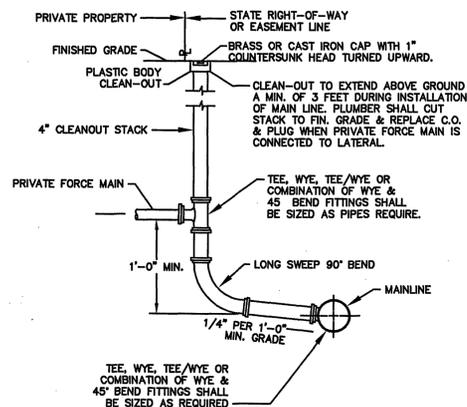


ALTERNATE PIPE SUPPORT IN CASING PIPE:
18" LONG TREATED TIMBER SKIDS OF APPROPRIATE WIDTH SO THAT BELLS OR FLANGES DO NOT REST ON CASING WITH MORE THAN 3/4" FREE PLAY. SKIDS TO BE PLACED AT 4'-0" O.C. AND SECURED WITH 2" x 1/4" GALV. STEEL STRAPS OR 1" S.S. BANDS. SOAP-BASED LUBRICANT MAY BE USED FOR SLIDING OF SKID WITH DUCTILE IRON PIPE AND FLAX-BASED LUBRICANT MAY BE USED FOR SLIDING OF SKID WITH PVC PIPE.

NOTE: A 1" DRAIN WILL BE REQUIRED ON THE LOWER END OF THE CASING IF THE CASING ENDS ARE SEALED WITH MORTAR AND BRICK.

PIPE SUPPORT IN CASING PIPE
NTS

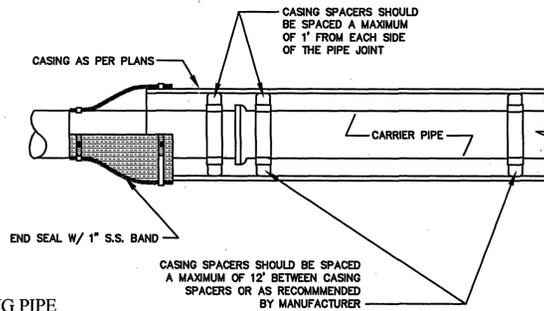

- NOTES:
1. SURFACE AND BASE REPLACEMENT WILL GENERALLY BE REQUIRED TO MATCH EXISTING ASPHALT LAYERS AND SHALL BE COMPACTED IN LIFTS ACCORDING TO VIRGINIA DEPARTMENT OF TRANSPORTATION ROAD AND BRIDGE SPECIFICATIONS.
 2. AGGREGATE BASE MATERIAL SHALL BE REPLACED TO A DEPTH GREATER THAN EXISTING STONE BASE TO ENSURE LOAD BEARING CAPACITY OF CUT RELATED TO UNDISTURBED EARTH AREAS. AGGREGATE BASE SHALL BE COMPACTED ACCORDING TO VIRGINIA DEPARTMENT OF TRANSPORTATION ROAD AND BRIDGE SPECIFICATIONS.
 3. BEDDING MATERIAL SHALL BE ACCORDING TO REQUIREMENT OF EACH UTILITY (GENERALLY FROM BOTTOM OF REPAIR DITCH TO SIX INCHES ABOVE PIPE WITH MINIMUM OF FOUR INCHES BELOW PIPE).
 4. SAW CUT TO BE MADE WITH MECHANICAL SAW AND SIDES TO BE TACKED WITH BITUMINOUS MATERIAL TYPE RC-250 OR EQUAL.

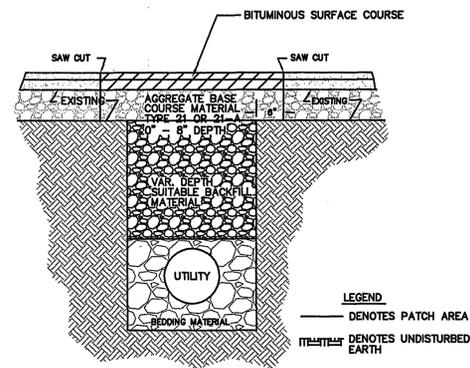

ACS DESIGN

Engineering-Planning-Surveying
Landscape Architecture
Construction Management

2203 Peters Creek Road, NW
Roanoke, Virginia 24017
Phone: 540 562 2345
Fax: 540 562 2344
Email: info@acsdesignllc.com
www.acsdesignllc.com

GRAVITY SEWER 1
LAKEWATCH PLANTATION
GILLS CREEK MAGISTERIAL DISTRICT
FRANKLIN COUNTY, VIRGINIA

DRAWN BY: DME
DESIGNED BY: CEK
CHECKED BY: DME
DATE: 4/11/06
SCALE: NOT TO SCALE

REVISIONS

REVISION	SHEET NO.	DATE	BY	COMMENT
04/19/06	04	04/19/06	CEK	CHANGED

SHEET No. 10 OF 11

SEWER FORCE MAIN DETAILS
JOB No. 21-04