

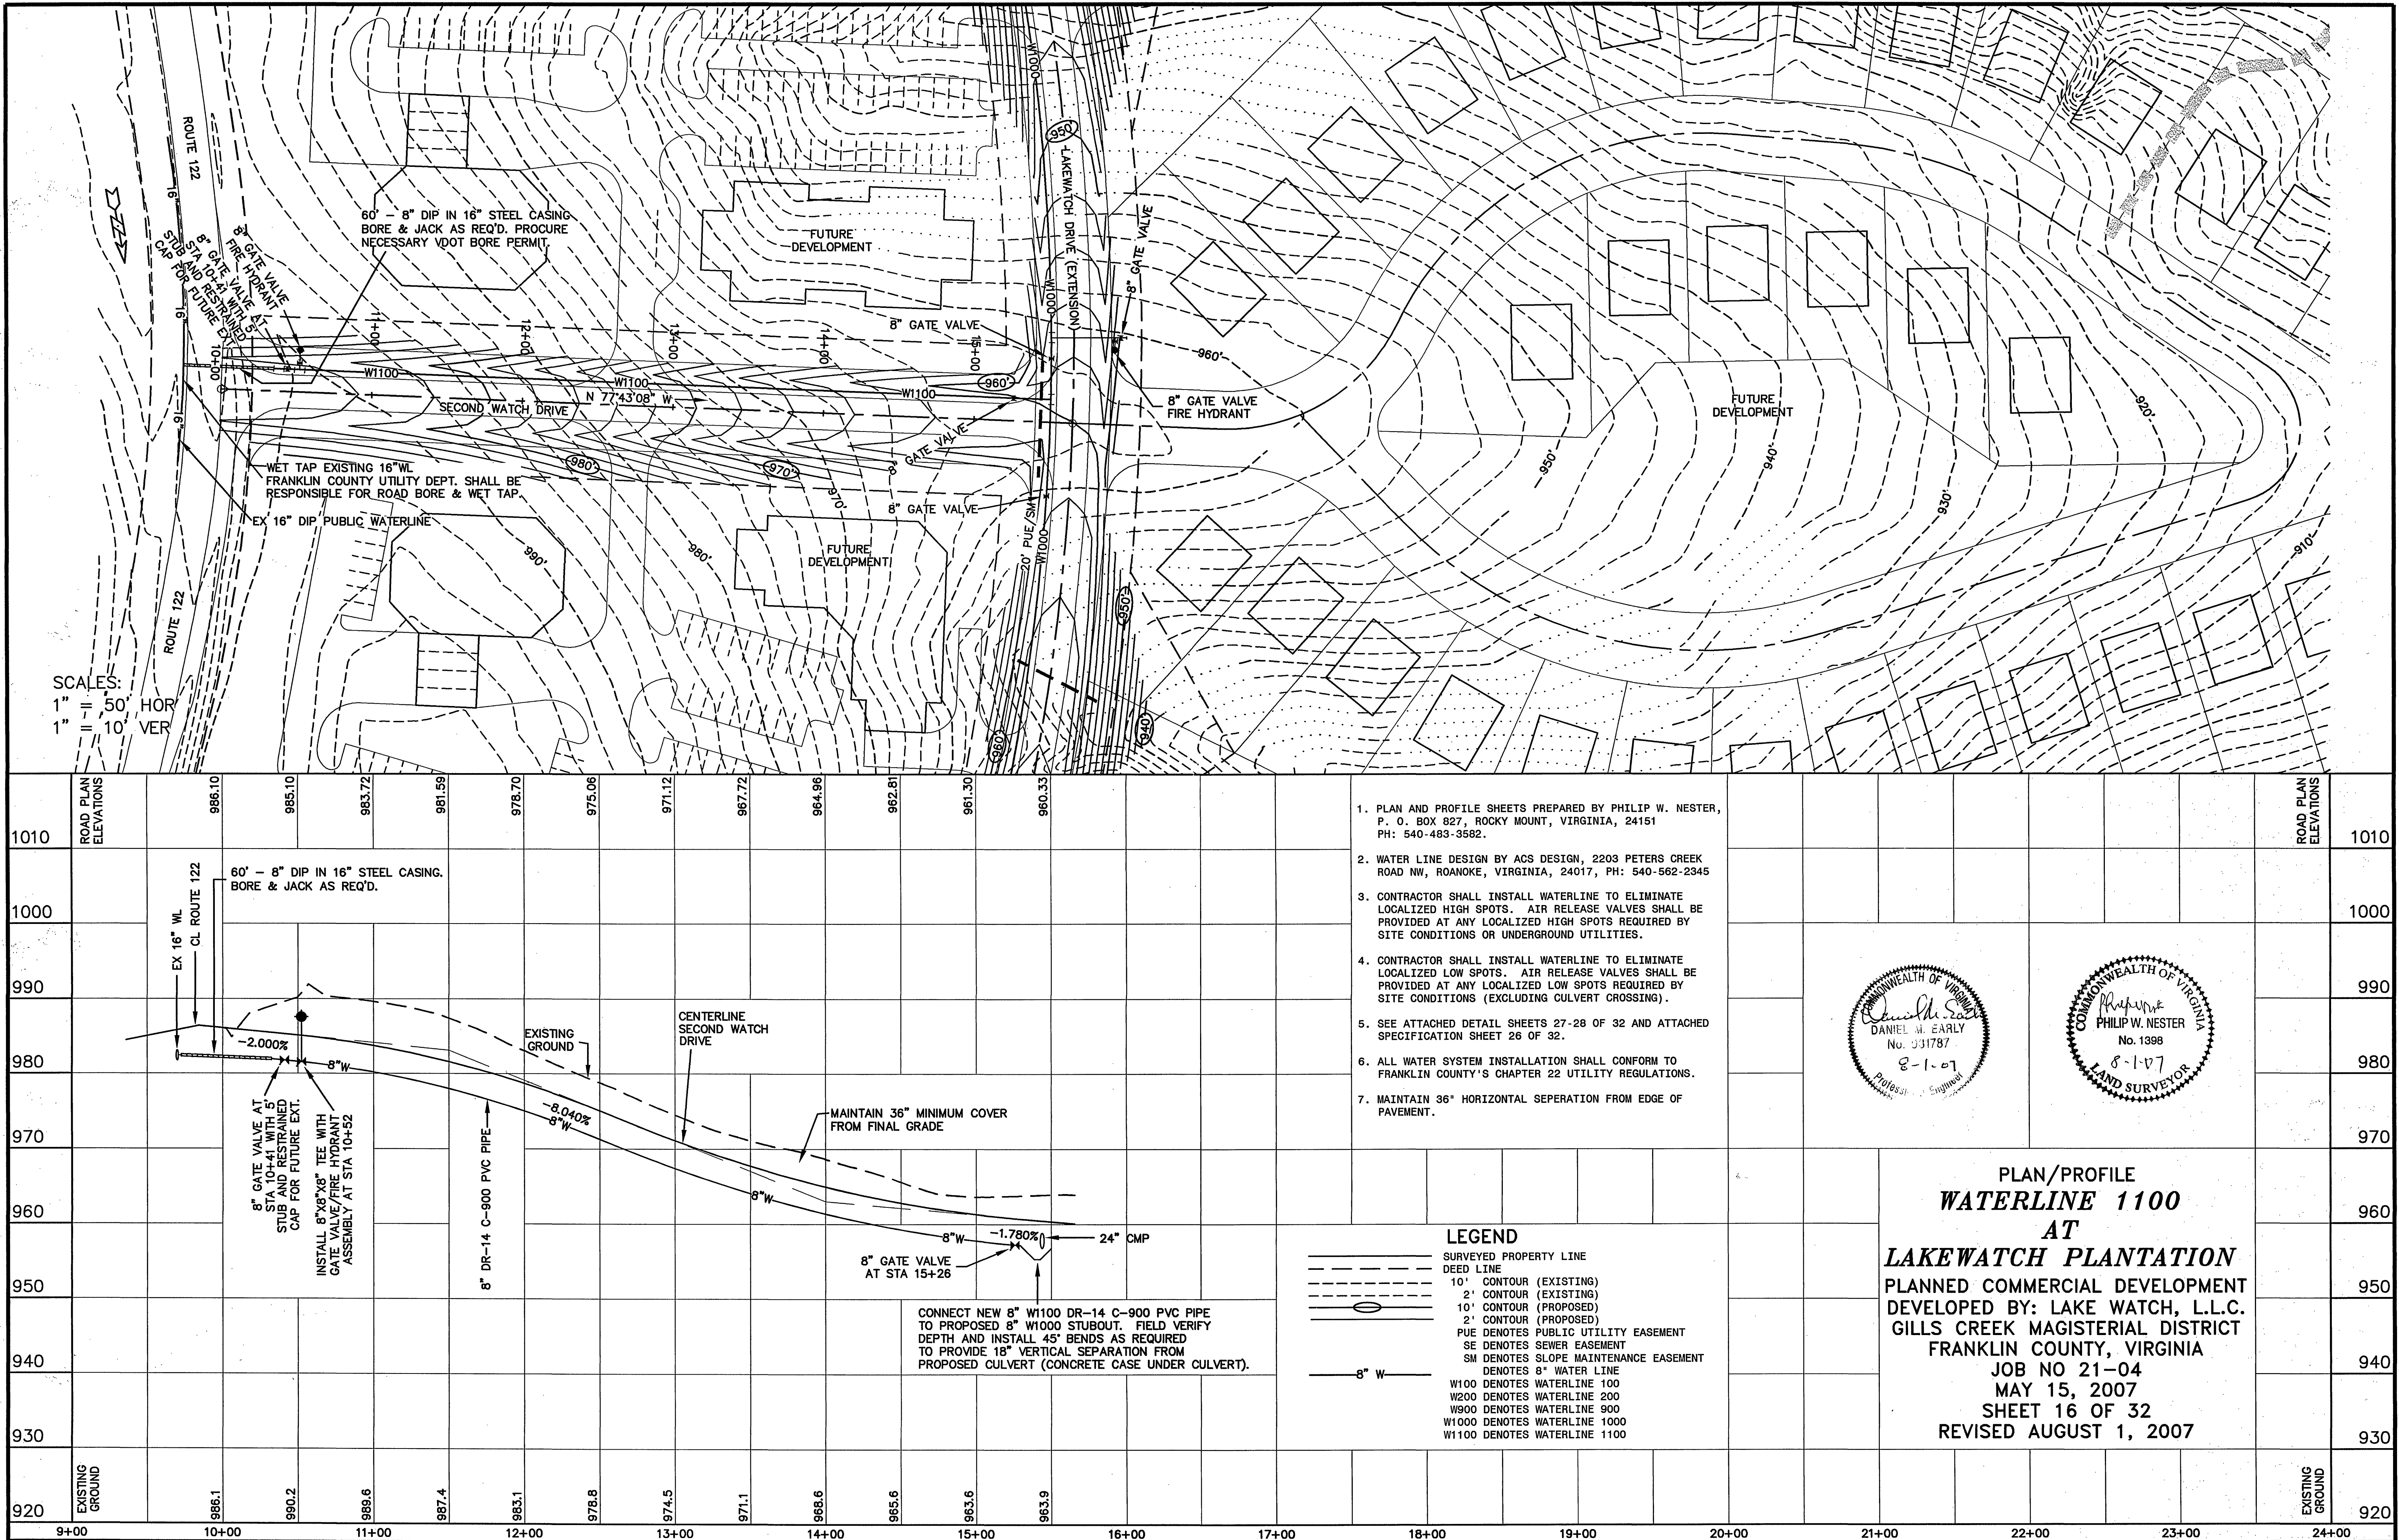


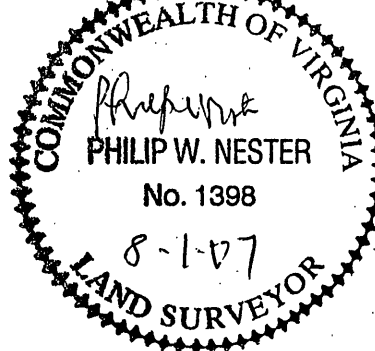

1. PLAN AND PROFILE SHEETS PREPARED BY PHILIP W. NESTER, P. O. BOX 827, ROCKY MOUNT, VIRGINIA, 24151 PH: 540-483-3582.
2. WATER LINE DESIGN BY ACS DESIGN, 2203 PETERS CREEK ROAD NW, ROANOKE, VIRGINIA, 24017, PH: 540-562-2345
3. CONTRACTOR SHALL INSTALL WATERLINE TO ELIMINATE LOCALIZED HIGH SPOTS. AIR RELEASE VALVES SHALL BE PROVIDED AT ANY LOCALIZED HIGH SPOTS REQUIRED BY SITE CONDITIONS OR UNDERGROUND UTILITIES.
4. CONTRACTOR SHALL INSTALL WATERLINE TO ELIMINATE LOCALIZED LOW SPOTS. AIR RELEASE VALVES SHALL BE PROVIDED AT ANY LOCALIZED LOW SPOTS REQUIRED BY SITE CONDITIONS (EXCLUDING CULVERT CROSSING).
5. SEE ATTACHED DETAIL SHEETS 27-28 OF 32 AND ATTACHED SPECIFICATION SHEET 26 OF 32.
6. ALL WATER SYSTEM INSTALLATION SHALL CONFORM TO FRANKLIN COUNTY'S CHAPTER 22 UTILITY REGULATIONS.
7. MAINTAIN 36" HORIZONTAL SEPERATION FROM EDGE OF PAVEMENT.

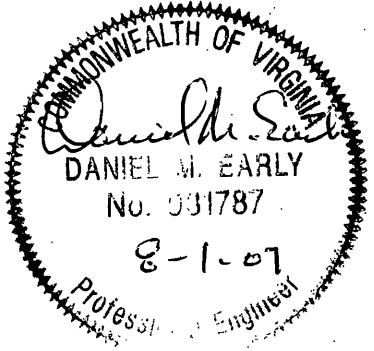

- LEGEND**
- SURVEYED PROPERTY LINE
 - - - DEED LINE
 - 10' CONTOUR (EXISTING)
 - 2' CONTOUR (EXISTING)
 - 10' CONTOUR (PROPOSED)
 - 2' CONTOUR (PROPOSED)
 - - - PUE DENOTES PUBLIC UTILITY EASEMENT
 - - - SE DENOTES SEWER EASEMENT
 - - - SM DENOTES SLOPE MAINTENANCE EASEMENT
 - 8" W DENOTES 8" WATER LINE
 - W100 DENOTES WATERLINE 100
 - W200 DENOTES WATERLINE 200
 - W900 DENOTES WATERLINE 900
 - W1000 DENOTES WATERLINE 1000
 - W1100 DENOTES WATERLINE 1100

PLAN/PROFILE
WATERLINE 1100
AT
LAKEWATCH PLANTATION
PLANNED COMMERCIAL DEVELOPMENT
DEVELOPED BY: LAKE WATCH, L.L.C.
GILLS CREEK MAGISTERIAL DISTRICT
FRANKLIN COUNTY, VIRGINIA
JOB NO 21-04
MAY 15, 2007
SHEET 16 OF 32
REVISED AUGUST 1, 2007