



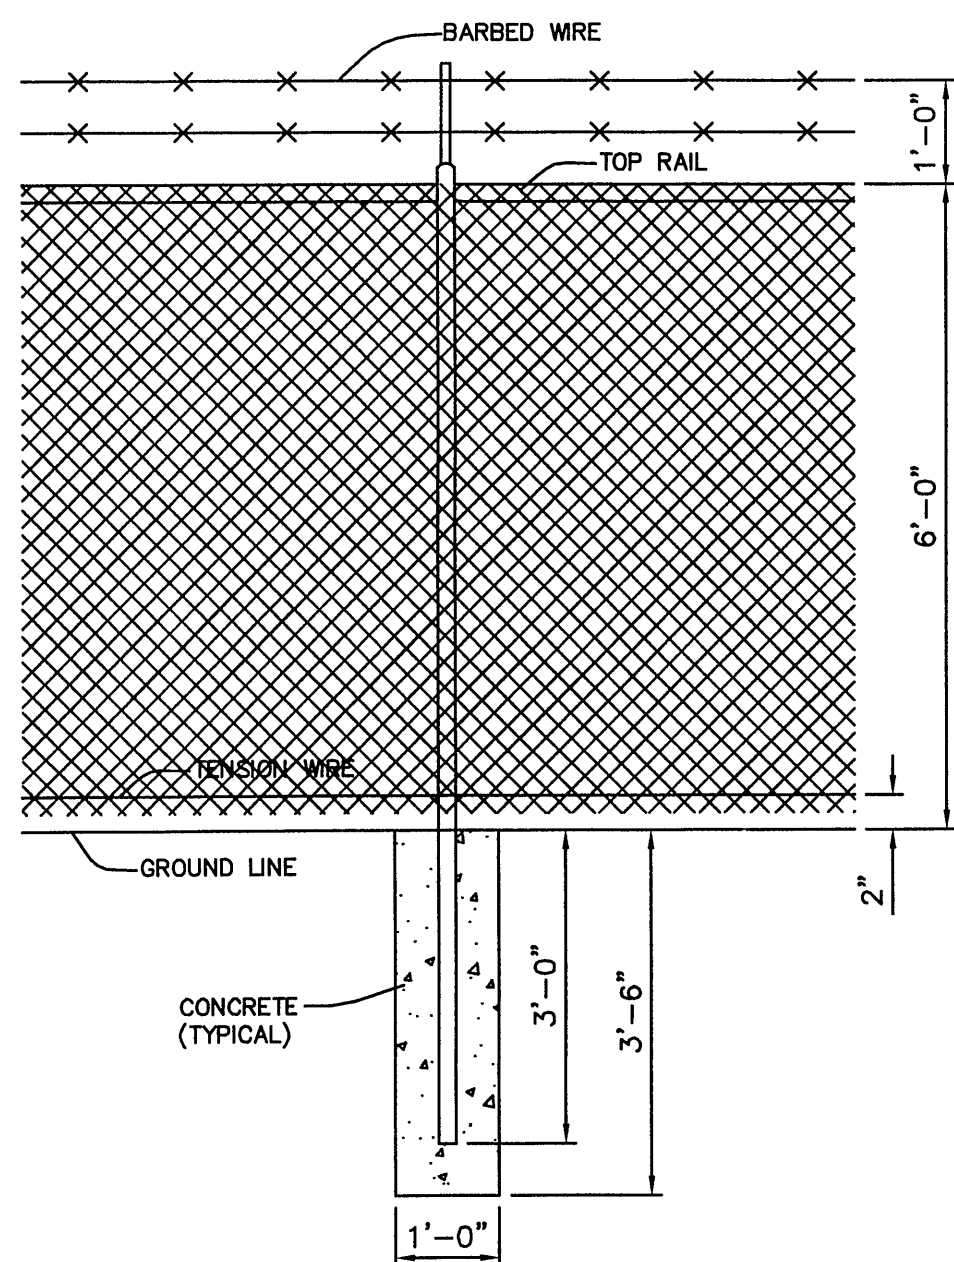


STANDARD LINE POST
NTS

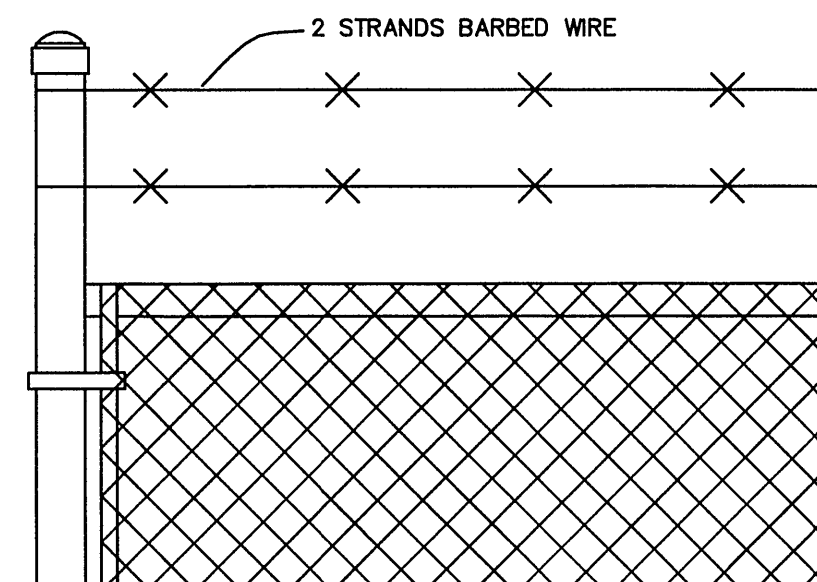


BARBED WIRE - 2 STRANDS, 12 1/2 GAUGE WIRE WITH 14 GAUGE 4 POINT BARBS SPACED APPROXIMATELY 6 INCHES APART. ALL WIRE SHALL BE ALUMINUM COATED WITH A MINIMUM COATING OF 0.25 OUNCES PER SQUARE FOOT OF SURFACE AREA.

BARBED WIRE SHALL BE DIRECTLY ATTACHED TO EACH CORNER AND GATE POST. BARBED WIRE SHALL BE ATTACHED TO EACH LINE POST AND PULL POST WITH A SUPPORTING ARM. SUPPORTING ARM SHALL SLOPE TO THE OUTSIDE OF THE FENCE AT A 45° ANGLE.


BARBED WIRE
NTS

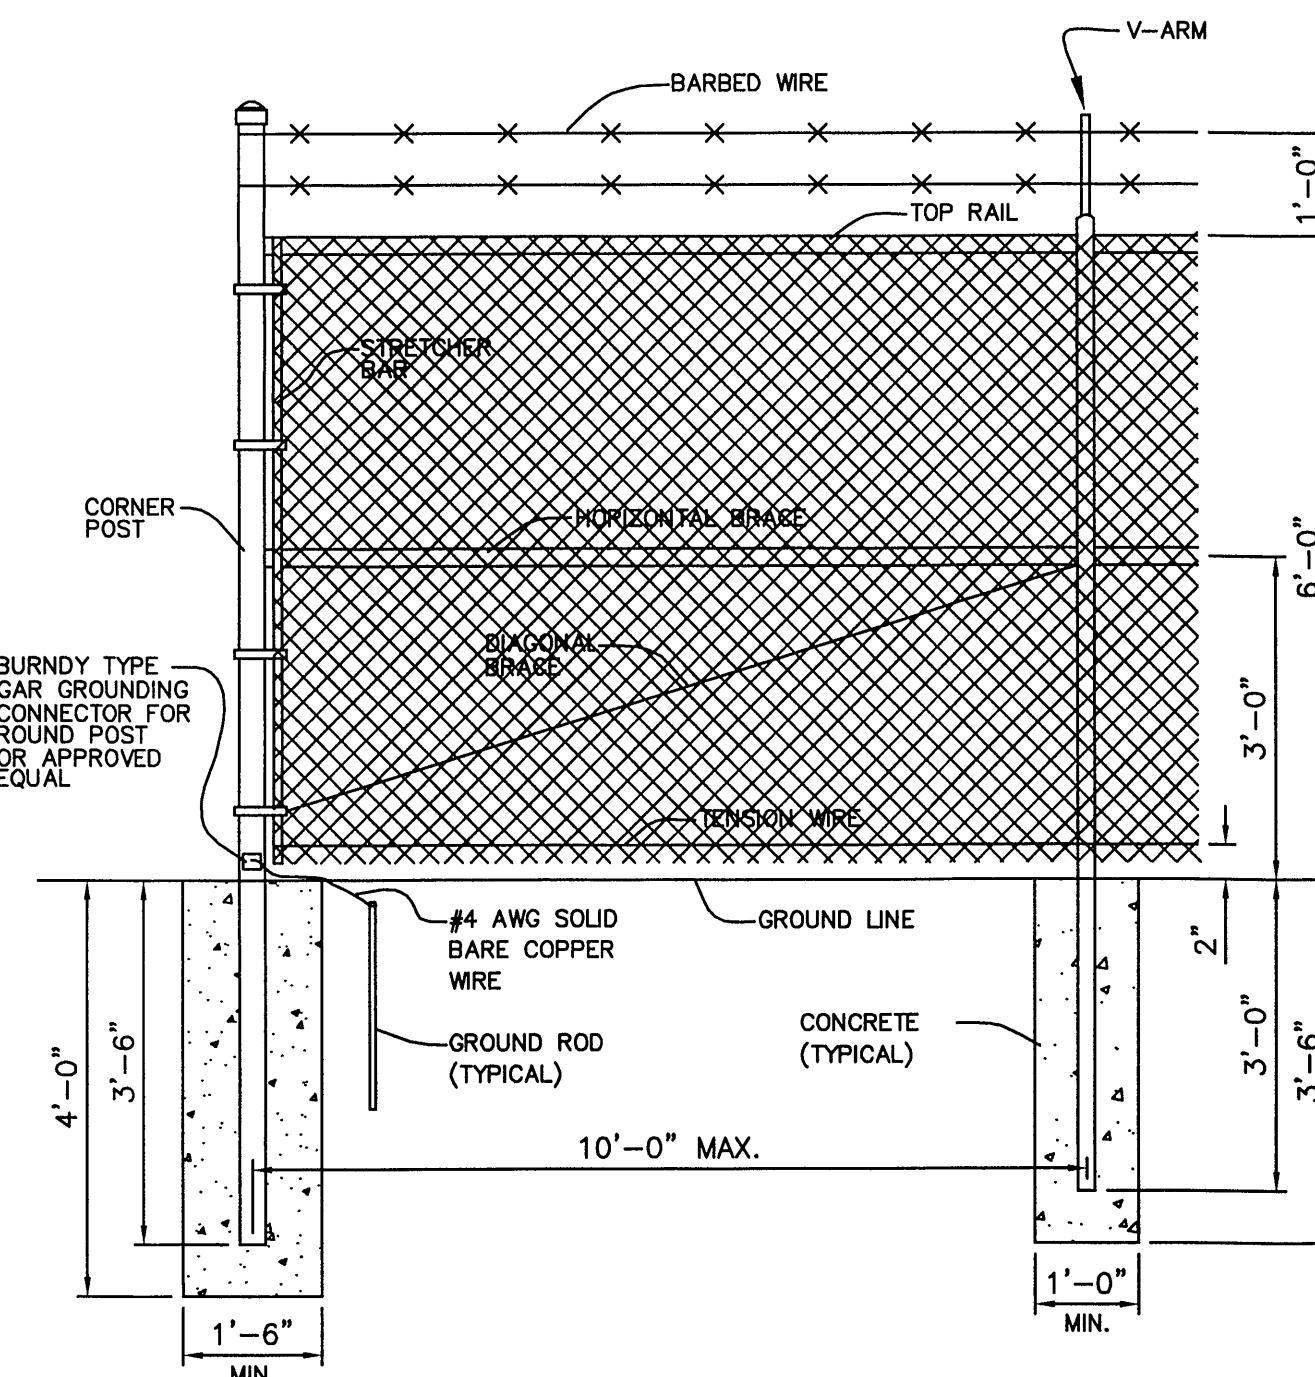

STANDARD CORNER
NTS

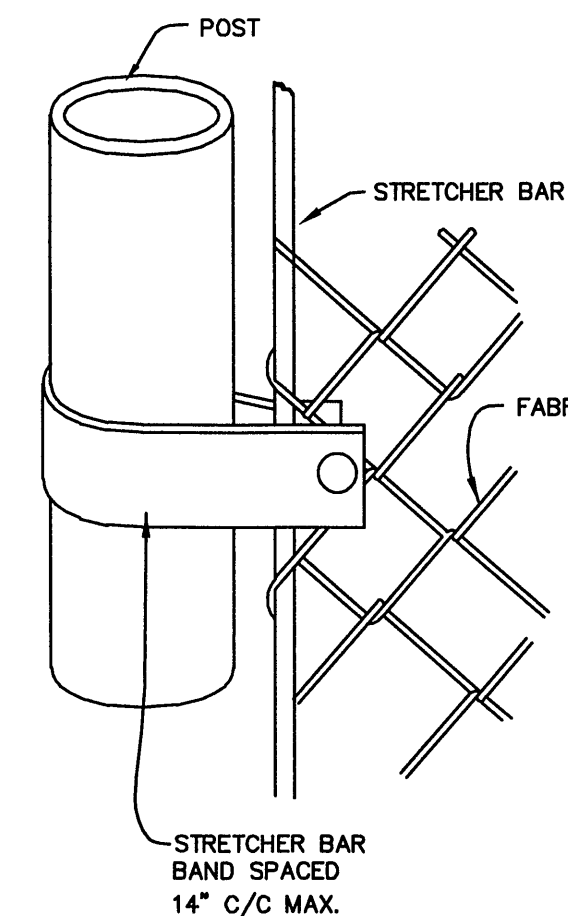

METHOD OF FASTENING
STRETCHER BAR TO POST

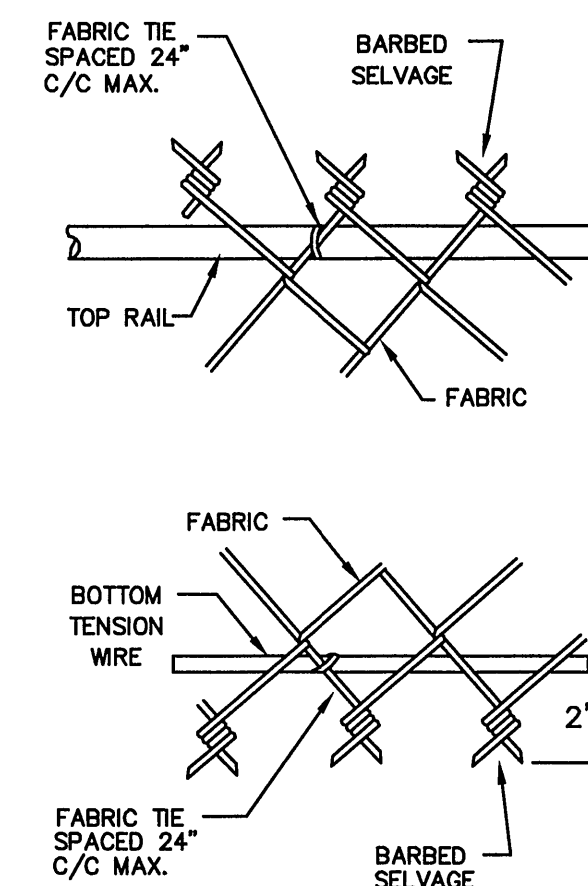


METHOD OF TYING
FABRIC TO TENSION WIRES

FASTENING & TYING
NTS




BLOCK LETTERS ON WHITE BACKGROUND
SIGN PANEL SHALL BE STANDARD GAUGE ALUMINUM SHEETS
SIGN SHALL BE FIELD LOCATED


SIGN
NTS

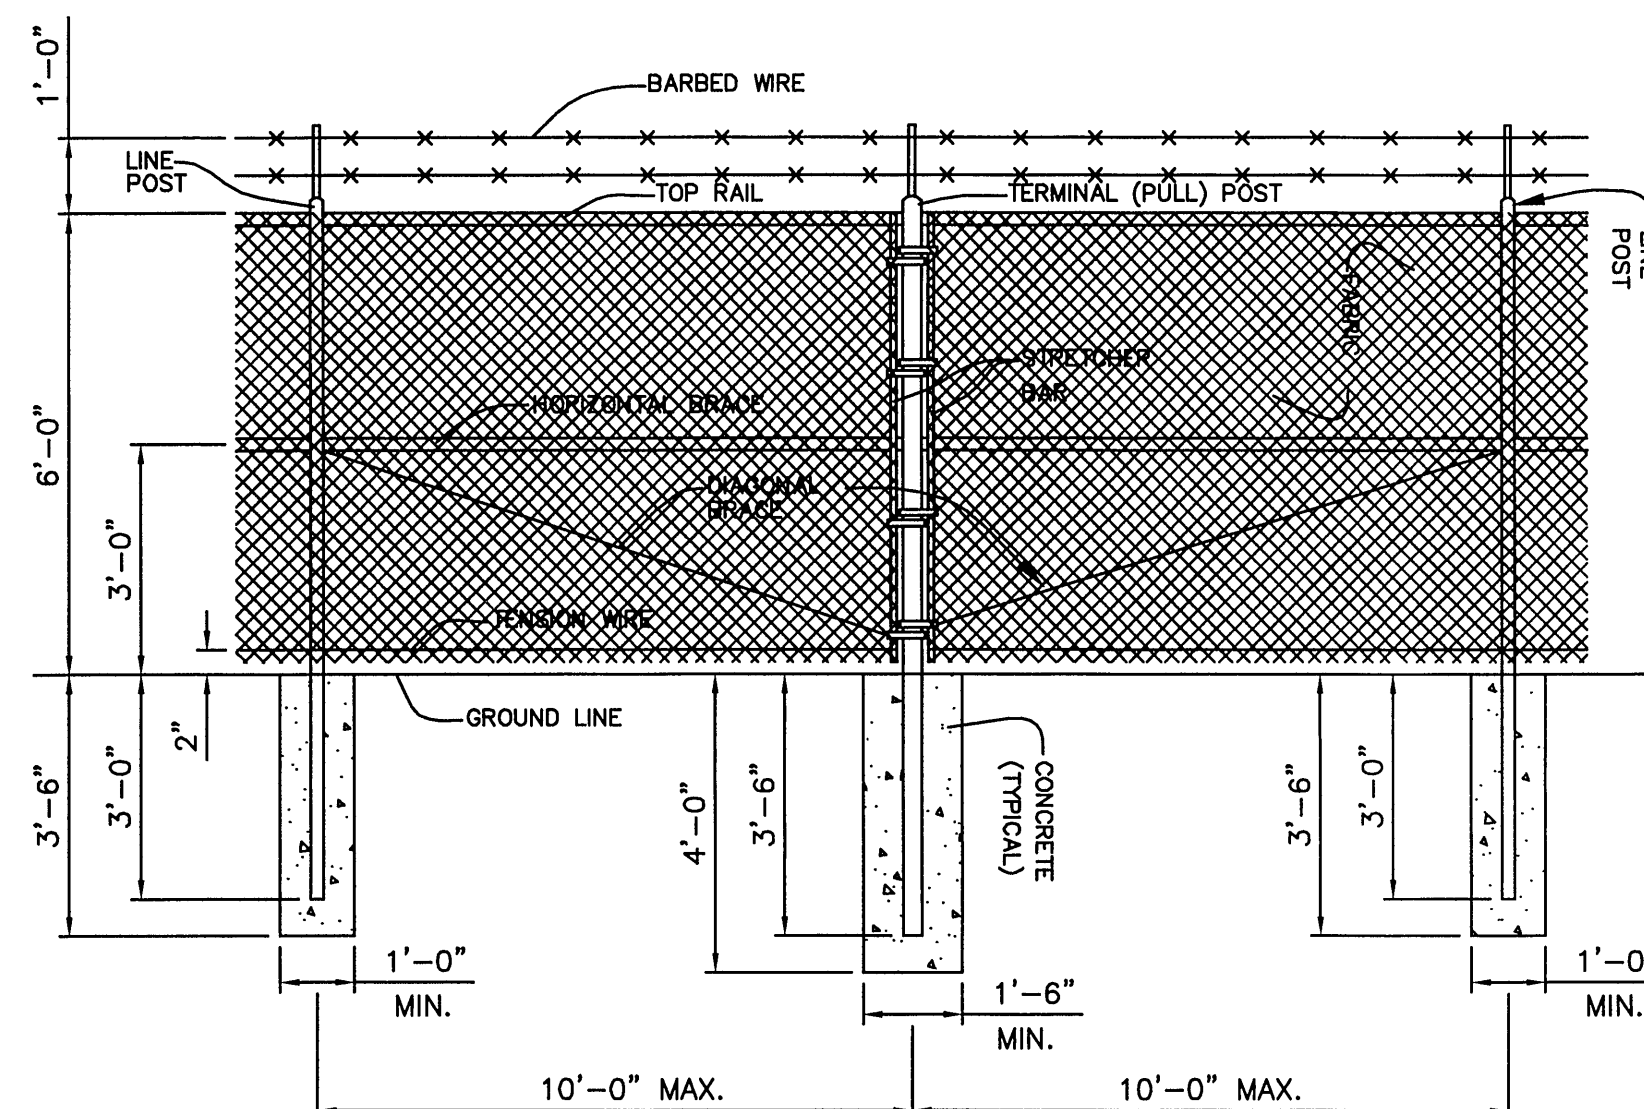

STANDARD PULL POST
NTS

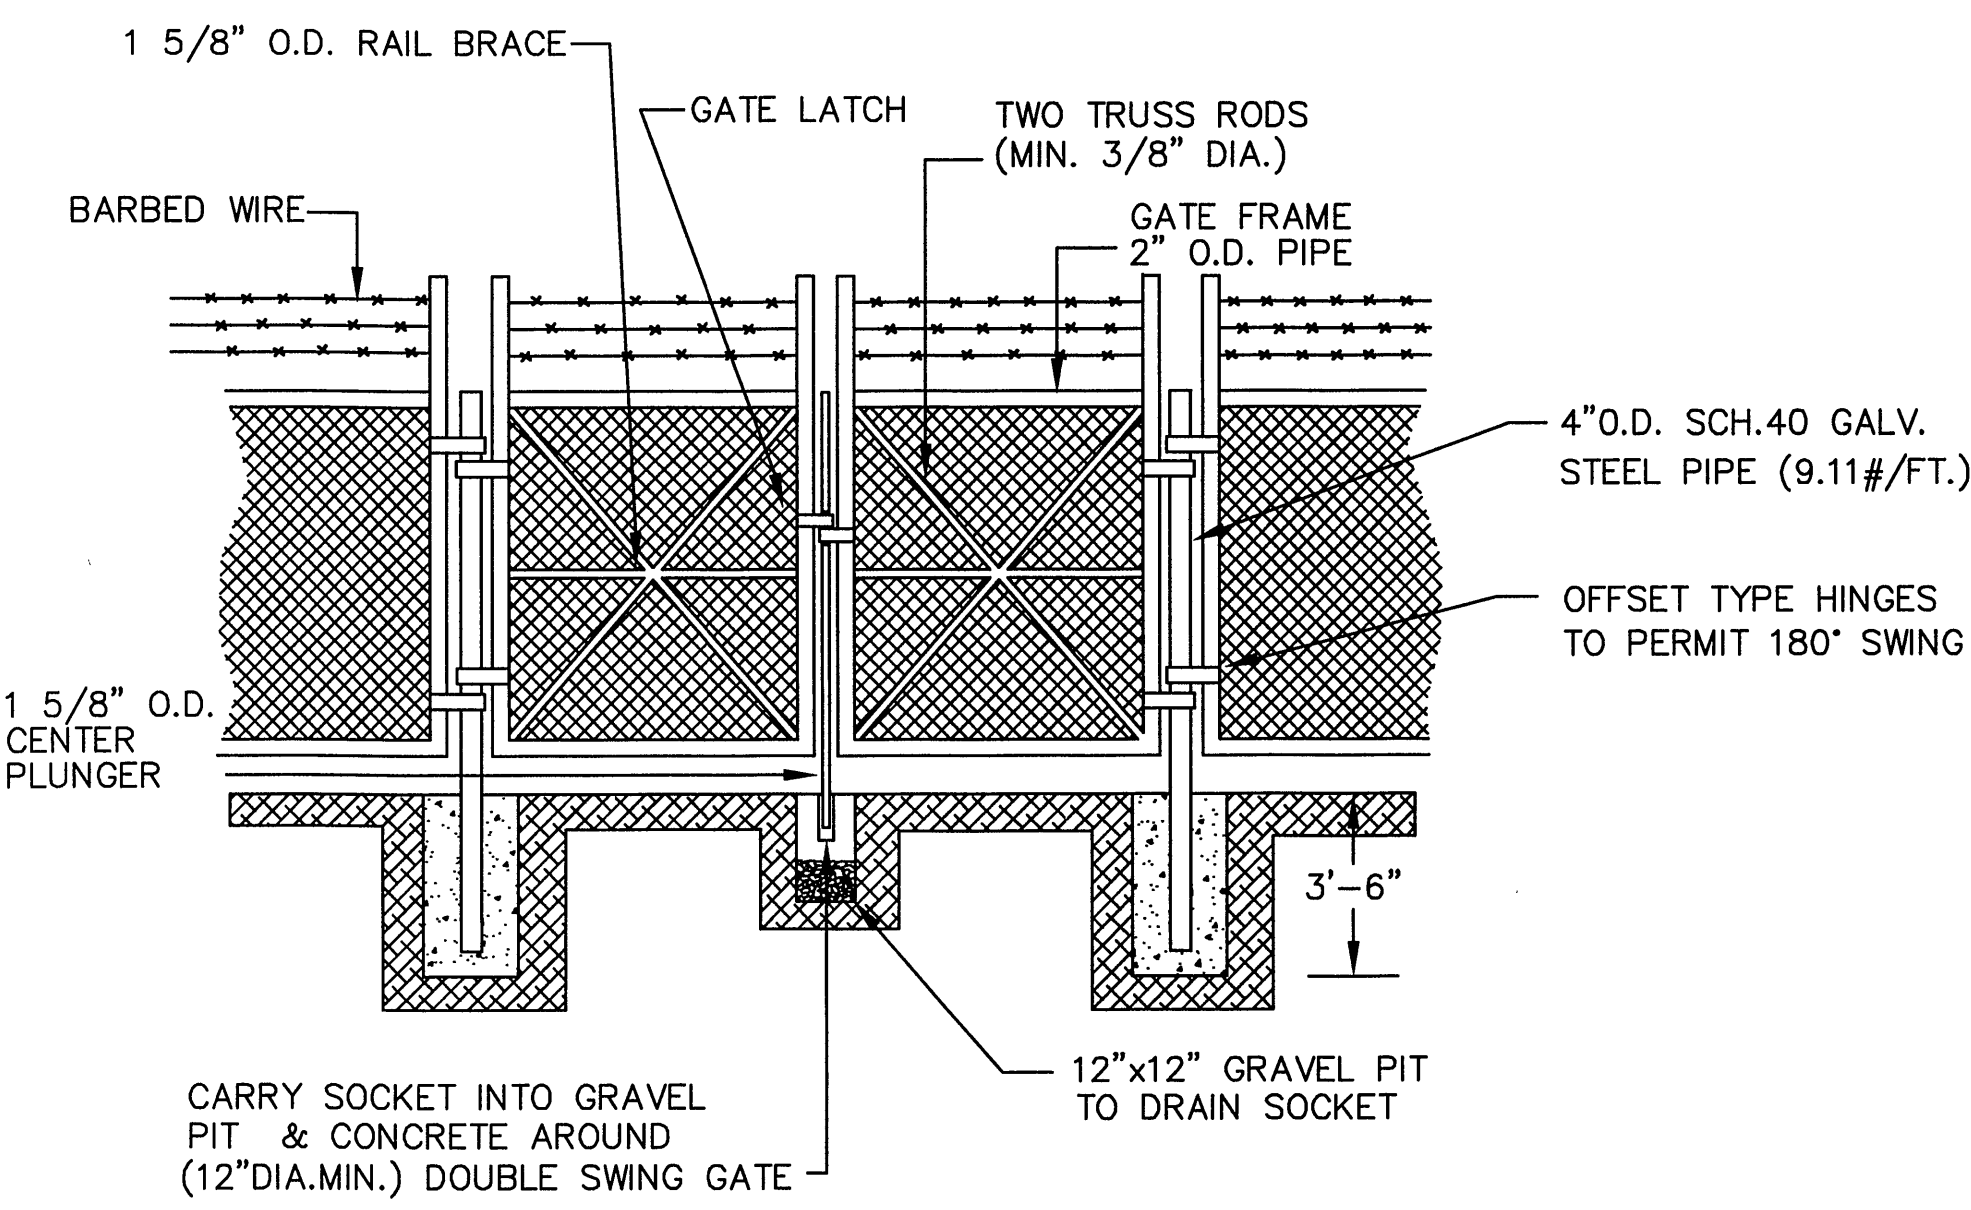

DOUBLE GATE DETAIL

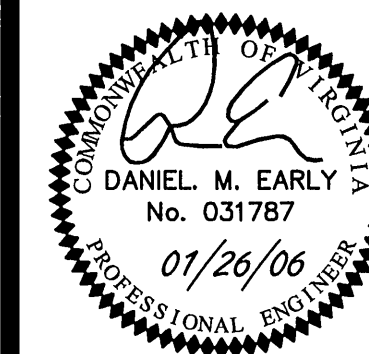

ACS DESIGN

Engineering-Planning-Surveying
Construction Management
2203 Peters Creek Road, NW
Roanoke, Virginia 24017
Phone: 540 562 2345
Fax: 540 562 2344
Email: info@acsdesignllc.com
www.acsdesignllc.com

**LAKEWATCH PLANTATION
COMMUNITY SEWER SYSTEM
PHASE 1
FRANKLIN COUNTY, VIRGINIA**

DRAWN BY: AH

DESIGNED BY: DME

CHECKED BY: DME

DATE: NOV. 26, 2006

SCALE: NTS

REVISIONS	DATE	COMMENT

SHEET No.

C1.23

STANDARD DETAILS

JOB No. 05076