




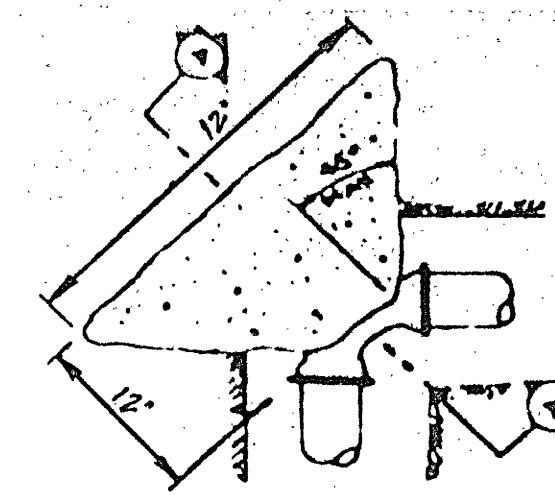

FOR ALL BENDS

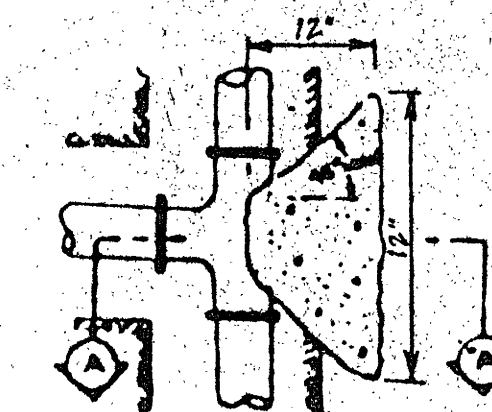


FOR TEE FITTINGS

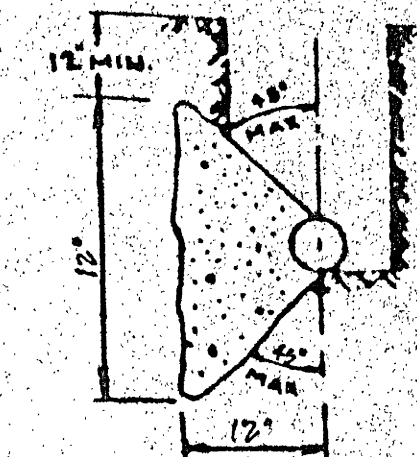


SECTION A-A

TYPE 'F' ANCHOR

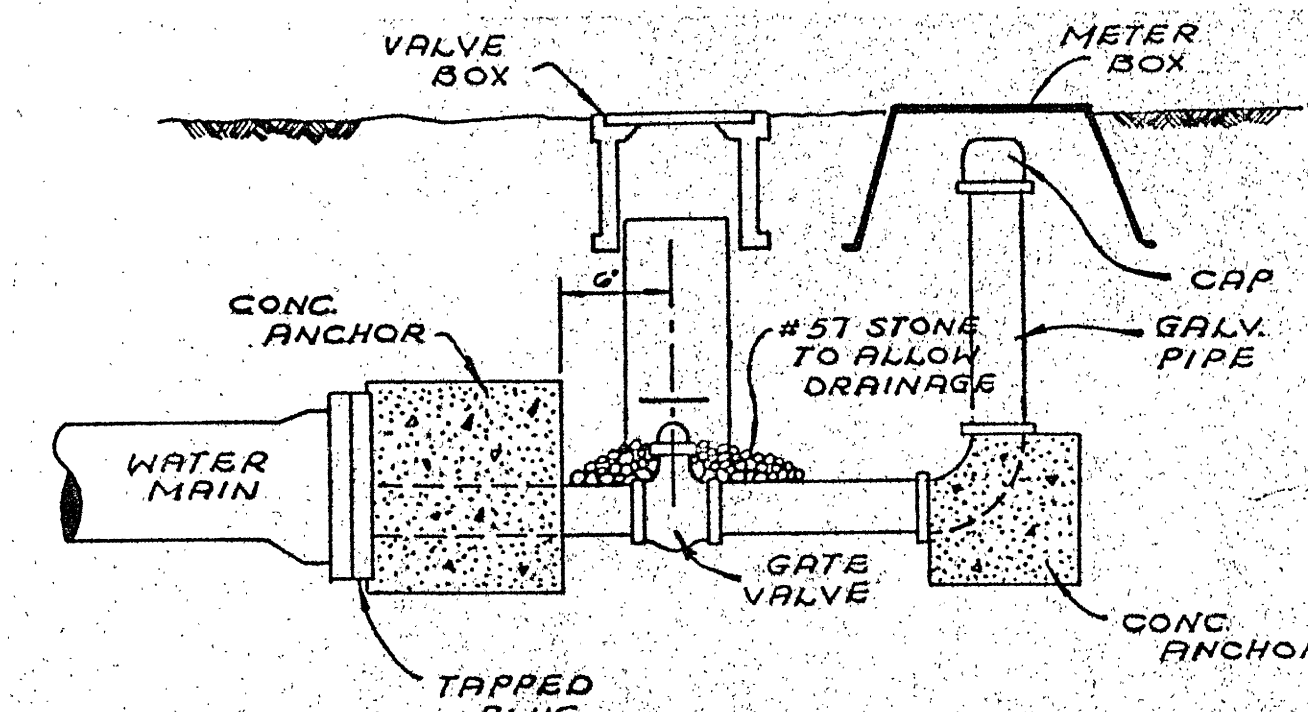

BLOW-OFF VALVE ASSEMBLY

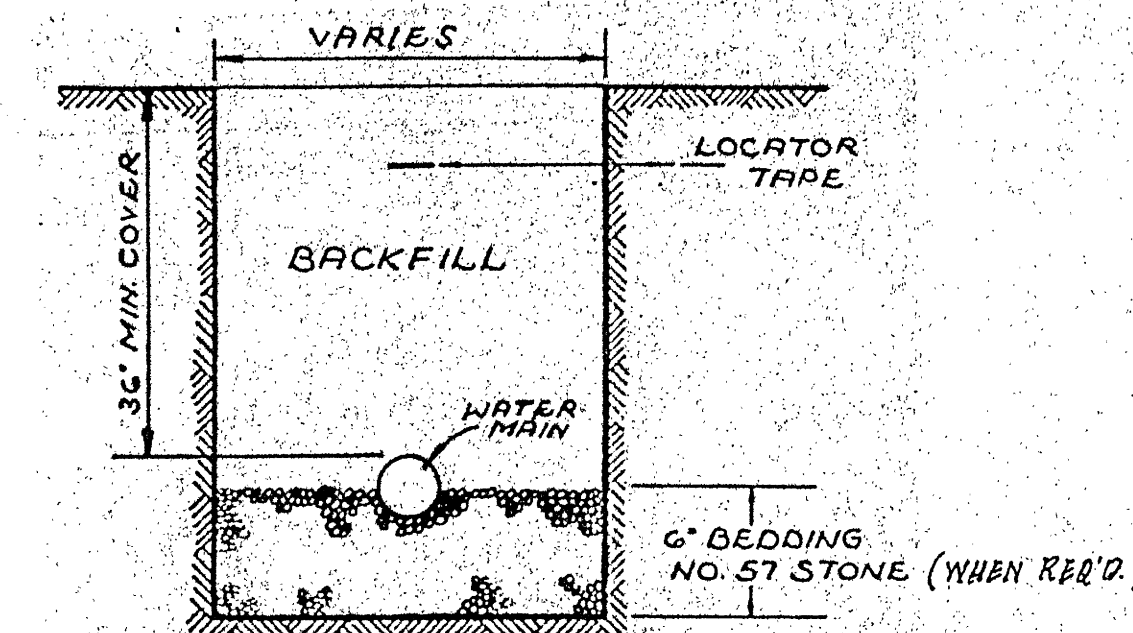


TYPICAL BEDDING DETAIL

NOTE: TIE ALL GATE VALVES TO TEES
W/ 3/4" A-307 CADMIUM
COATED TIE RODS.


- SINGLE METER CONNECTION
- DOUBLE METER CONNECTION

Berkley Howell & Assoc.
ENGINEERS • SURVEYORS • PLANNERS
101 CLAYMONT DRIVE
LYNCHBURG, VIRGINIA 24502
PHONE: 385-7548
385-7550

SCALE: 1" = 100' DATE: 3-29-90
COMM. NO. 90164 SHEET 1 OF 2

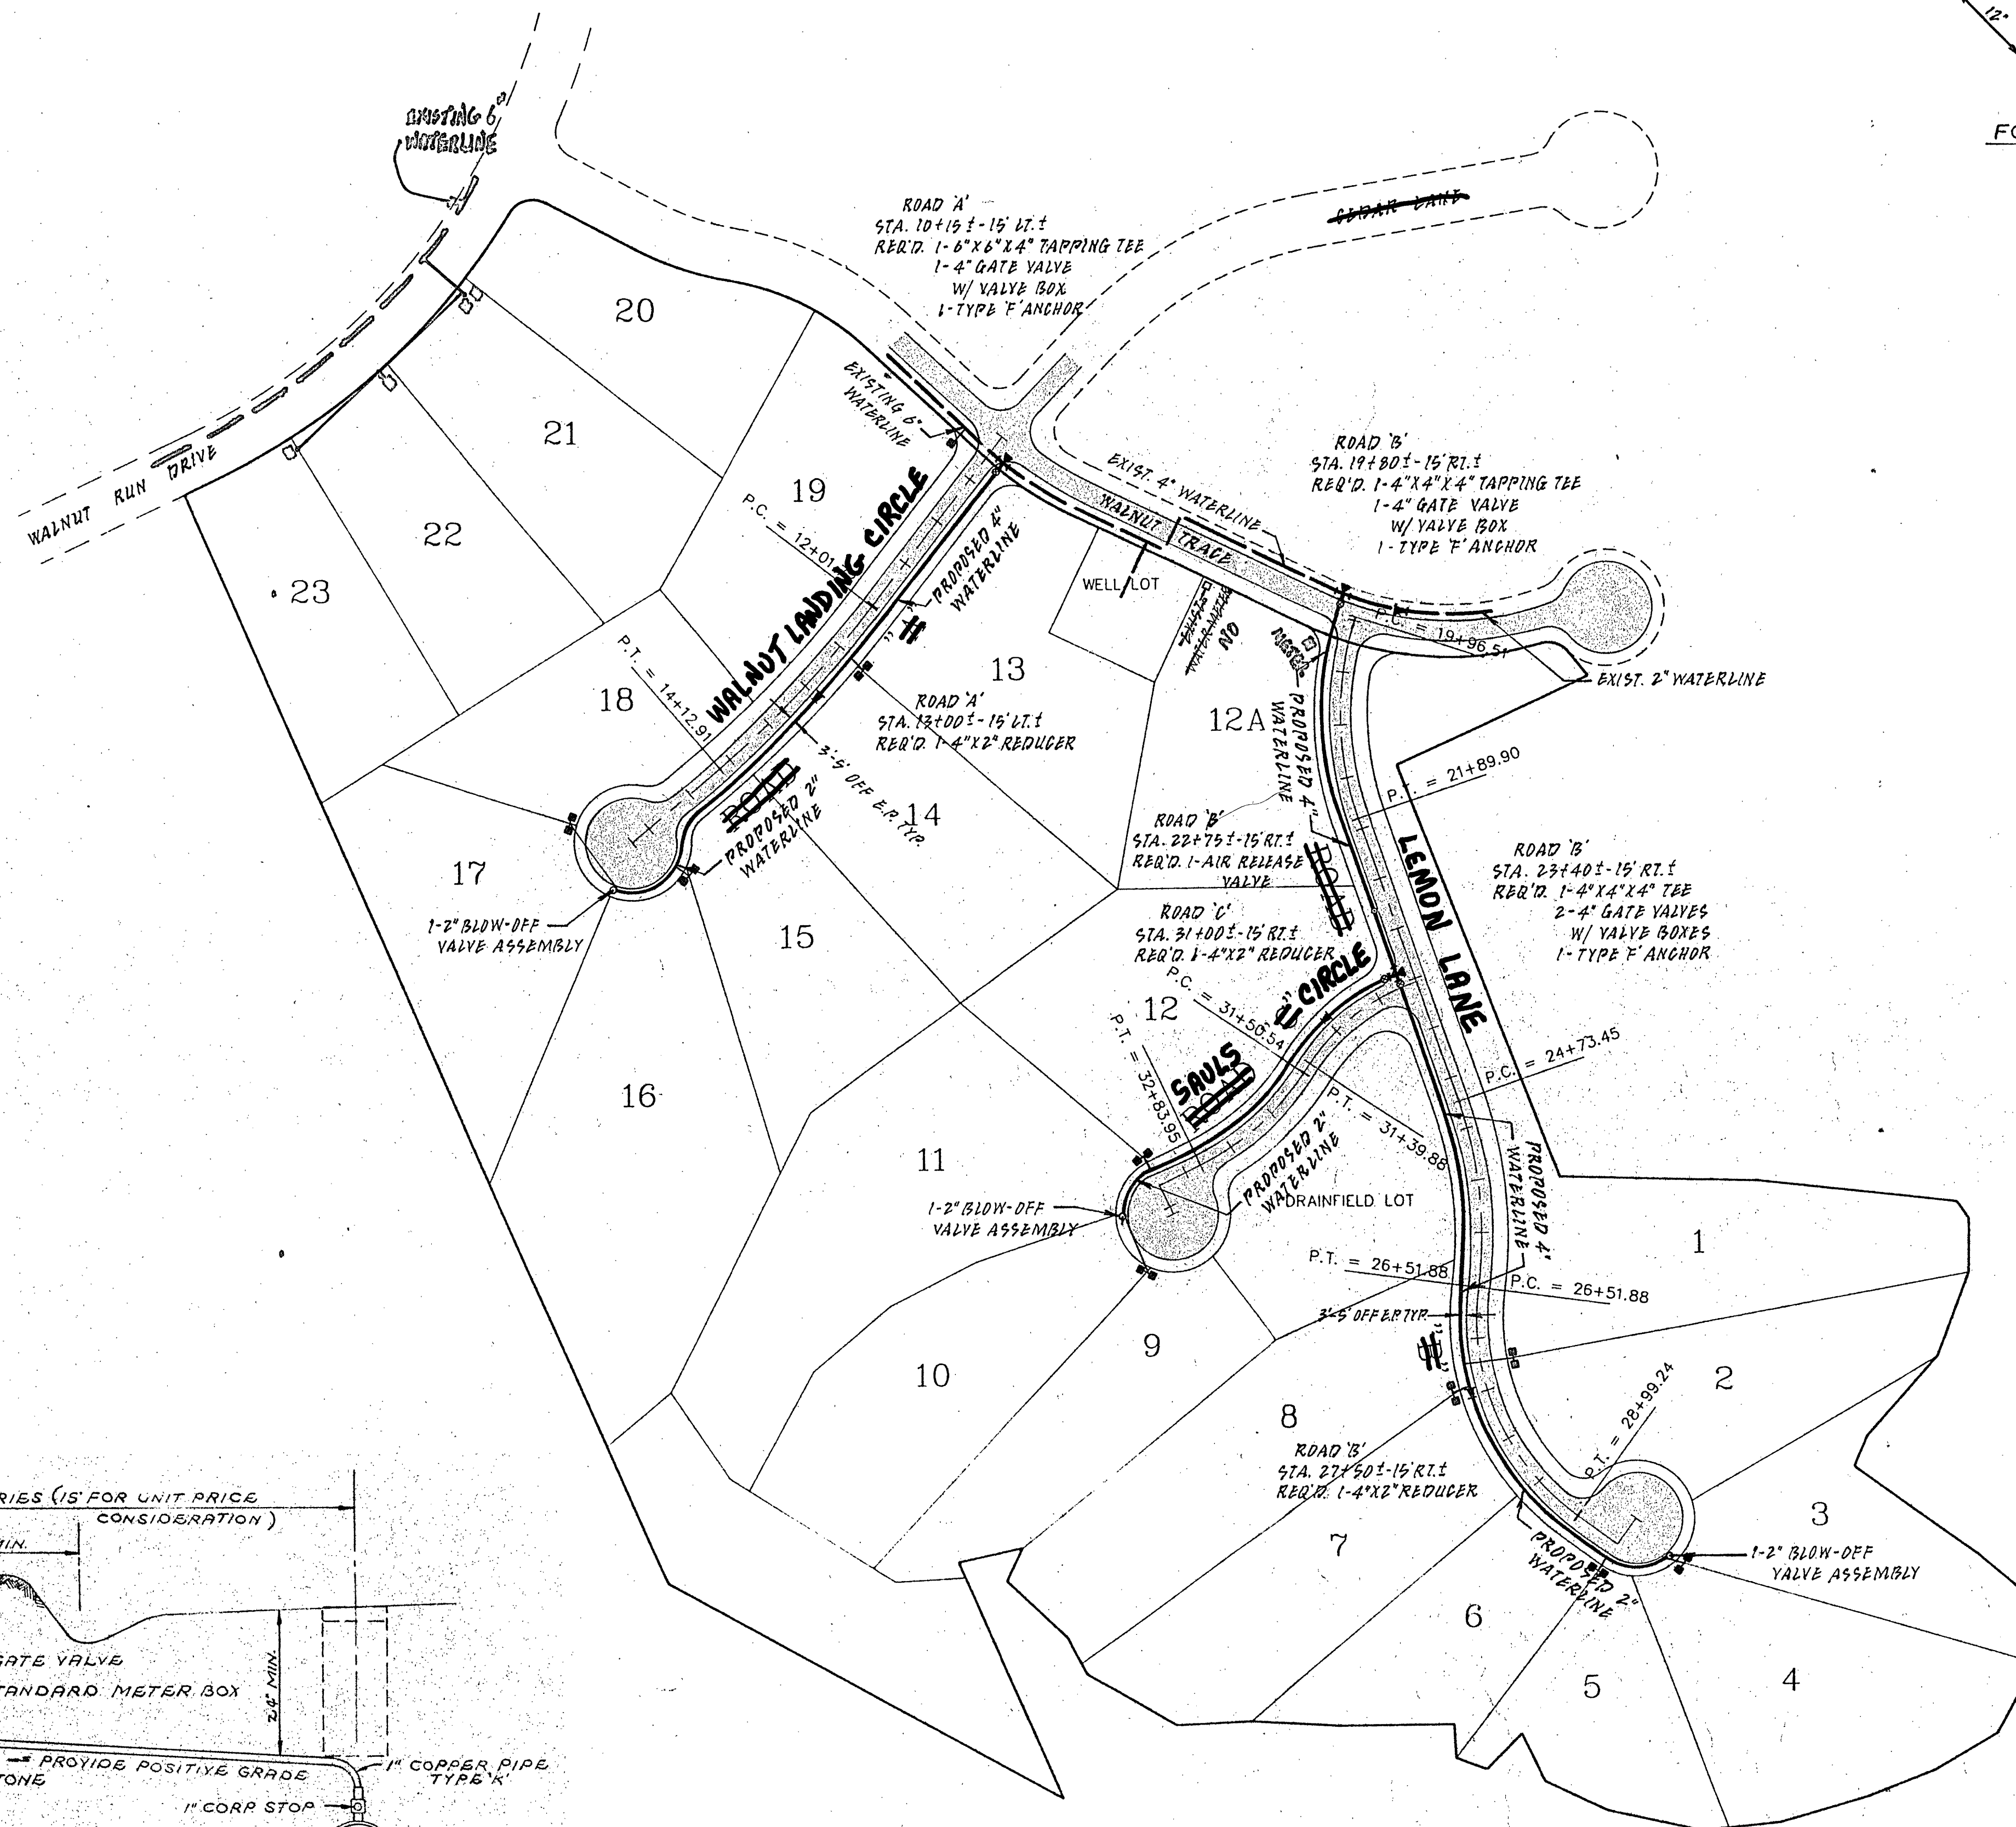

WALNUT RUN - SECTION 4
CENTRAL WATER SYSTEM

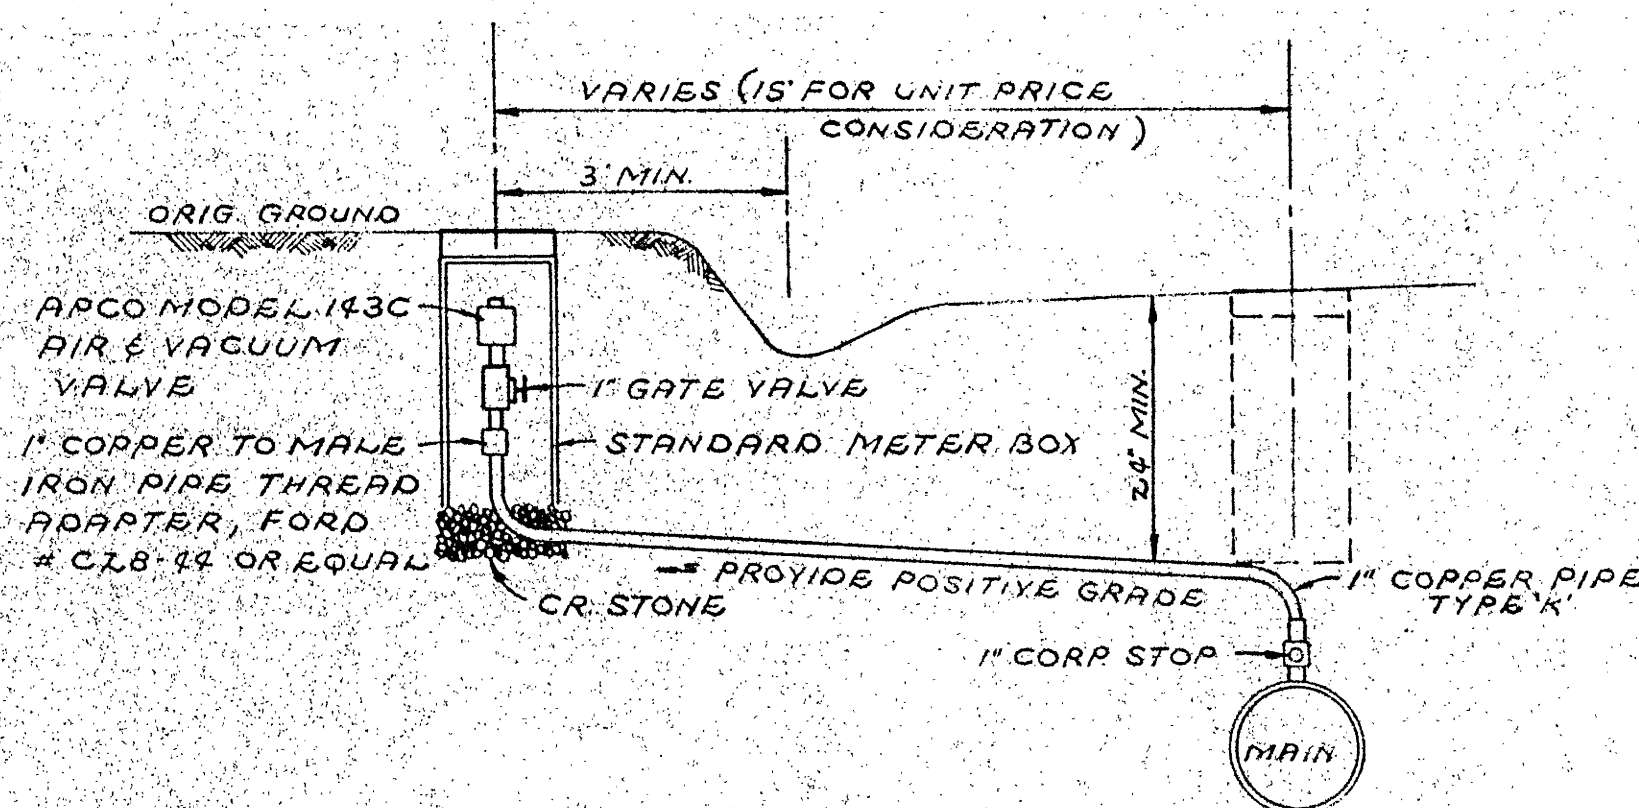

AIR RELEASE VALVE DETAIL