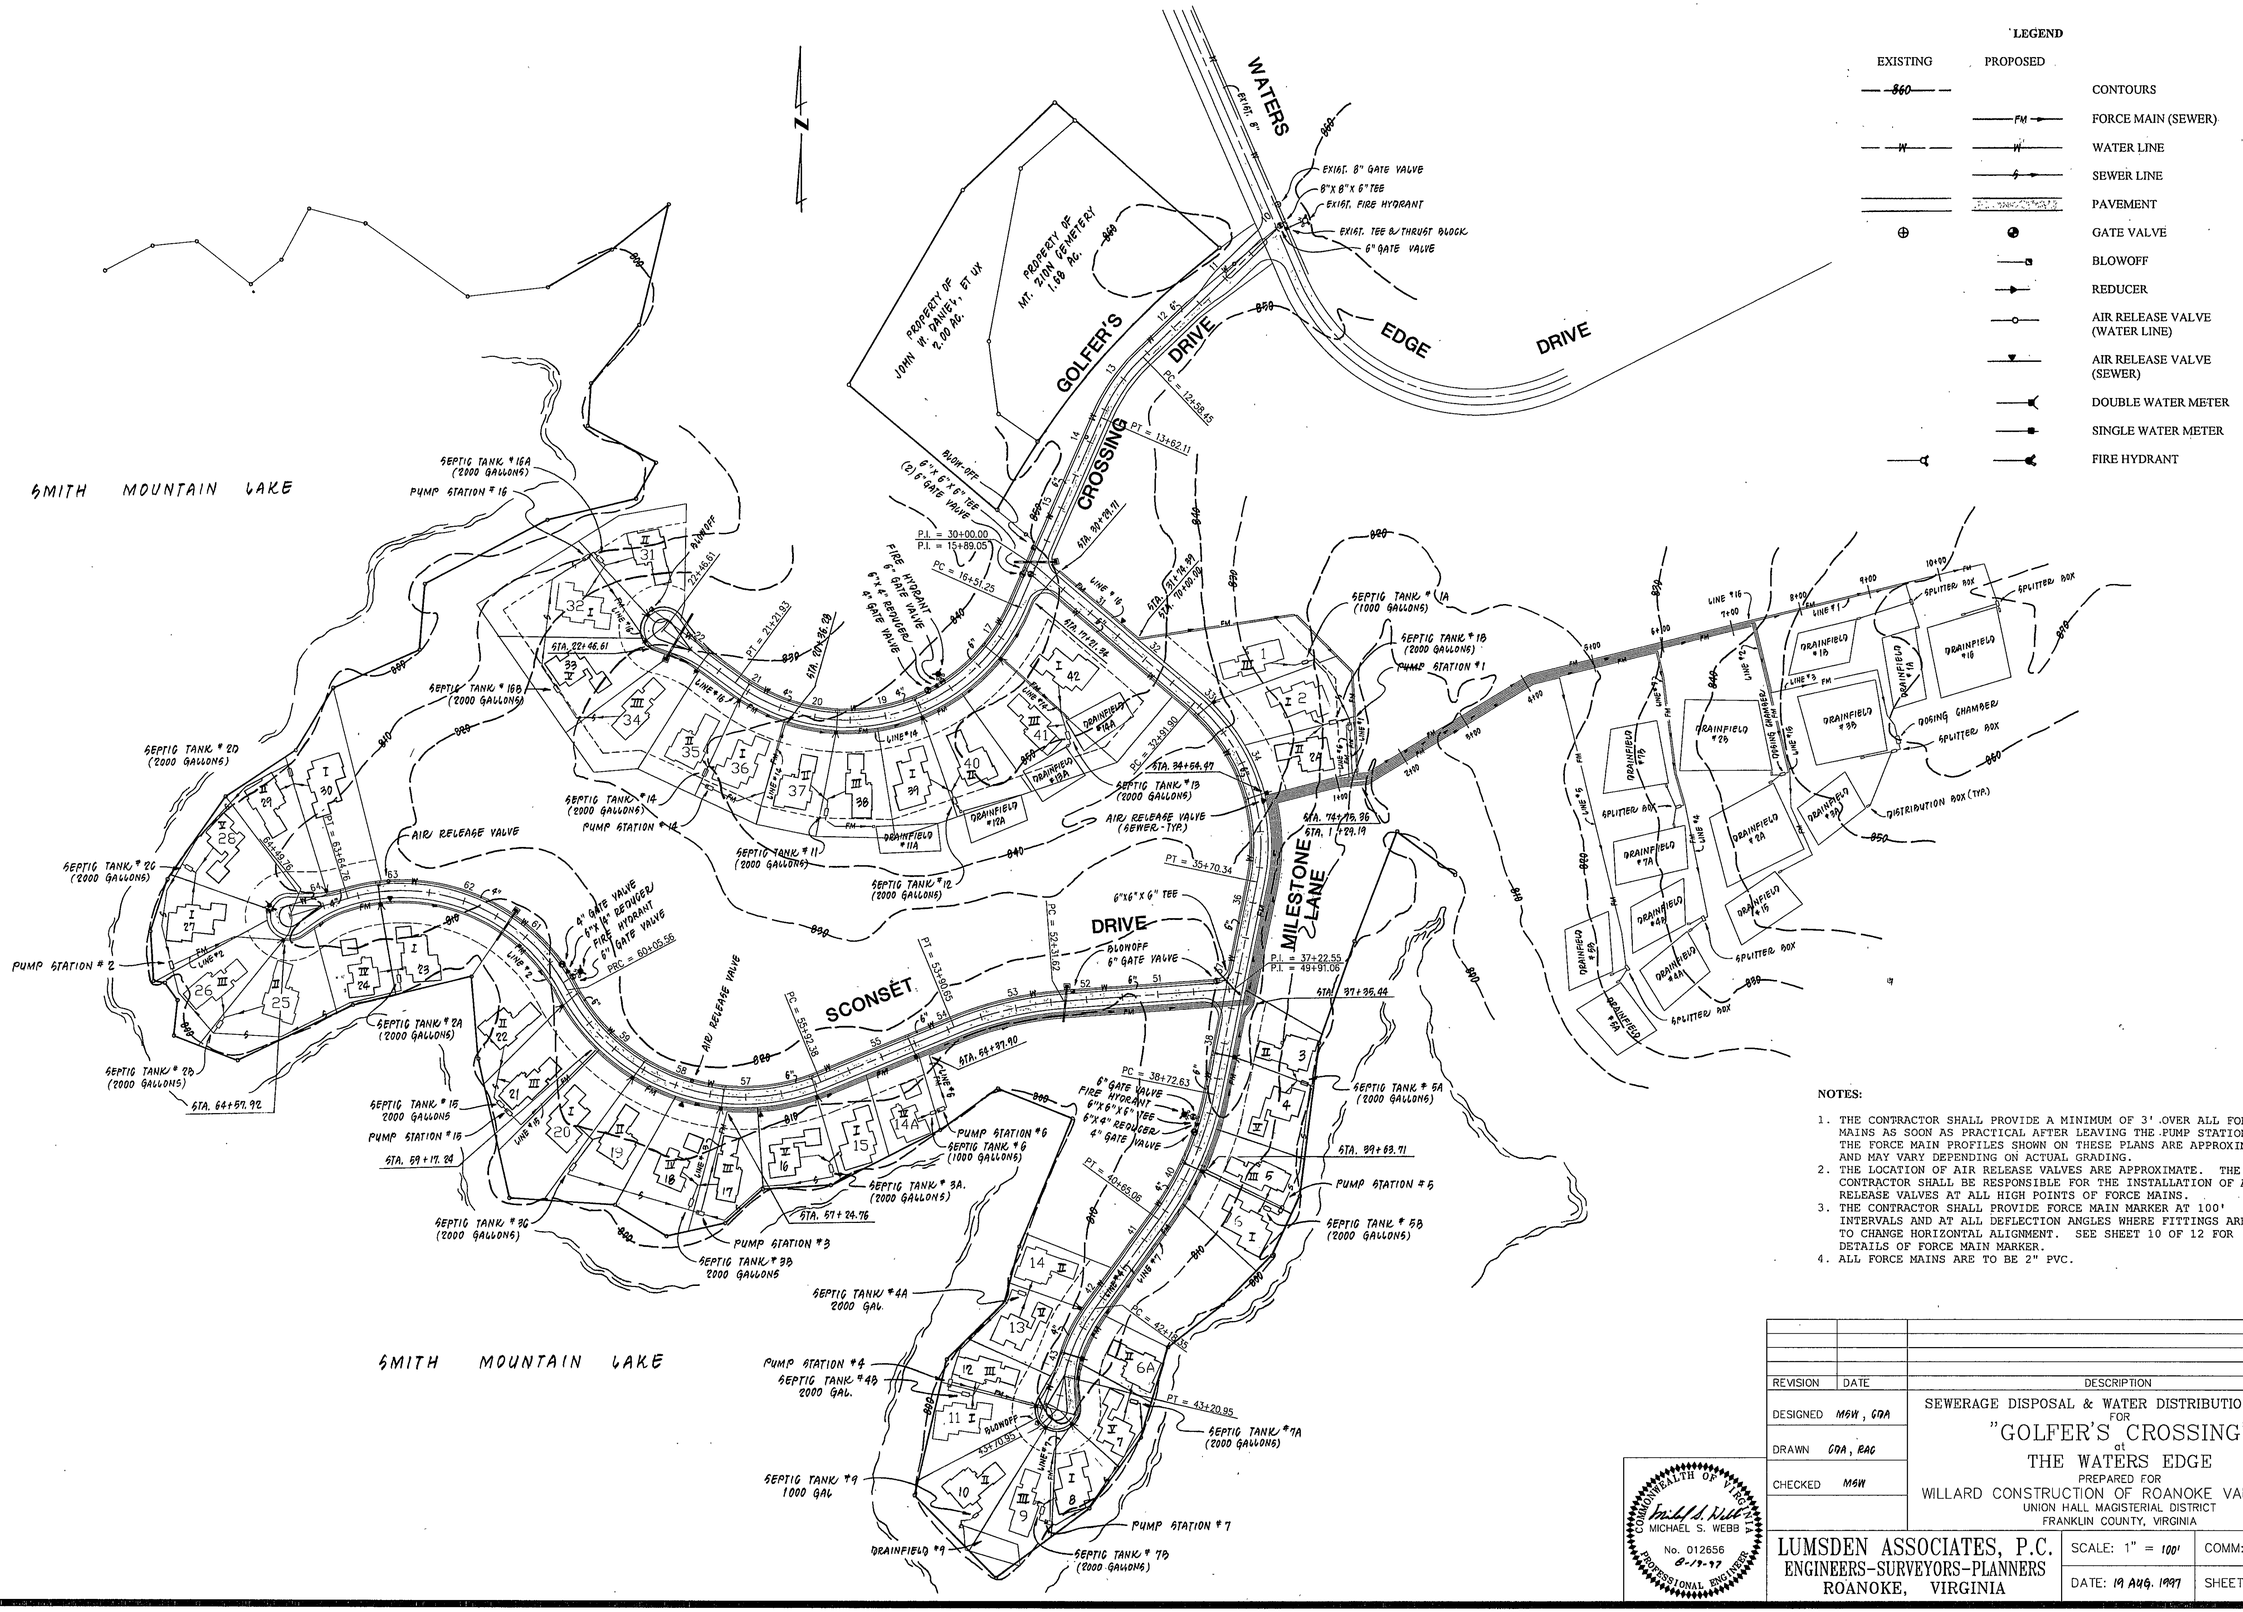

NOTES:

1. THE CONTRACTOR SHALL PROVIDE A MINIMUM OF 3' OVER ALL FORCE MAINS AS SOON AS PRACTICAL AFTER LEAVING THE PUMP STATION. THE FORCE MAIN PROFILES SHOWN ON THESE PLANS ARE APPROXIMATE AND MAY VARY DEPENDING ON ACTUAL GRADING.
2. THE LOCATION OF AIR RELEASE VALVES ARE APPROXIMATE. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE INSTALLATION OF AIR RELEASE VALVES AT ALL HIGH POINTS OF FORCE MAINS.
3. THE CONTRACTOR SHALL PROVIDE FORCE MAIN MARKER AT 100' INTERVALS AND AT ALL DEFLECTION ANGLES WHERE FITTINGS ARE USED TO CHANGE HORIZONTAL ALIGNMENT. SEE SHEET 10 OF 12 FOR DETAILS OF FORCE MAIN MARKER.
4. ALL FORCE MAINS ARE TO BE 2" PVC.

REVISION	DATE	DESCRIPTION

DESIGNED MGW, GOA
DRAWN GOA, RAG
CHECKED MGW

COMMONWEALTH OF VIRGINIA
MICHAEL S. WEBB
No. 012656
8-19-97
PROFESSIONAL ENGINEER

SEWERAGE DISPOSAL & WATER DISTRIBUTION SYSTEM
FOR
"GOLFER'S CROSSING"
at
THE WATERS EDGE
PREPARED FOR
WILLARD CONSTRUCTION OF ROANOKE VALLEY, INC.
UNION HALL MAGISTERIAL DISTRICT
FRANKLIN COUNTY, VIRGINIA

LUMSDEN ASSOCIATES, P.C.
ENGINEERS-SURVEYORS-PLANNERS
ROANOKE, VIRGINIA

SCALE: 1" = 100'
DATE: 19 AUG. 1997
COMM: # 84-665GC
SHEET 6 of 13