

Measurements are done Aprx 4' to 5' from edge of road unless noted otherwise.

Measurements for Katamaran Ln. start at 2" Valve


25' = 4'9"	389' = P.L. lot 6+7 = 4'6"
50' = 4'	375' = 4'2"
75' = 4'2"	400' = 4'
100' = 4'2"	425' = 3'9"
125' = 4'2"	450' = 3'7"
133' = P.L. lot 4+5 = 4'2"	475' = 3'
150' = 4'2"	484' = 4/meter box lot 7+8 = 3'4"
175' = 4'2"	500' = 3'9"
200' = 5'6"	525' = 3'6"
225' = 10'8"	550' = 3'6"
250' = P.L. lot 5+6 = 16'	575' = 4'6"
275' = 10'7"	600' = 4'8"
300' = 8'2"	608' = C/Fire Hyd.
325' = 8'5'10"	625' = 4'6"
350' = 5'	650' = 4'6"

675' = 4'6"
700' = 4'3"
725' = 4'6"
730' = 4/meter box lot 9+10
750' = 5'2"
775' = 4'8"
800' = 4'
825' = 4'4"

at this spot angle out to edge of pavement to finish measuring

845' = P.L. lot 10+11
850' = 4'9"
875' = 5'7"
881' = 6'7"
900' = 12'
925' = 15'
950' = 19'6"
961' = P.L. lot 11+12 = 19'6"
975' = 16'
1000' = 9'6"
1025' = 6'8"
1050' = 4'

1075' = 4'6"
1100' = 1'6"
1125' = 10' from pc lot 12+13 = 7'6"
1150' = 1'6"
1175' = 3'
1200' = 3'

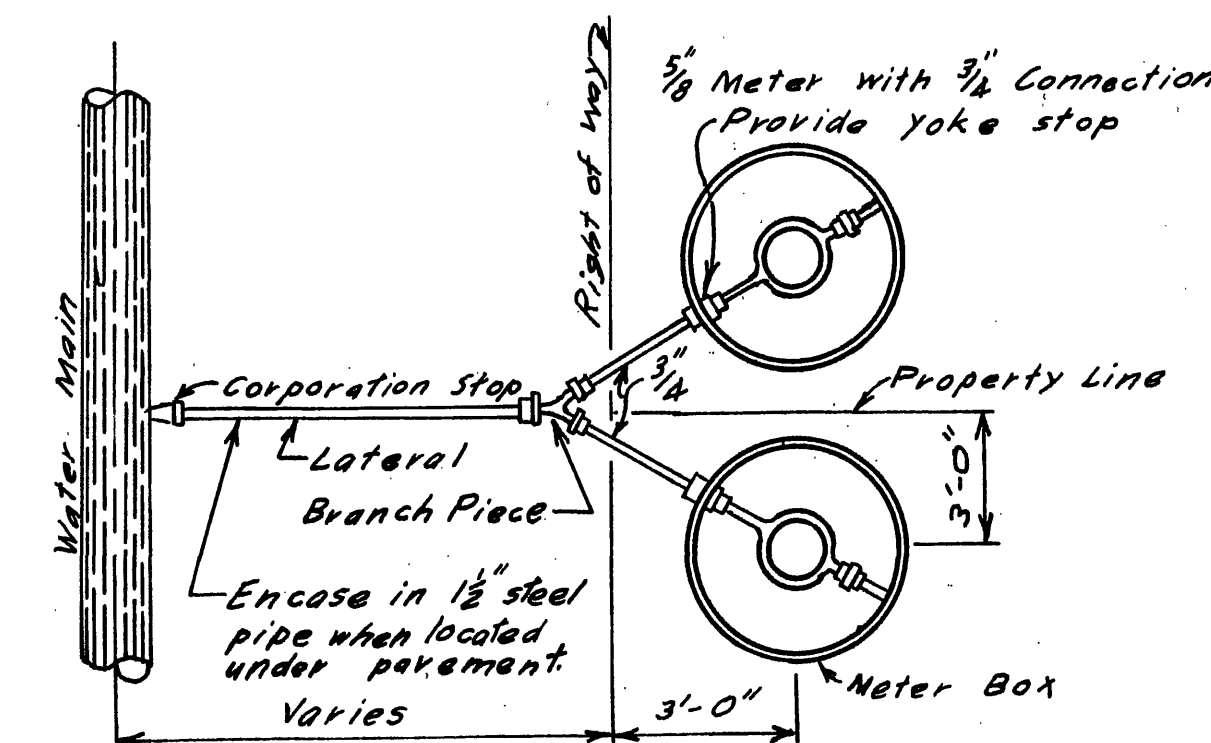


Note: Provide service saddle for all taps greater than 4"

WATER SERVICE CONNECTIONS


Not to Scale

Required:
1-8"x8"x6" Tee
1-3" Gate Valve
1-6" Gate Valve
1-Concrete Anchor

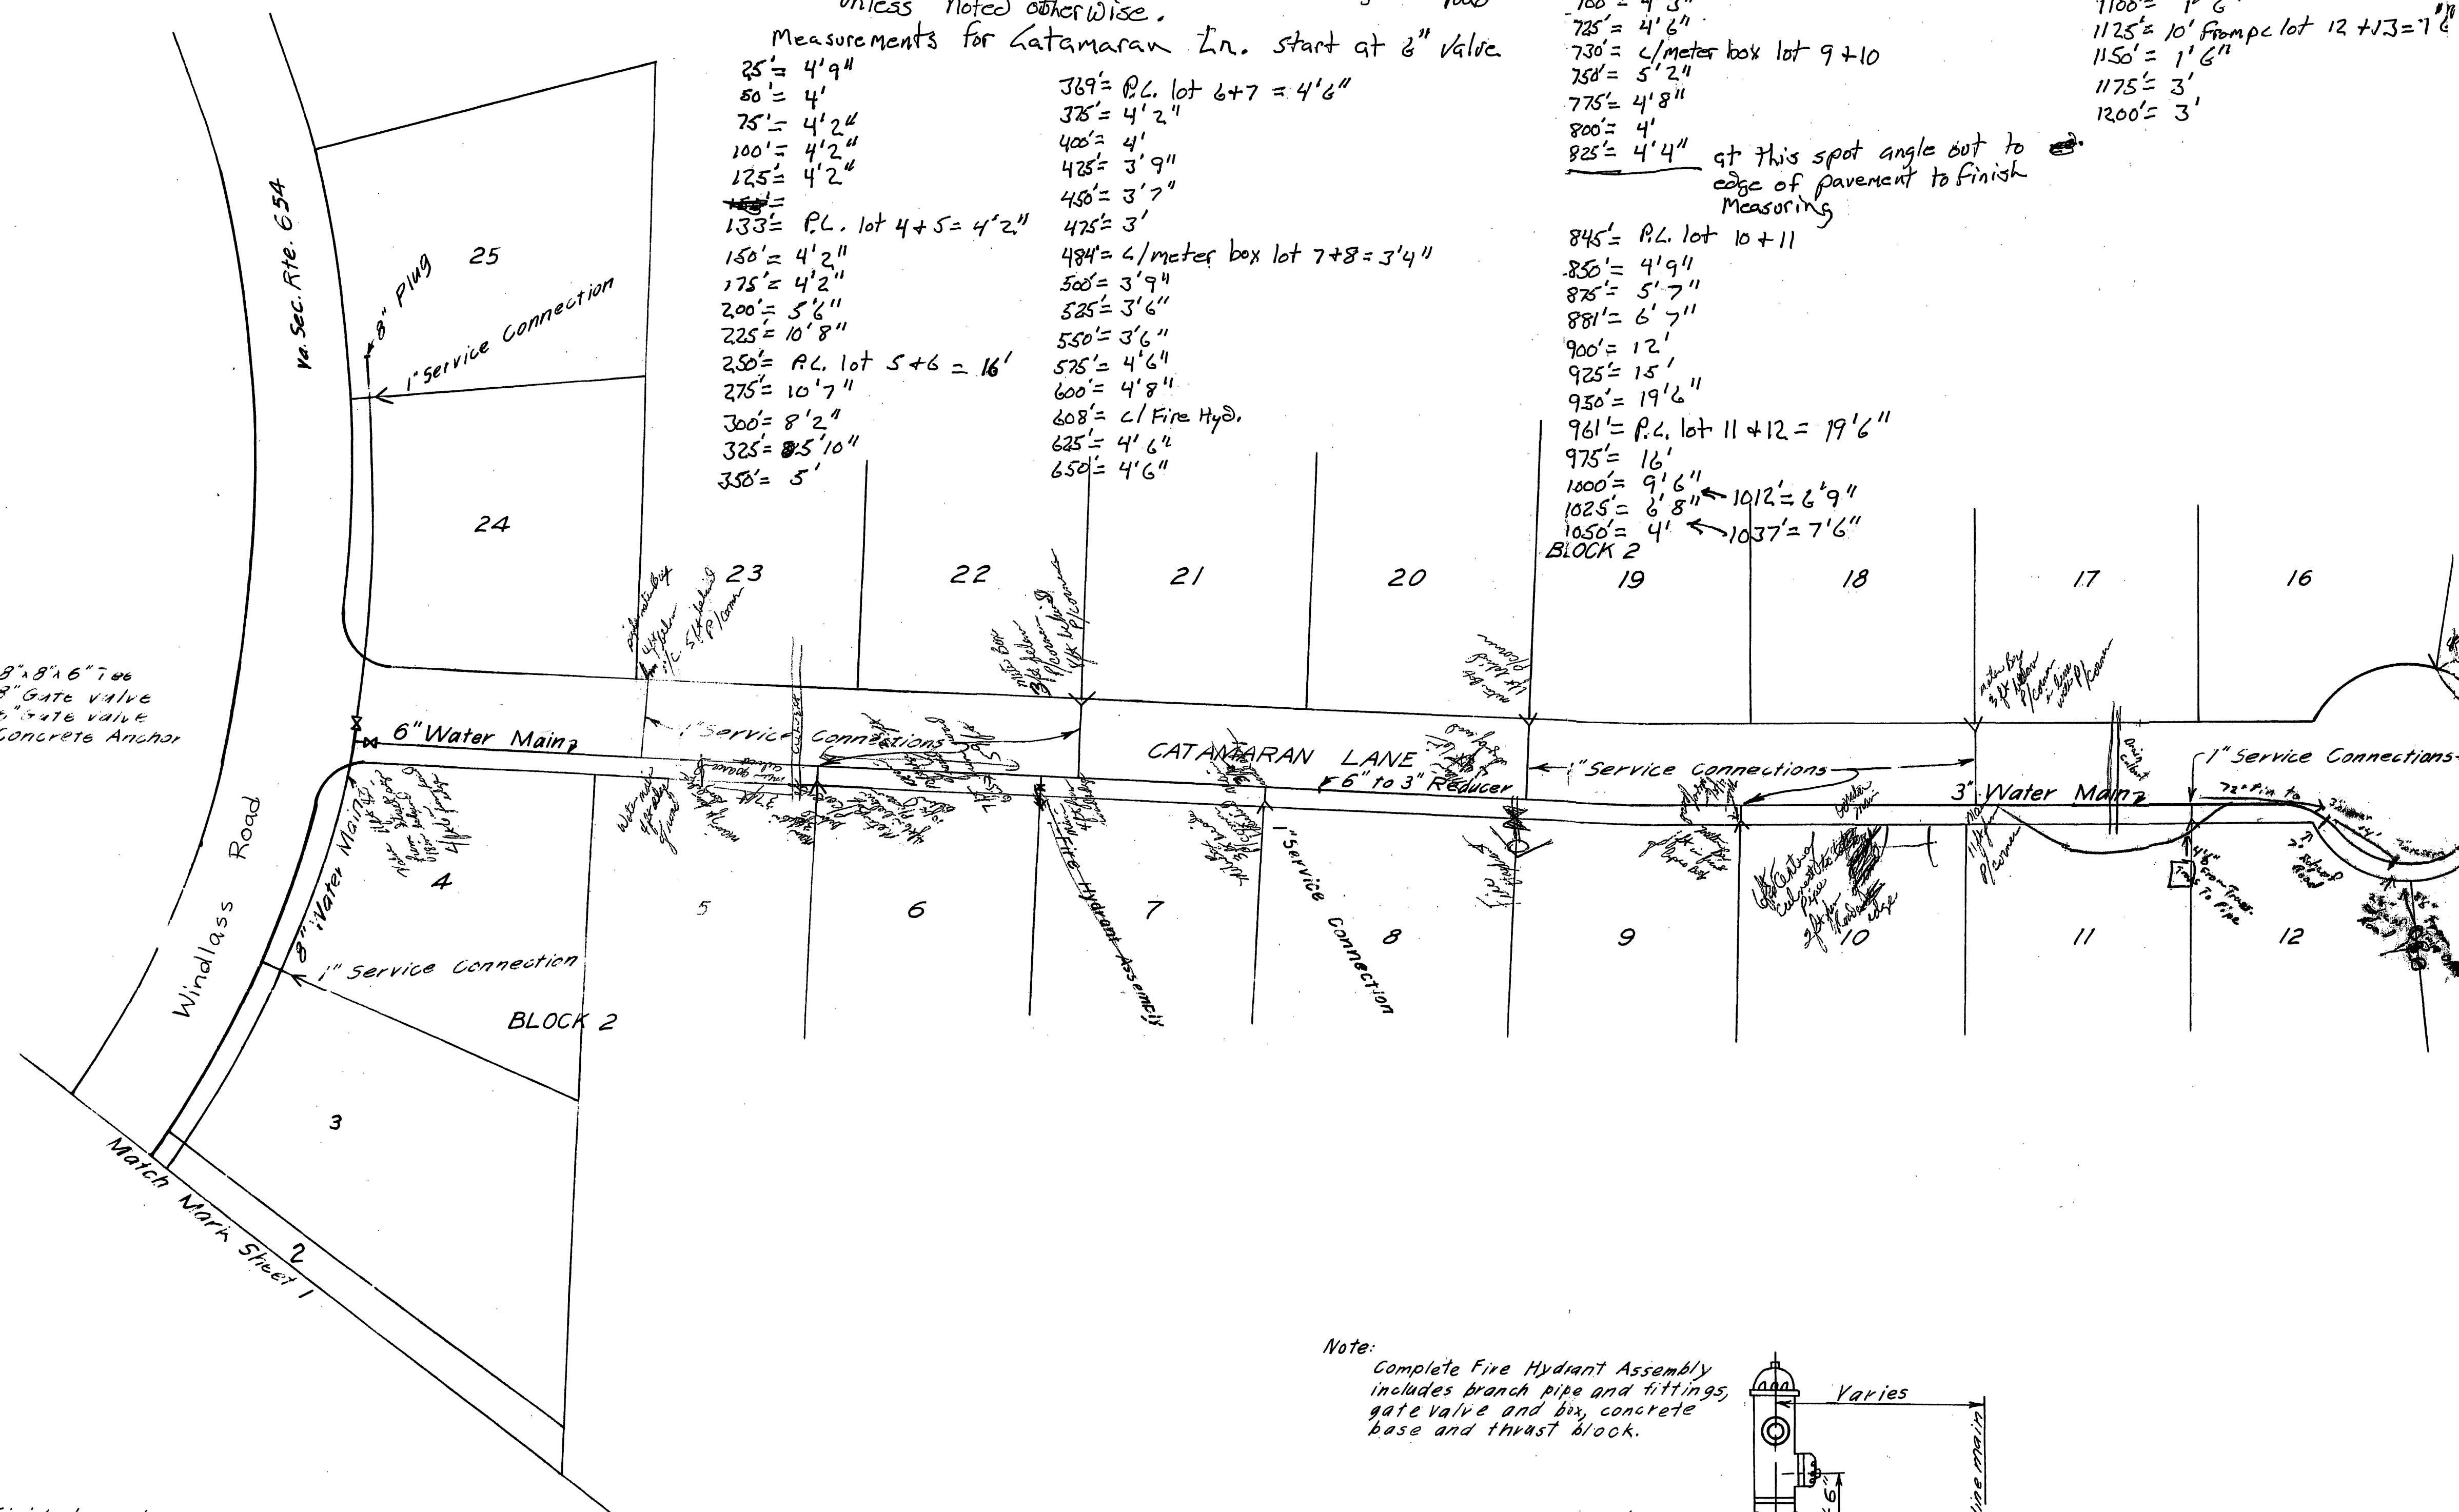


Required:
1-3" to 2" Reducer
1-2" Gate Valve
1-2" Line to Atmosphere

Note: Complete Fire Hydrant Assembly includes branch pipe and fittings, gate valve and box, concrete base and thrust block.

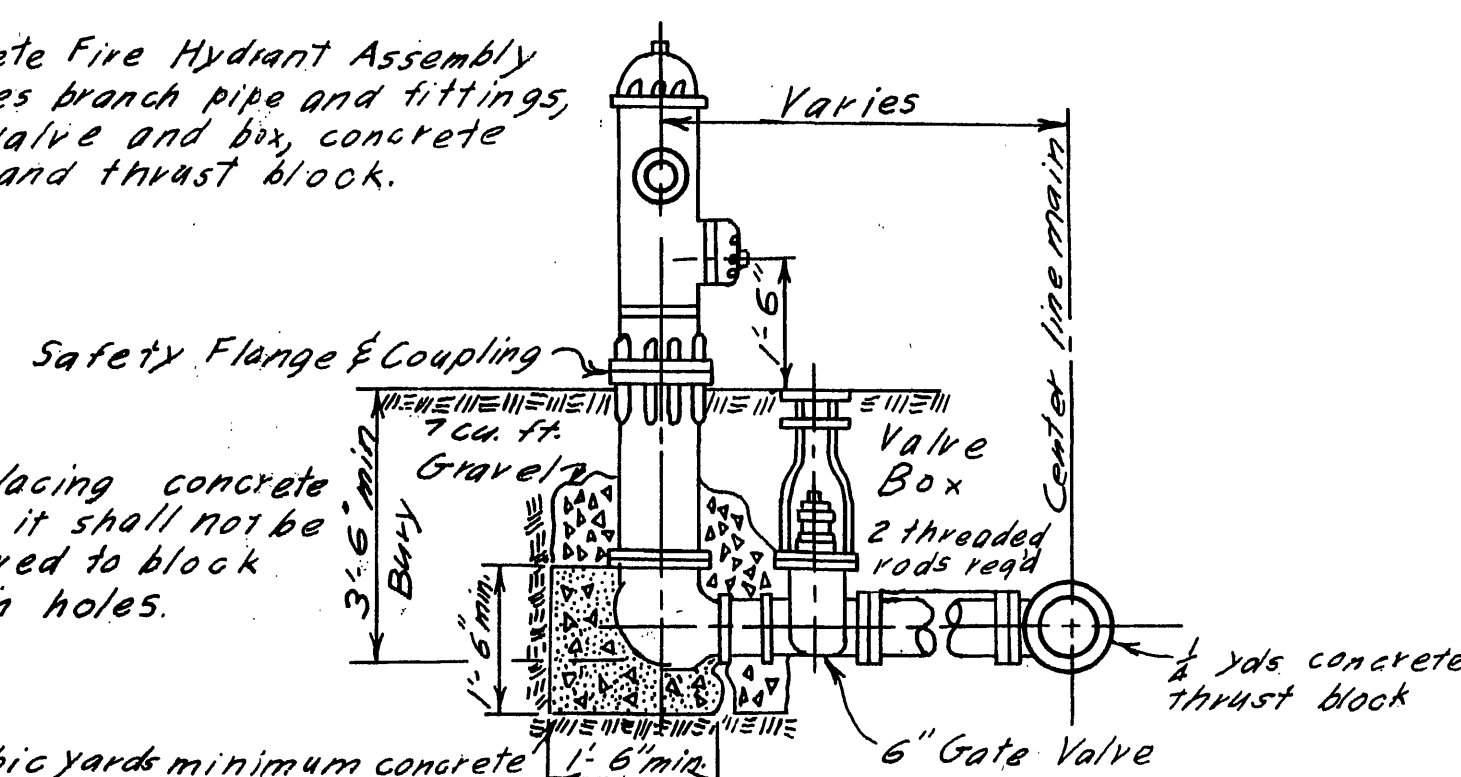


FIRE HYDRANT ASSEMBLY

Not to Scale

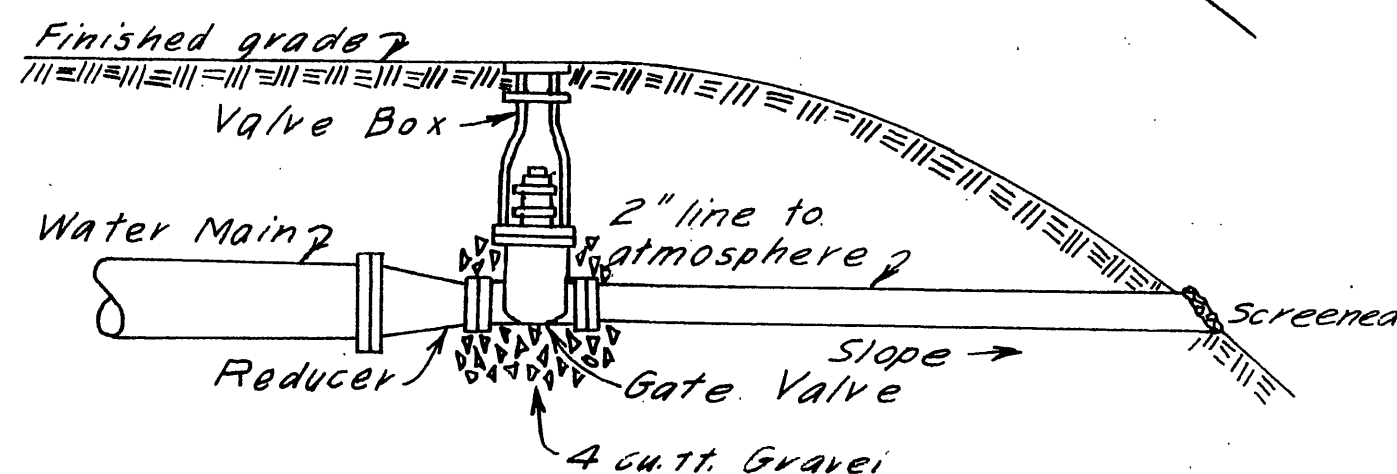

BLOWOFF

Not to Scale

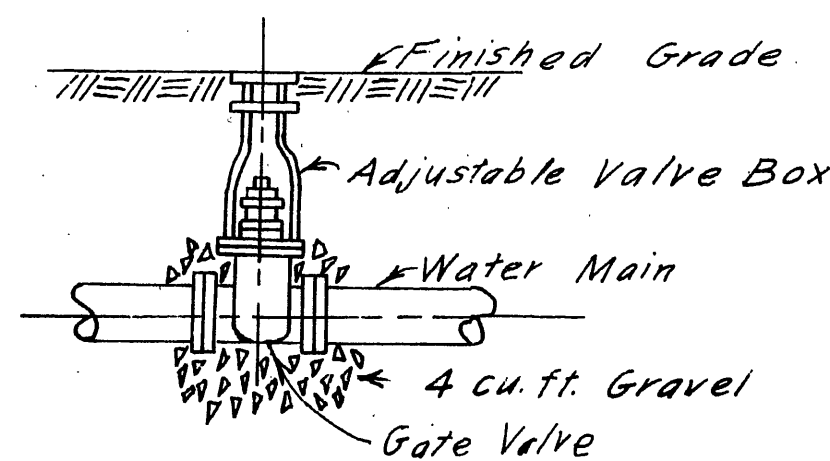

VALVE INSTALLATION

Not to Scale

WATER SYSTEM
to serve
WATER FRONT SECTION 4
owned by
BREMBLE PROPERTIES, INC.
GILLS CREEK MAG. DIST.
FRANKLIN COUNTY, VIRGINIA

Prepared by:
William L. Law, Civil Engineer, Va. Cert. No. 1296
Box 420, Route 1, Bassett, Virginia 24055
April 21, 1981

Scale: 1 inch = 50 feet

