



- NOTES:
- 1) ALL WATER SYSTEM CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE VIRGINIA DEPARTMENT OF HEALTH WATERWORKS REGULATIONS.
 - 2) ALL PIPING SHALL BE DISINFECTED IN ACCORDANCE WITH AWWA STANDARDS.
 - 3) THE WELL PUMP SHALL BE CONTROLLED BY PRESSURE SWITCHES WITH TIME DELAY.
 - 4) AN IDLER PIPE FOR THE WATER METER SHALL BE STORED IN THE WELL HOUSE.

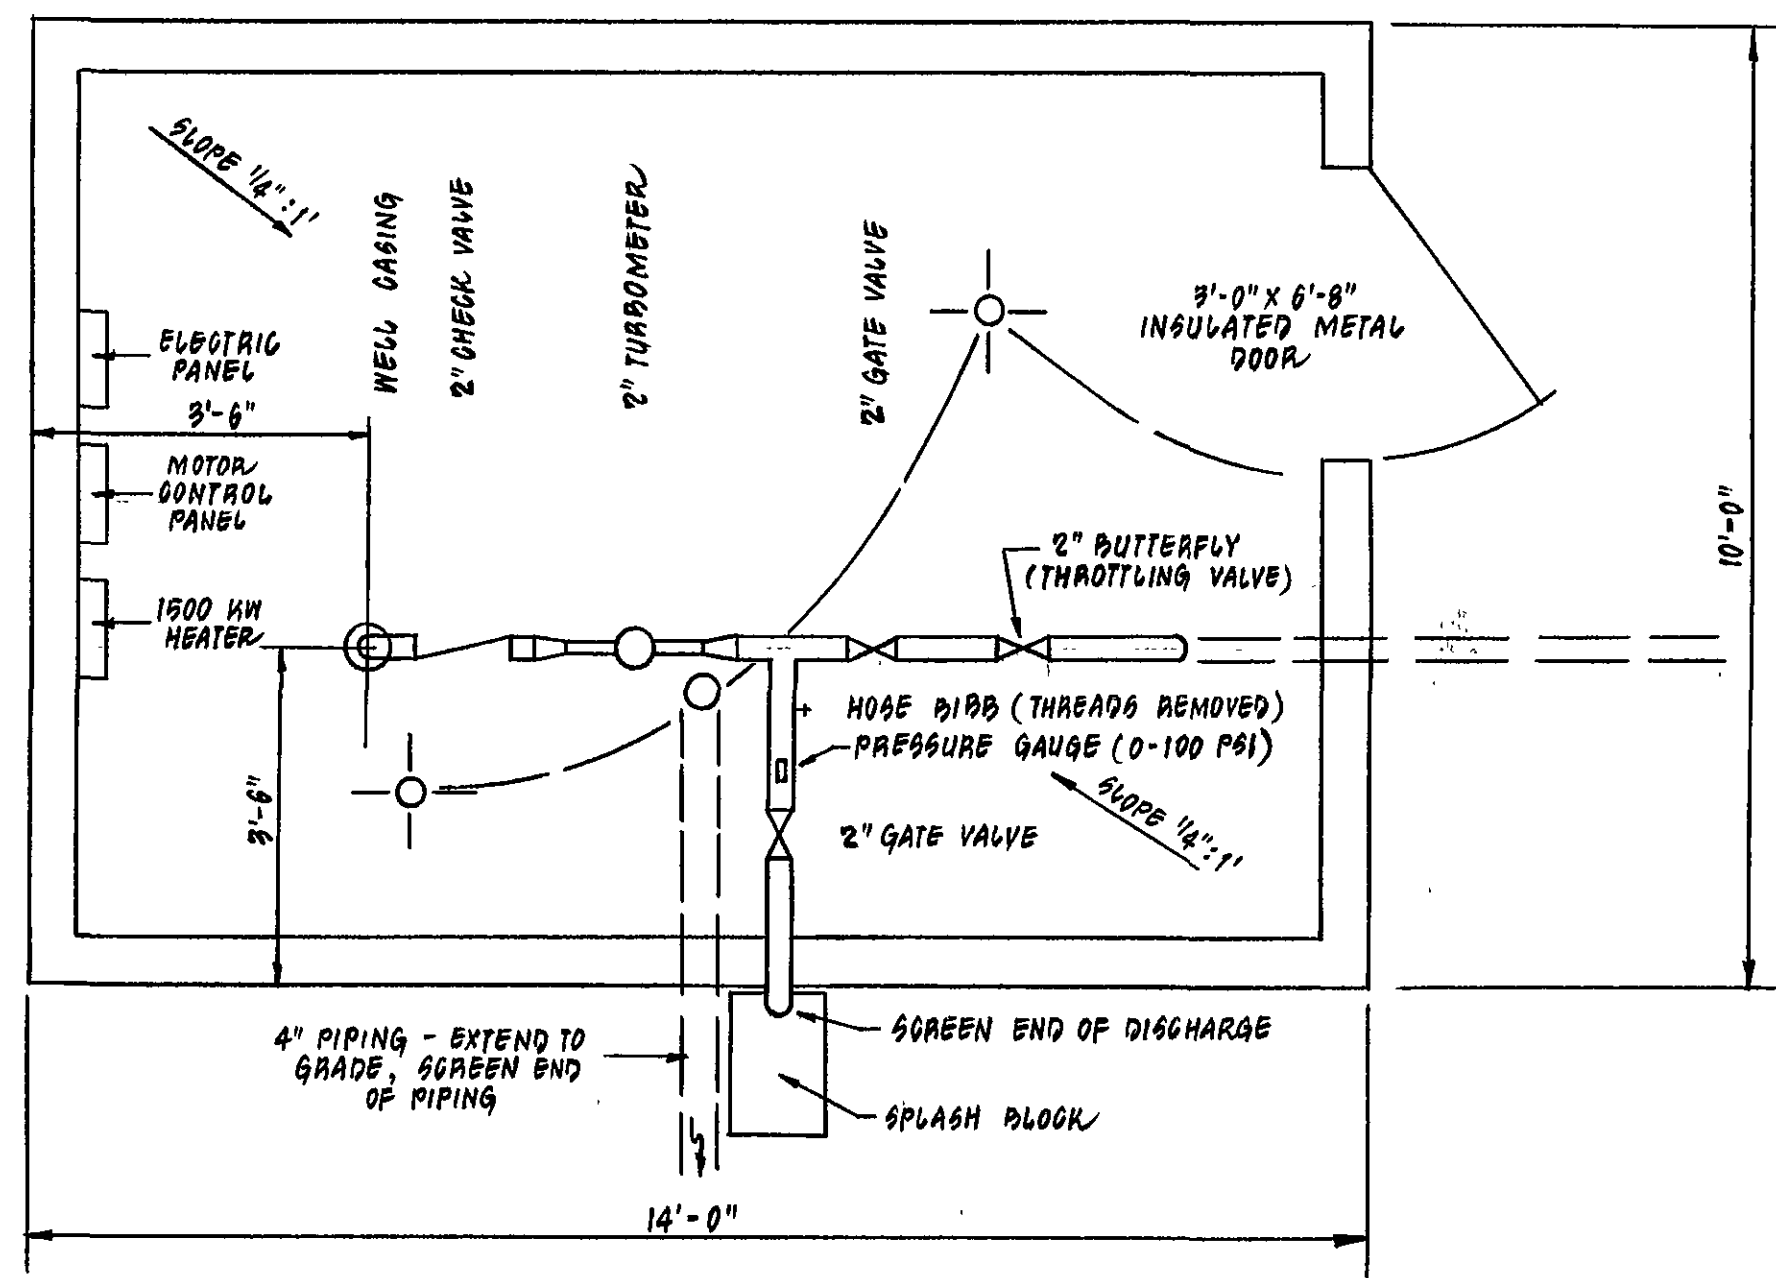


PLAN OF WELL HOUSE No. 7

SCALE: 1/2" = 1'-0"

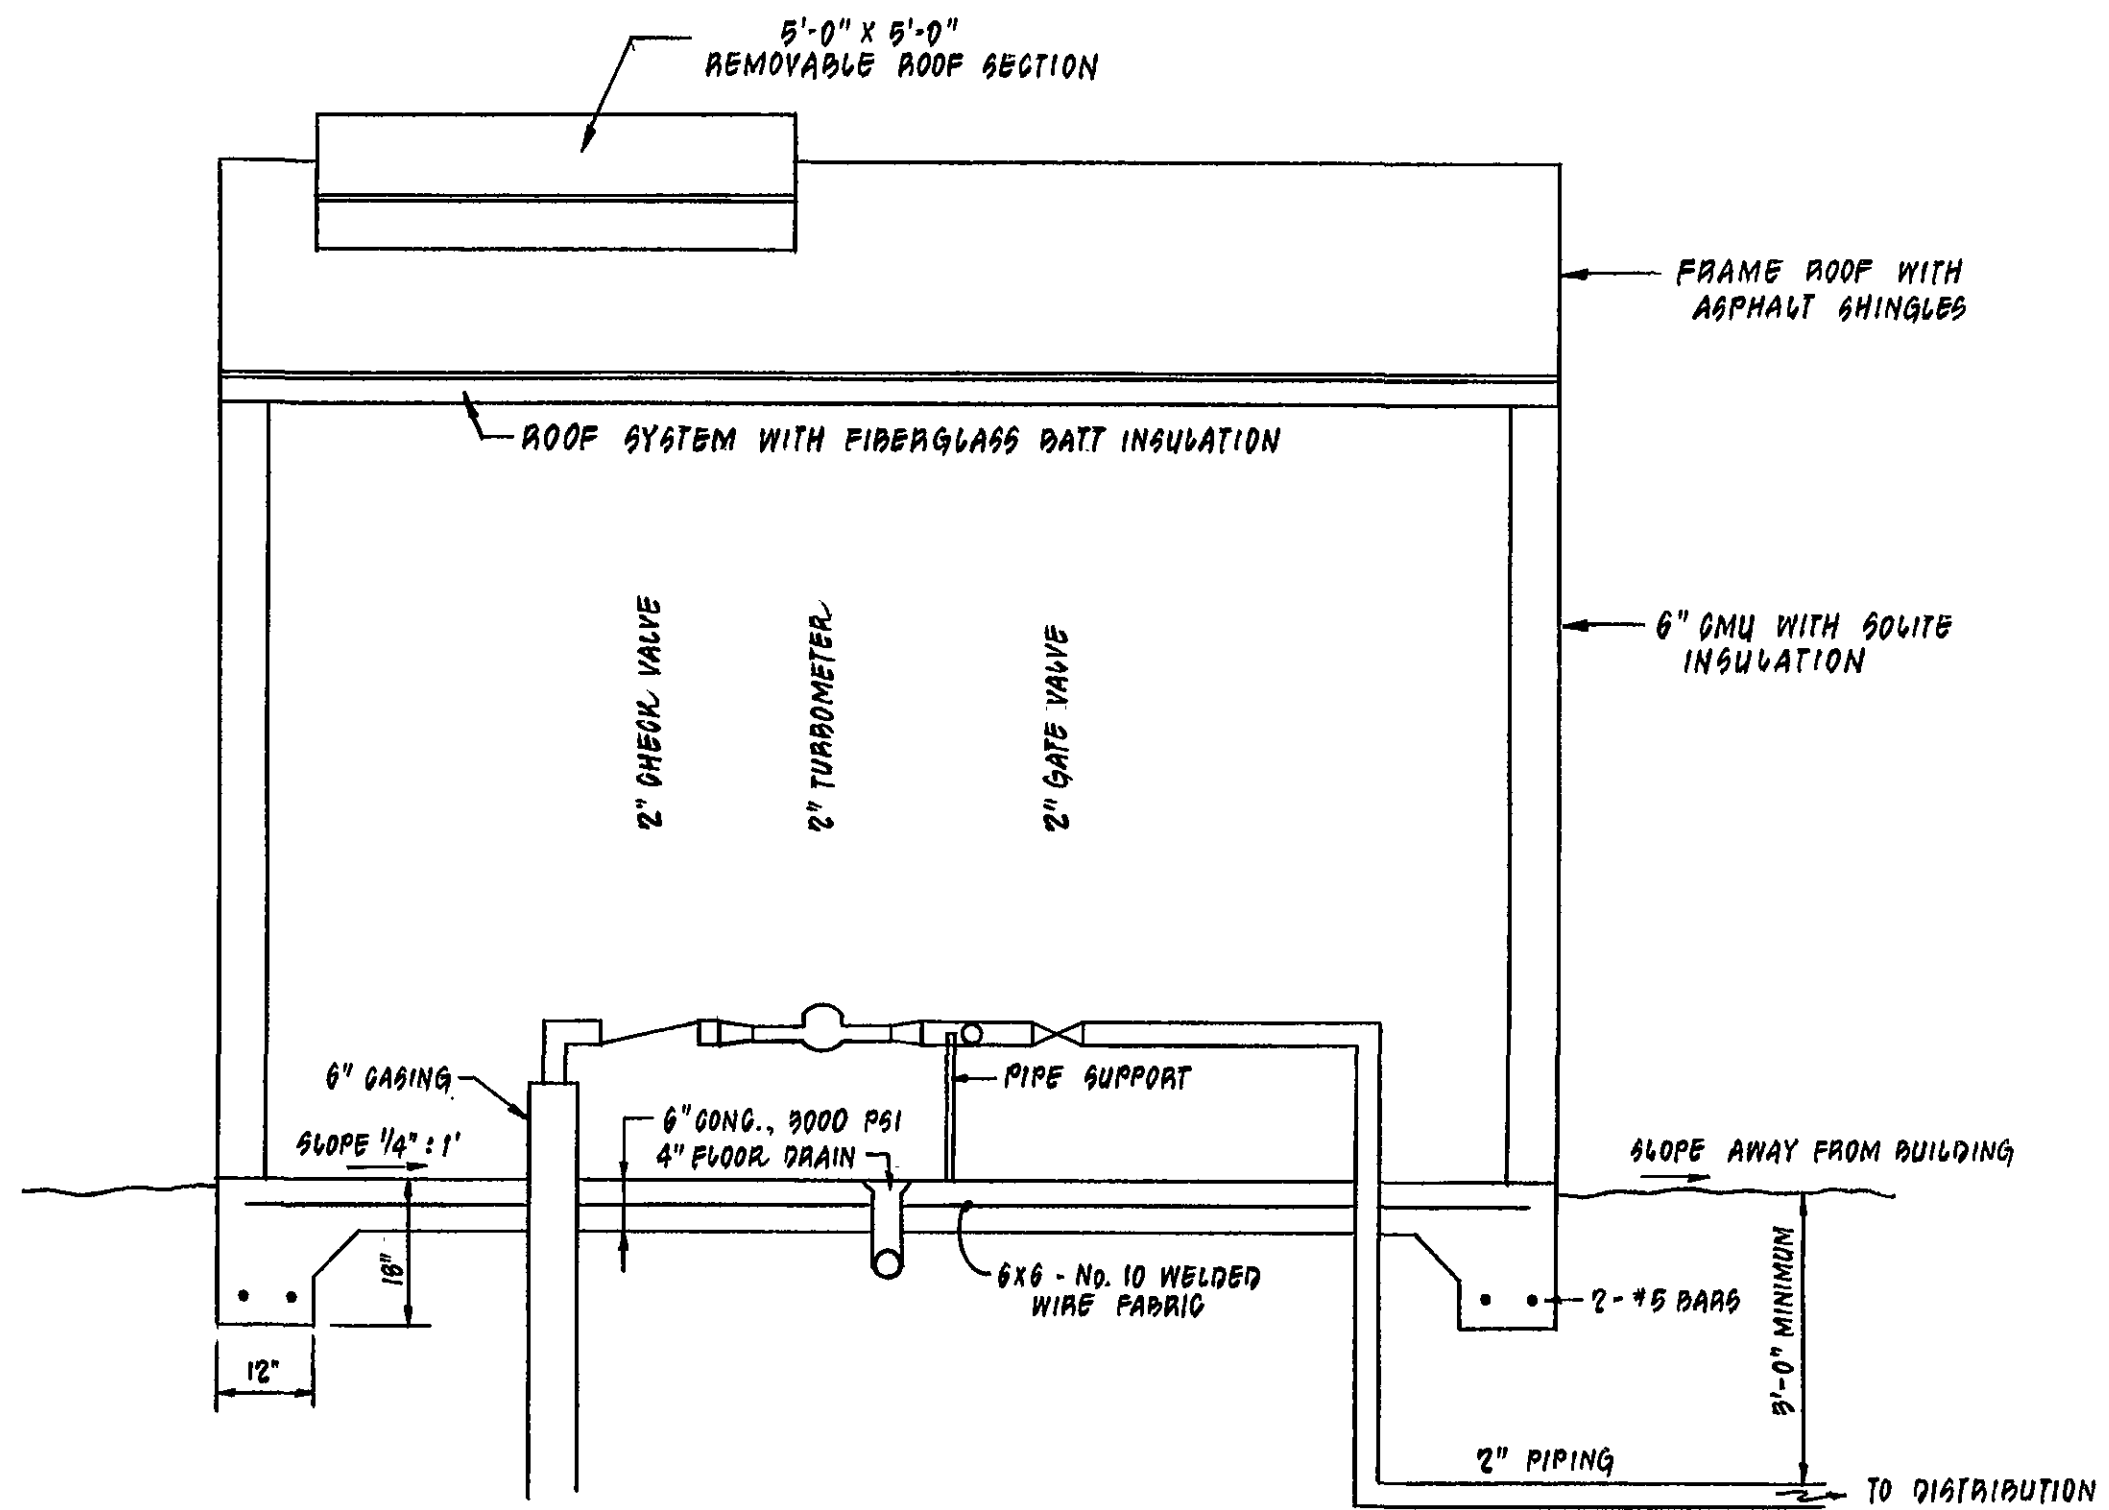

CROSS-SECTION OF WELL HOUSE No. 7


SCALE: 1/2" = 1'-0"

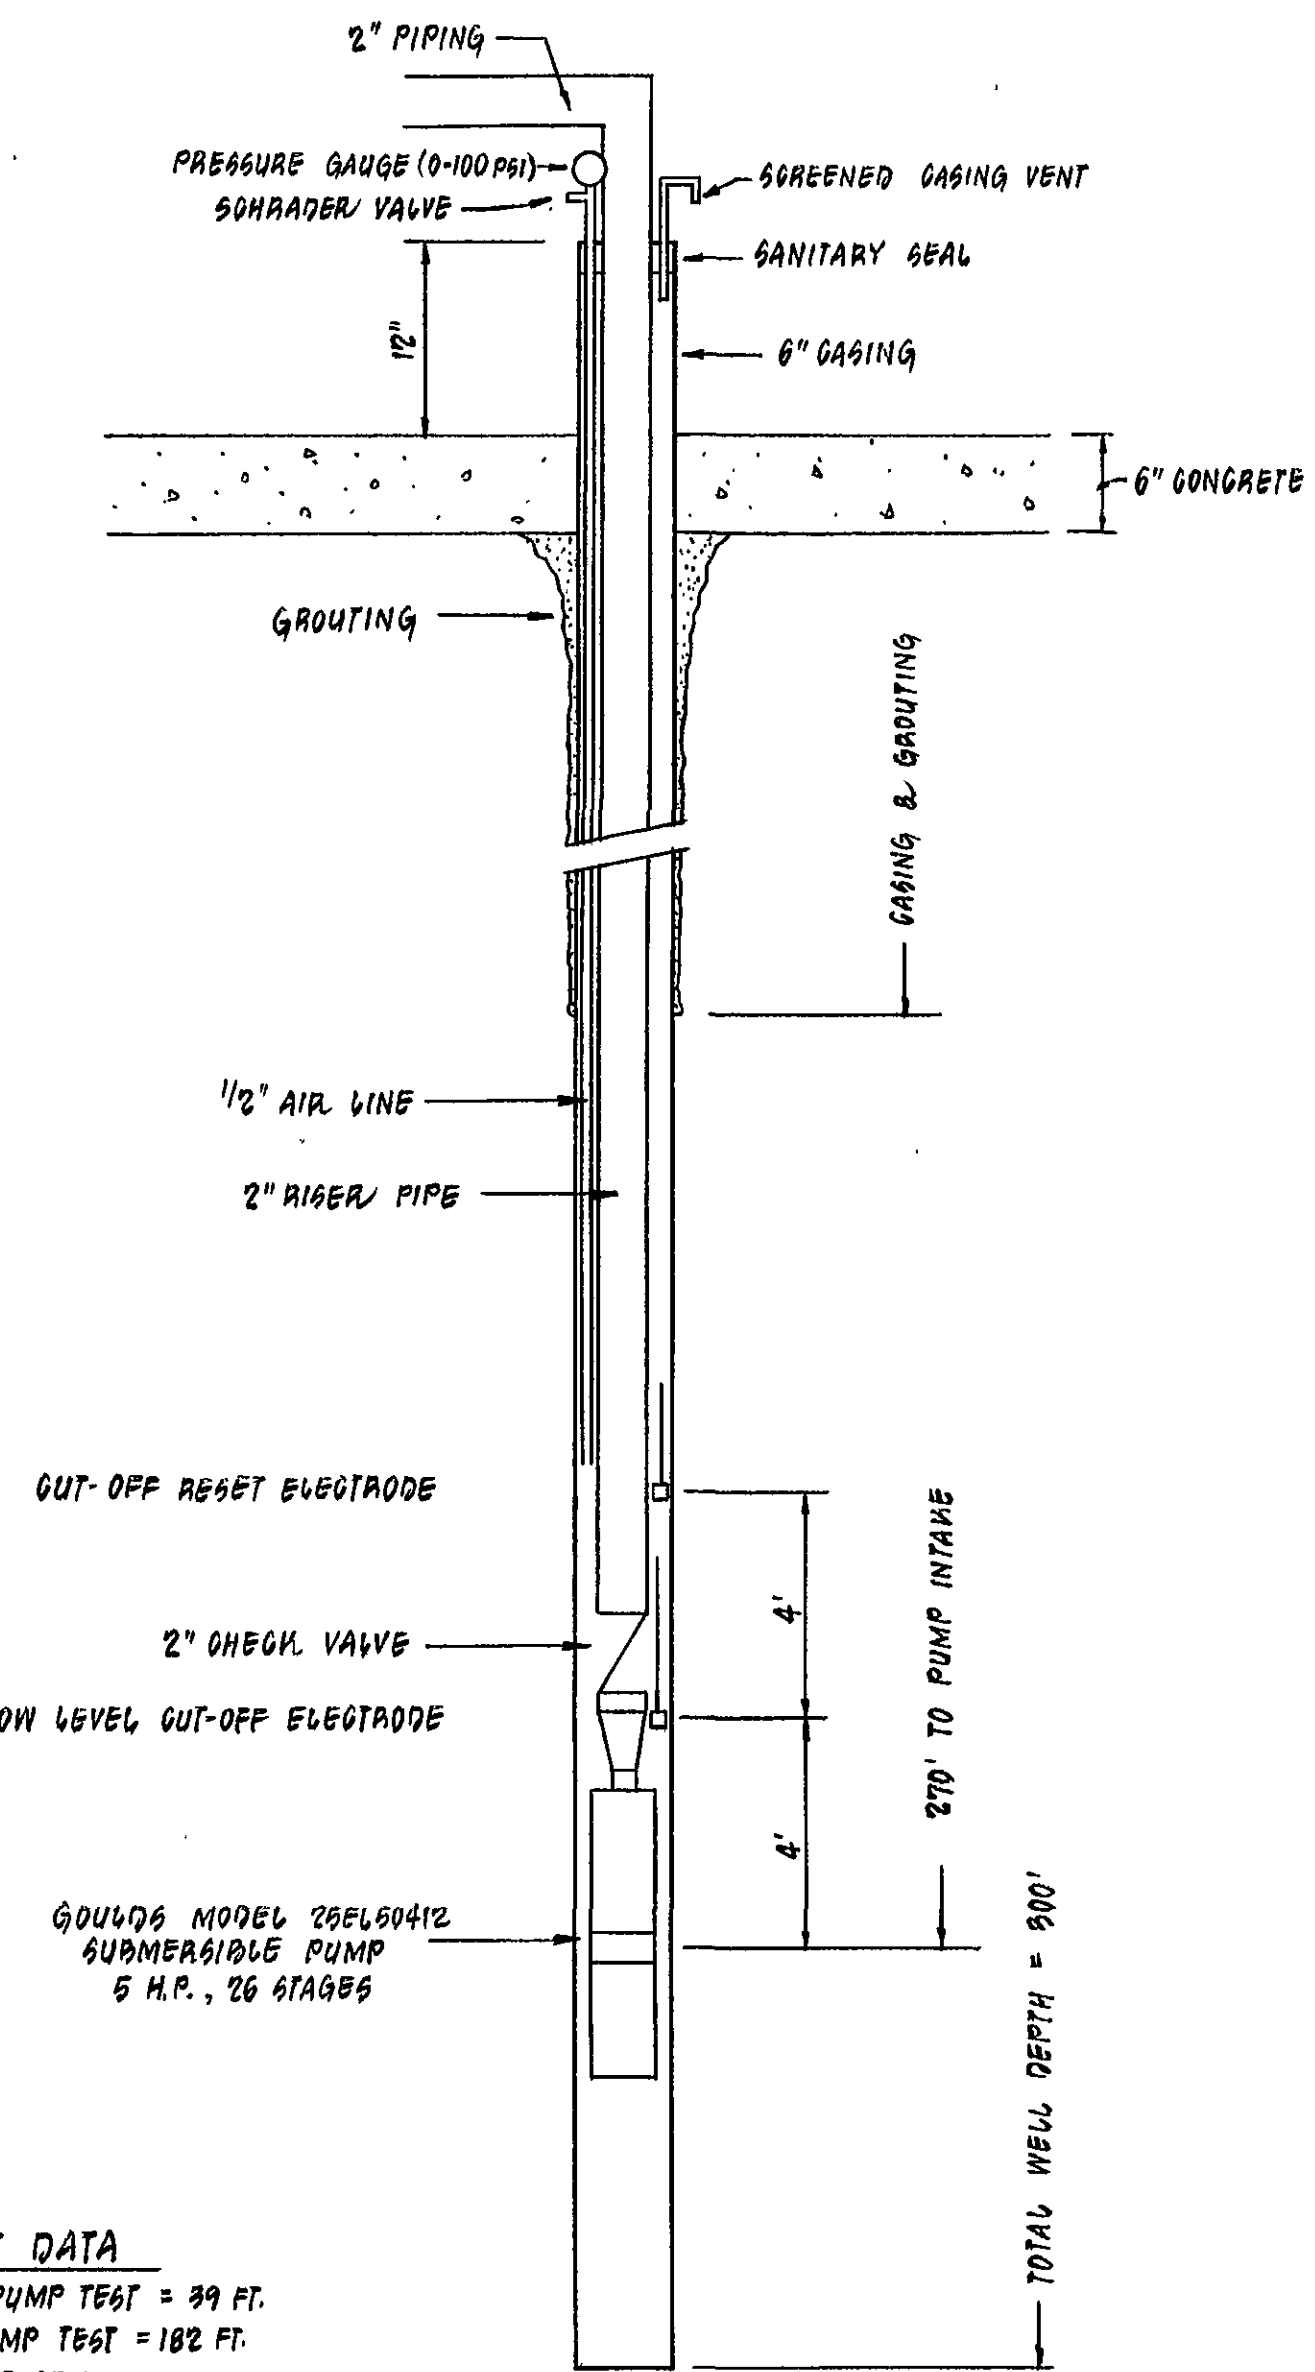

WELL SCHEMATIC

NO SCALE

WELL PUMP TEST DATA
WATER/ DEPTH @ START OF PUMP TEST = 39 FT.
WATER/ DEPTH @ END OF PUMP TEST = 182 FT.
PUMP TEST WELL YIELD = 85 GPM

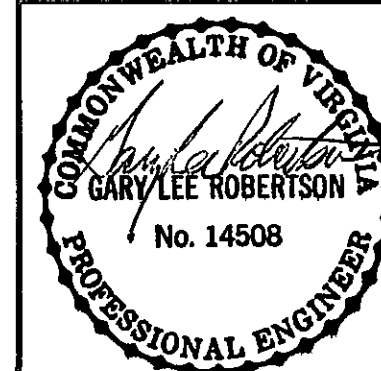

REVISION	DATE	DESCRIPTION
DESIGNED	M&W	WELL No. 7 DETAIL DRAWINGS FOR SECTION No. 11 "THE WATERFRONT"
DRAWN	RAC	PREPARED FOR WATERFRONT WATER WORKS, INC.
CHECKED	GJR	GILL CREEK MAGISTERIAL DISTRICT FRANKLIN COUNTY, VIRGINIA
LUMSDEN ASSOCIATES, P.C. ENGINEERS-SURVEYORS-PLANNERS ROANOKE, VIRGINIA		SCALE: AS SHOWN DATE: 29 OCT. 1992 COMM: *82-942-8 SHEET 4 of 9