
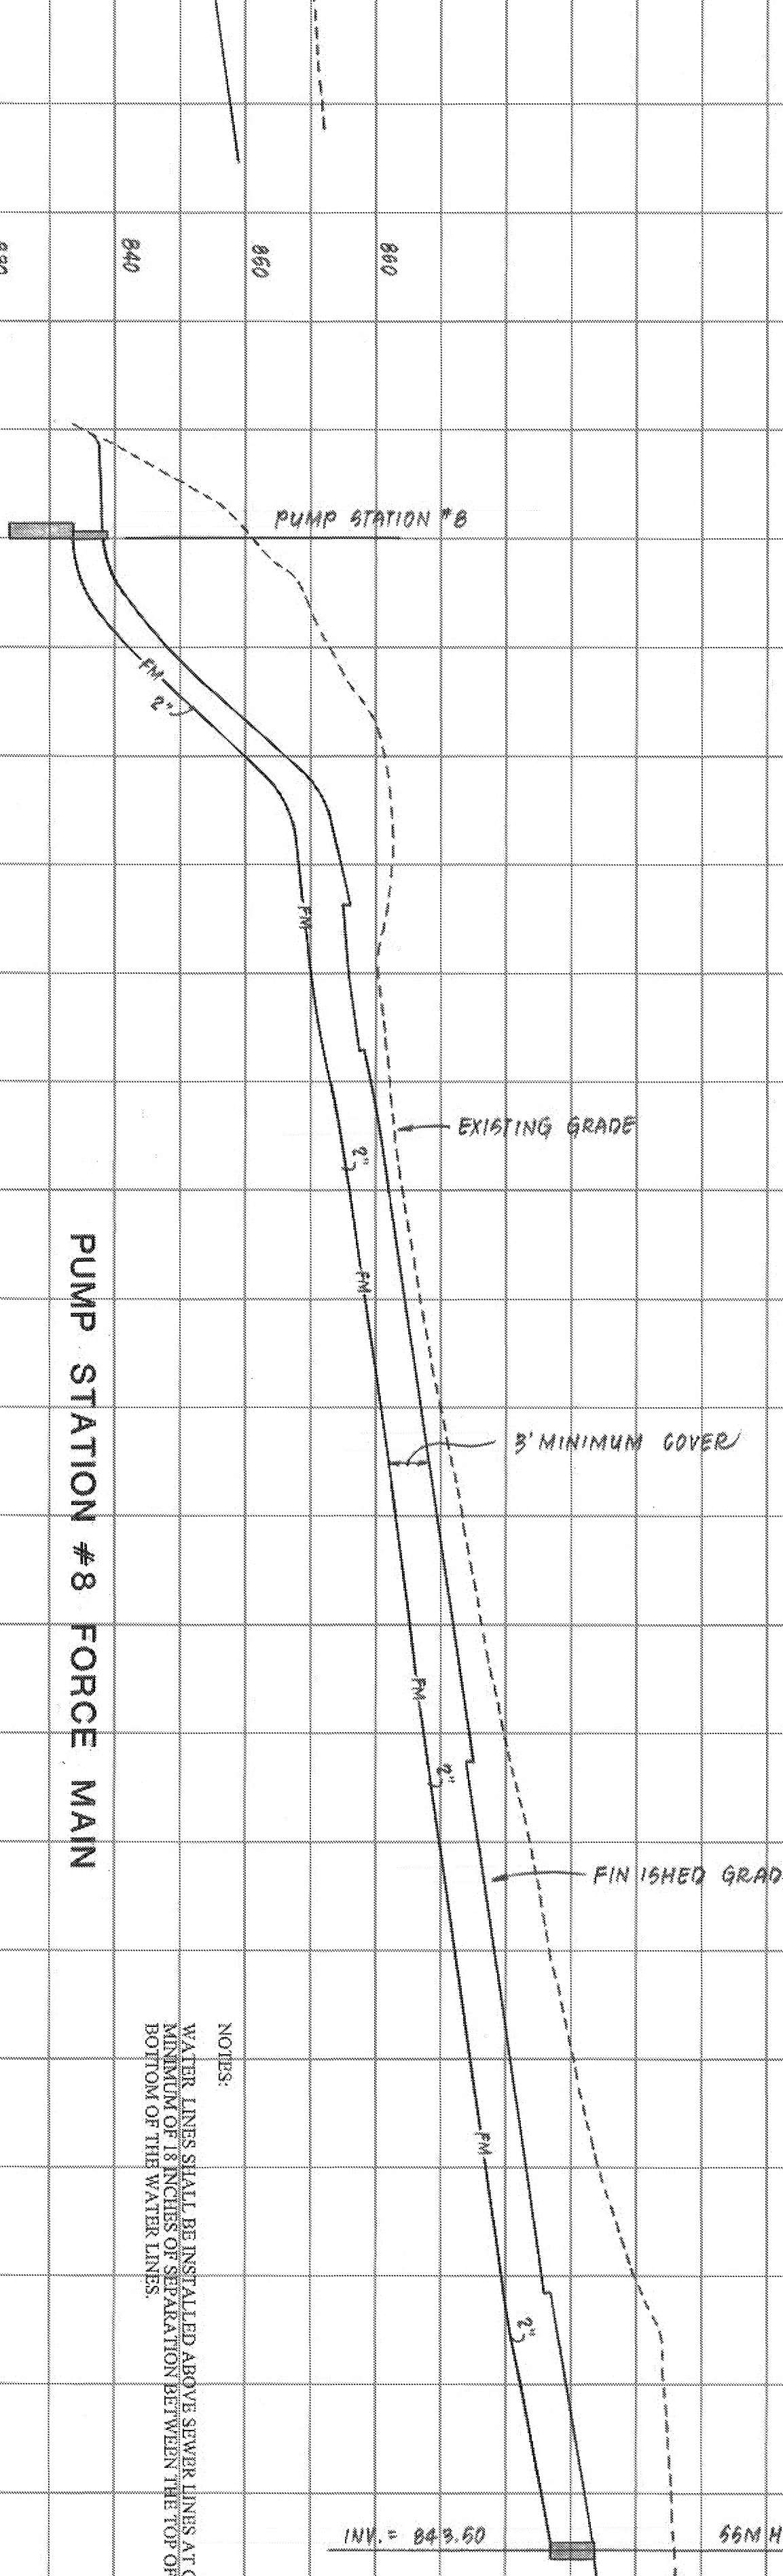
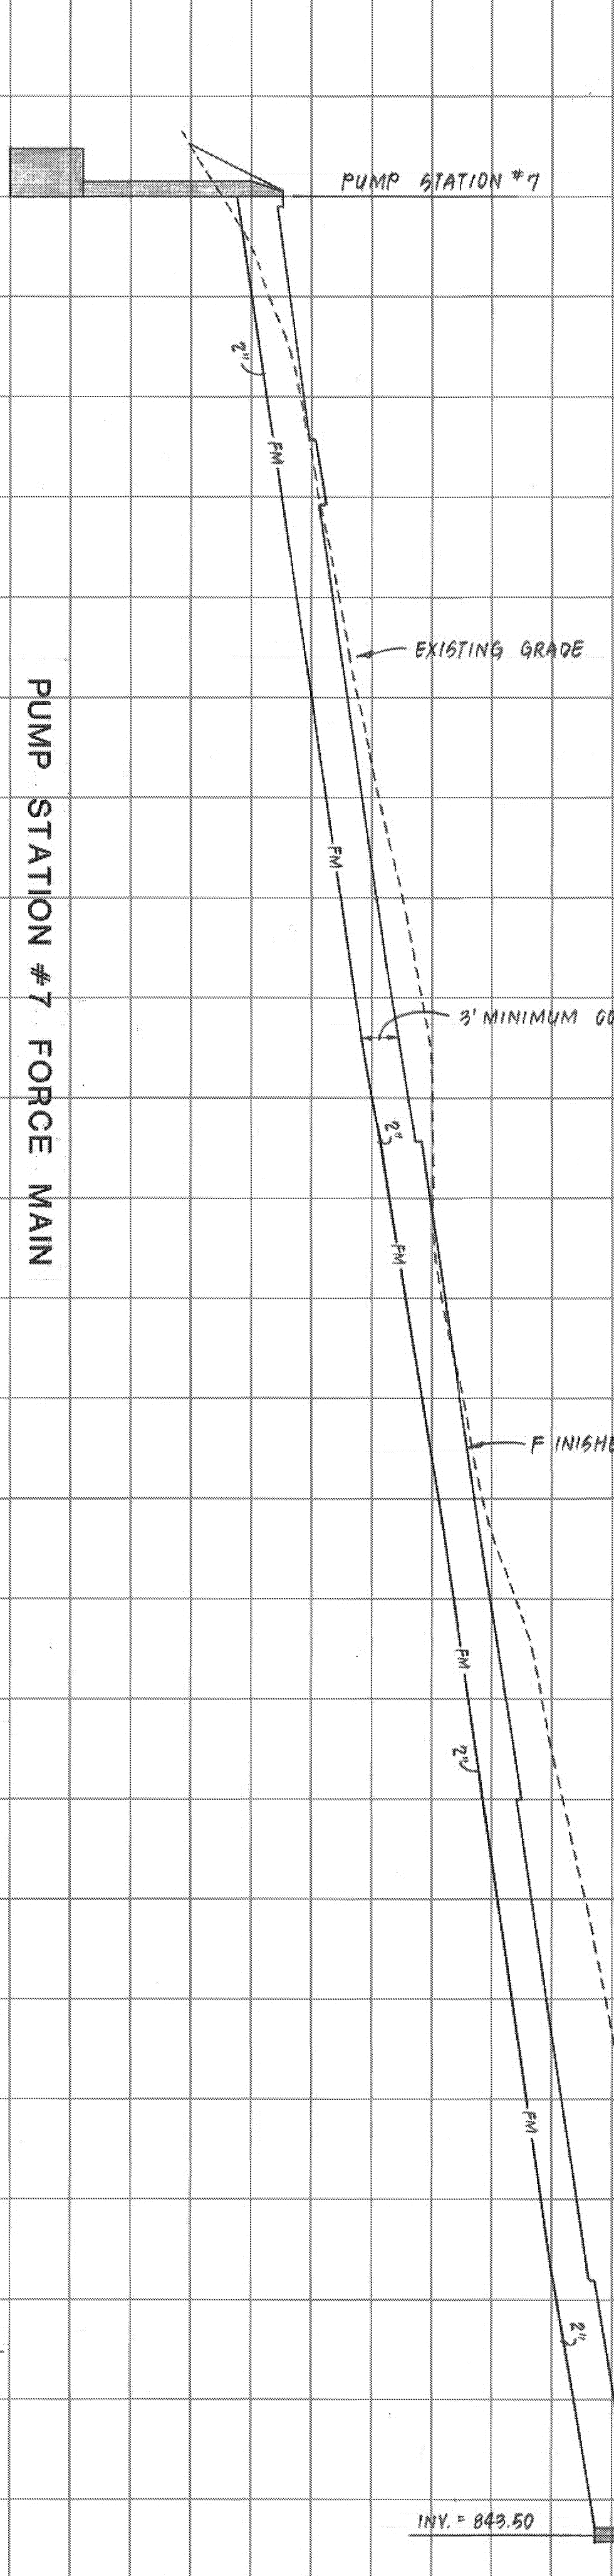
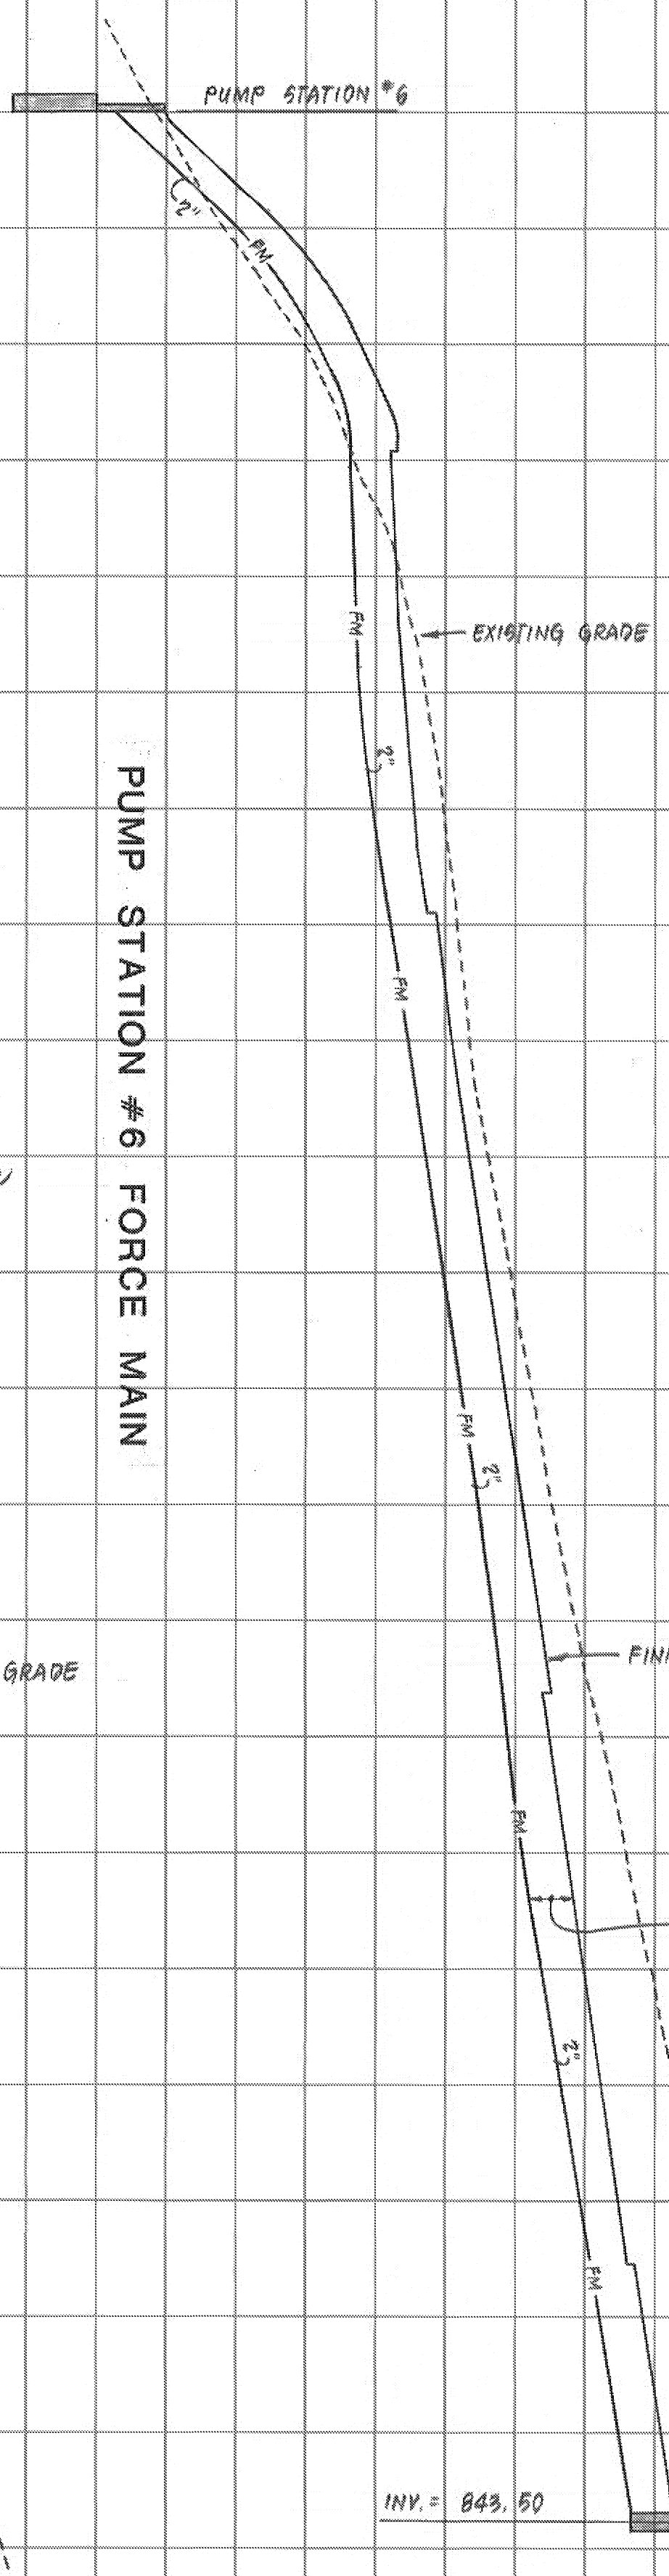
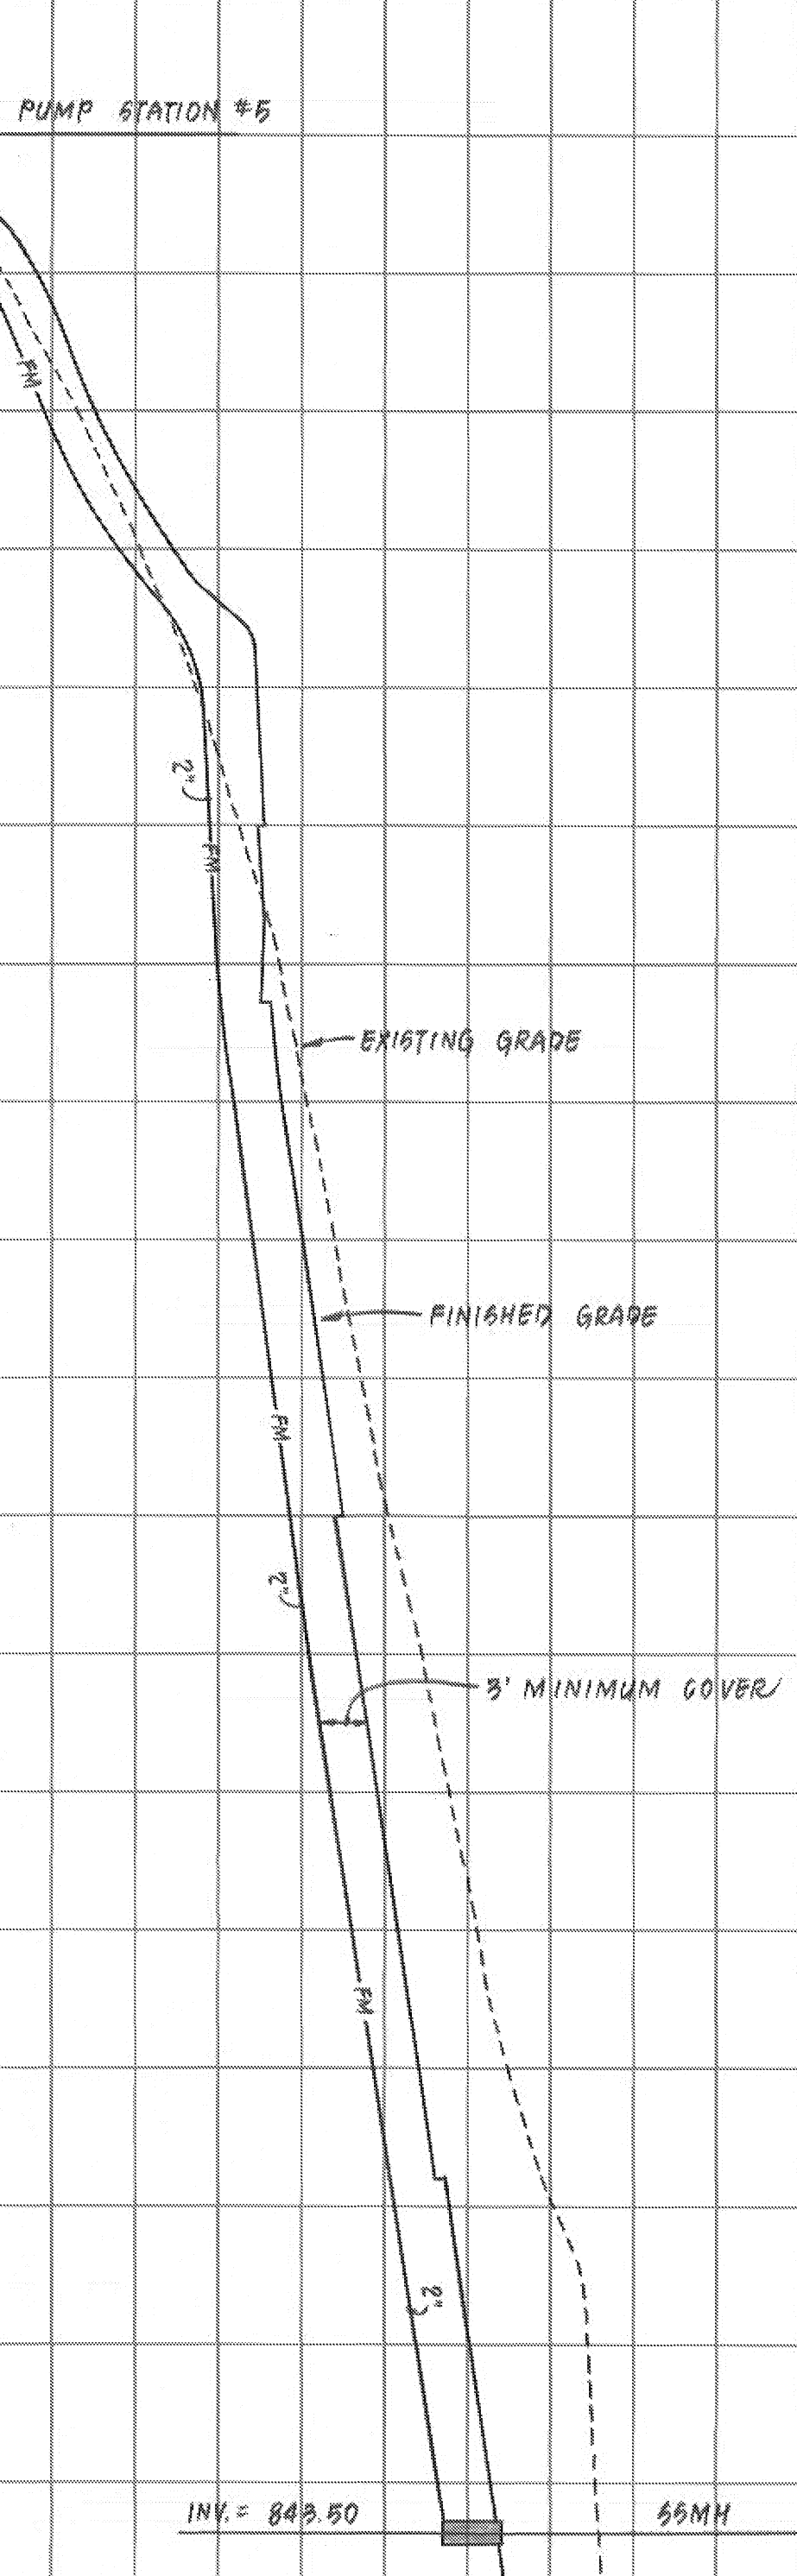
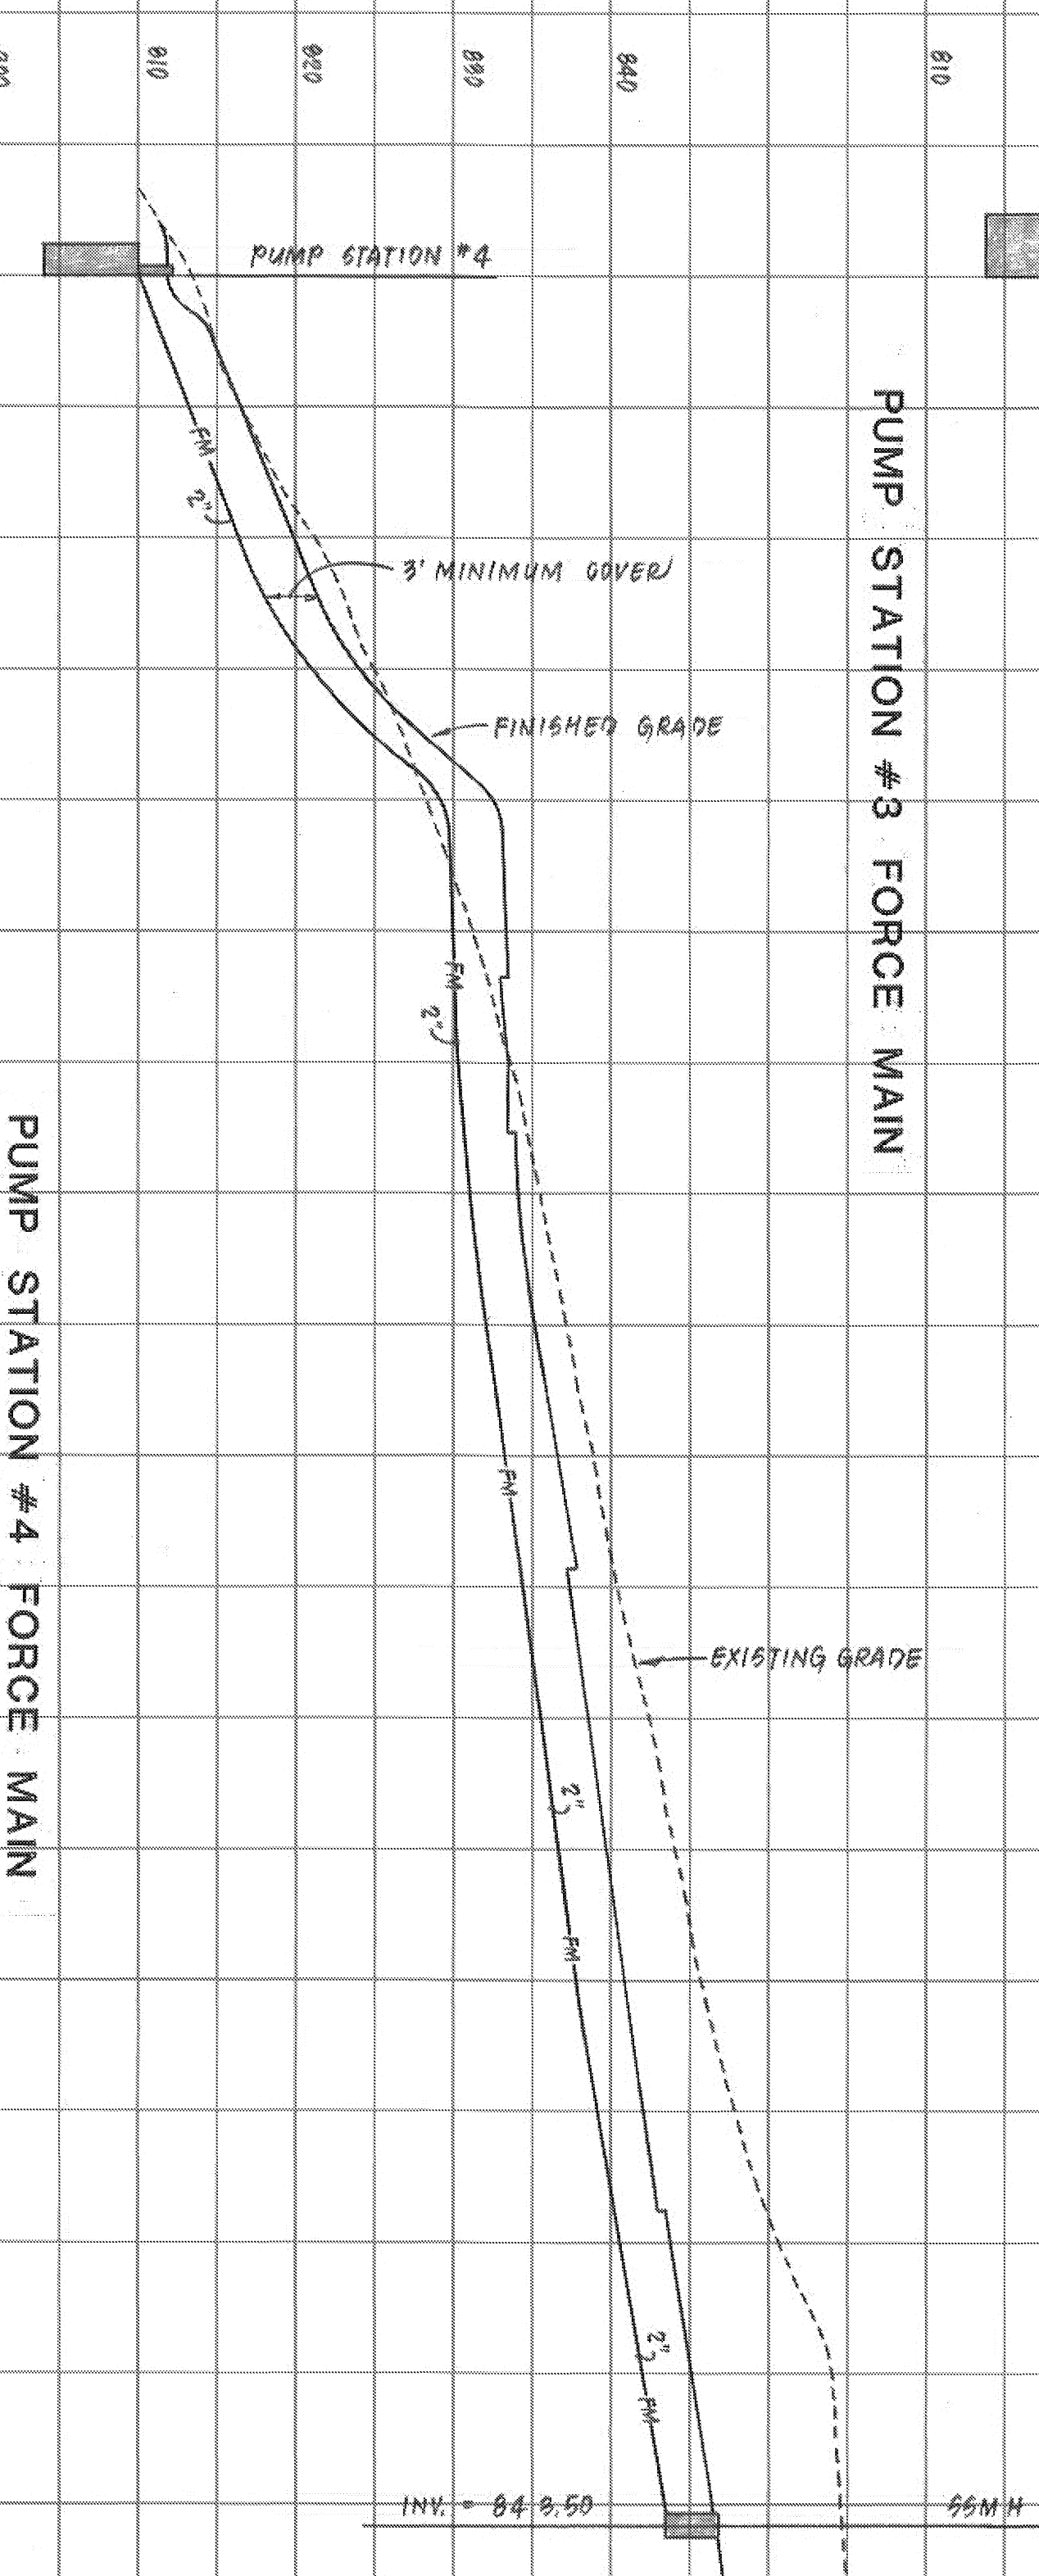
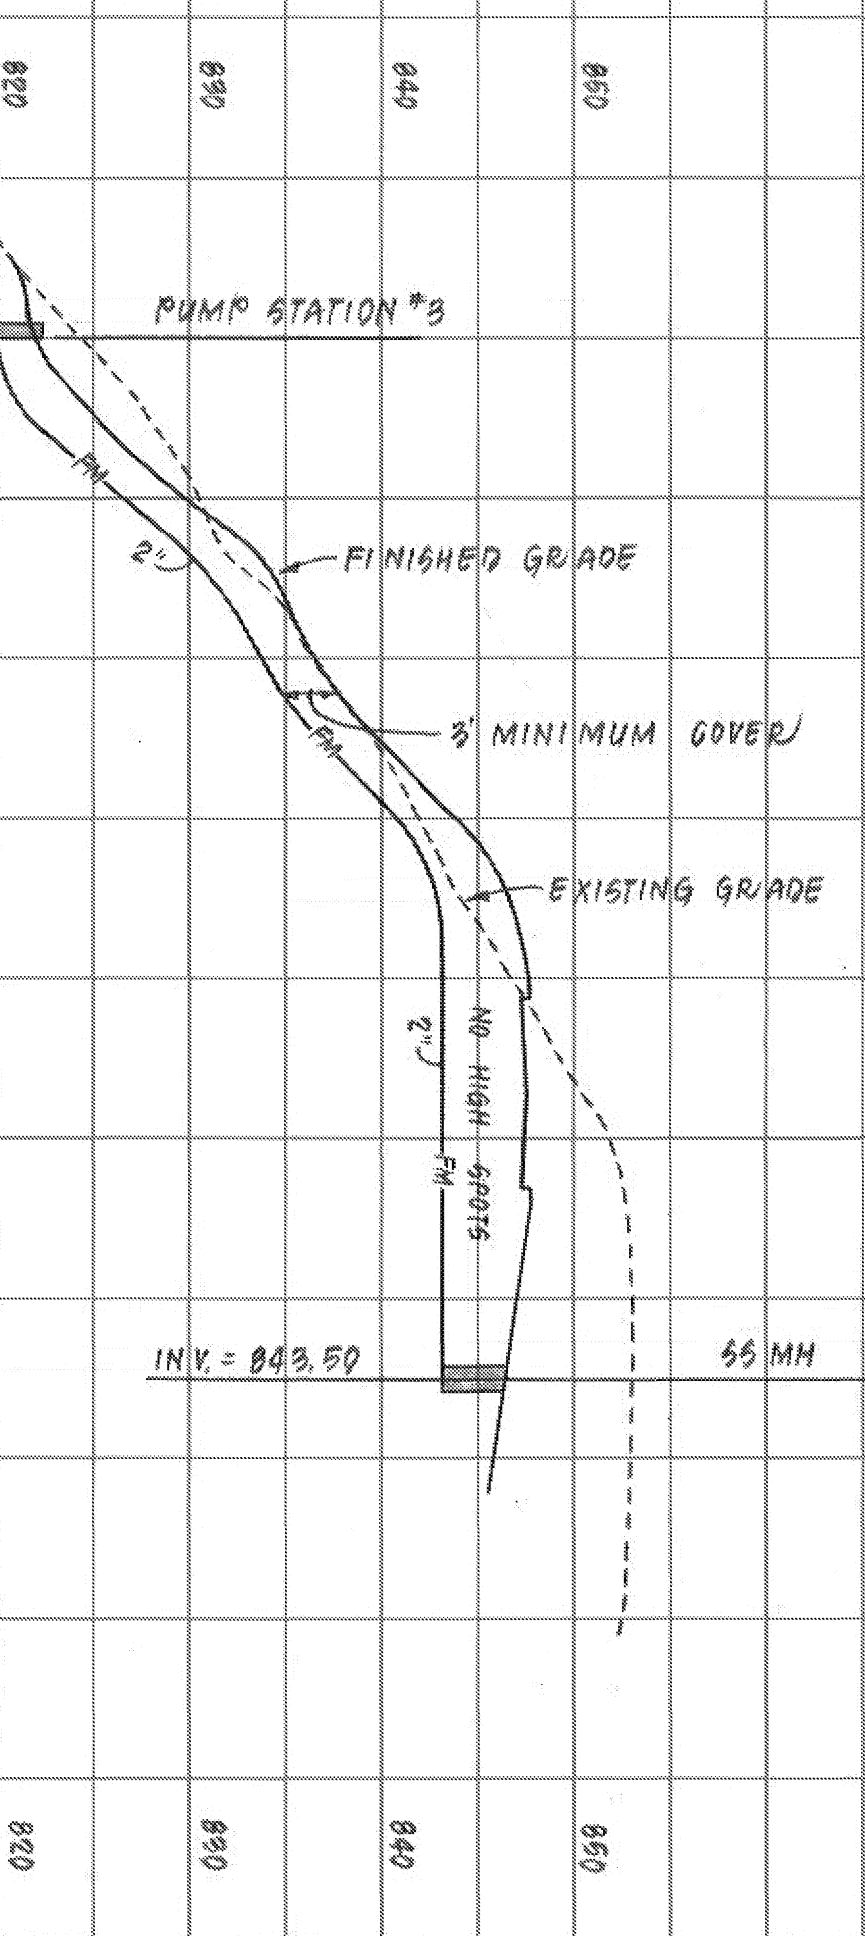
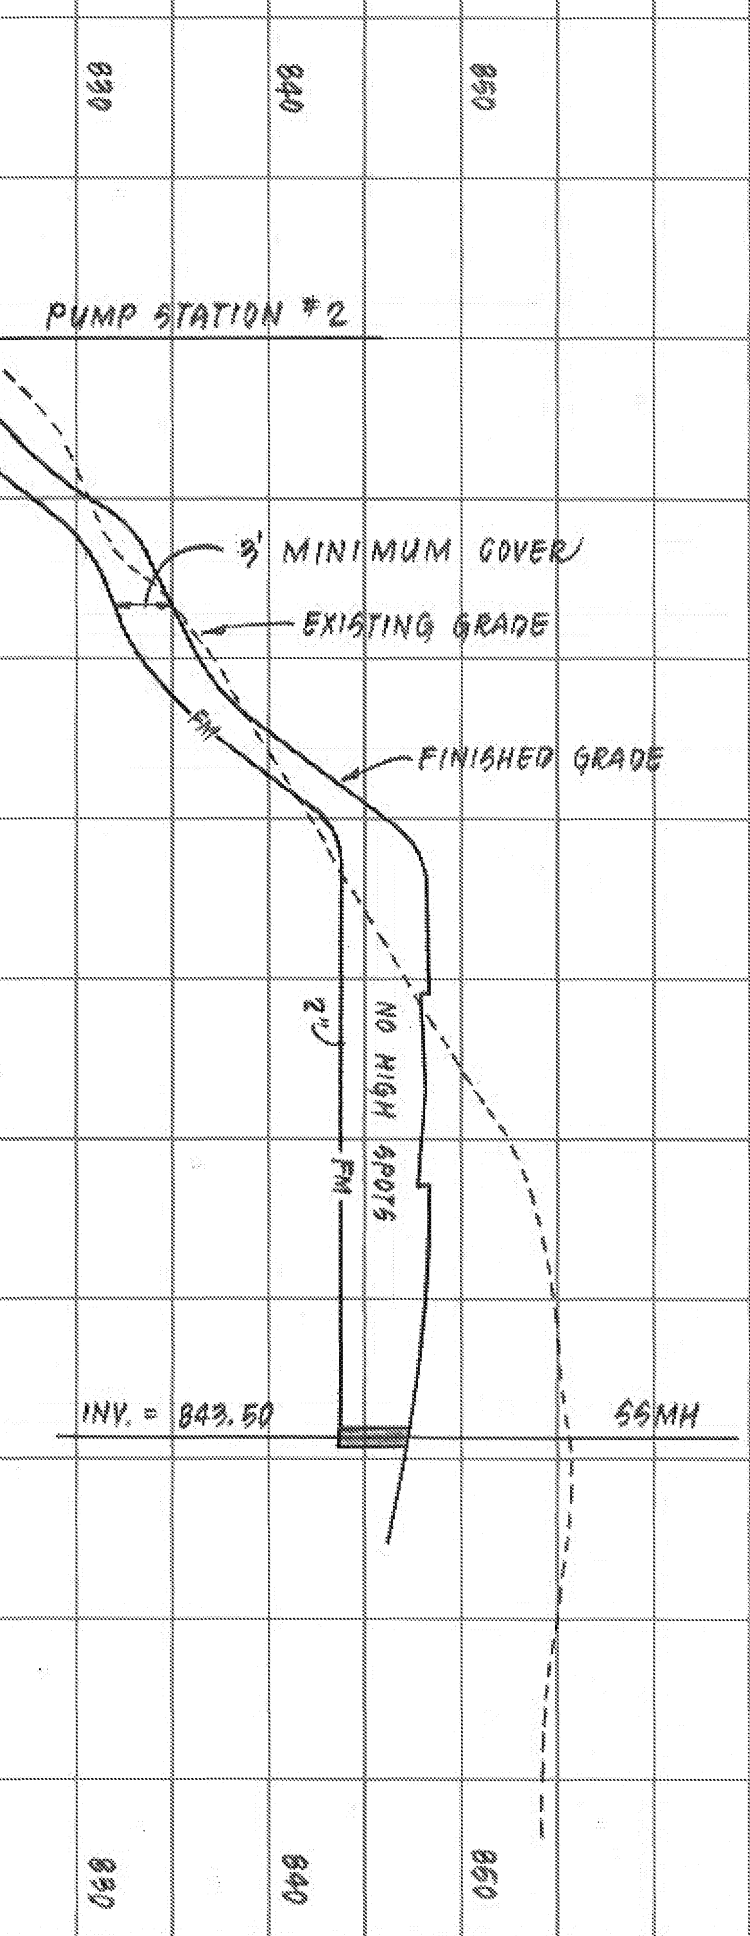


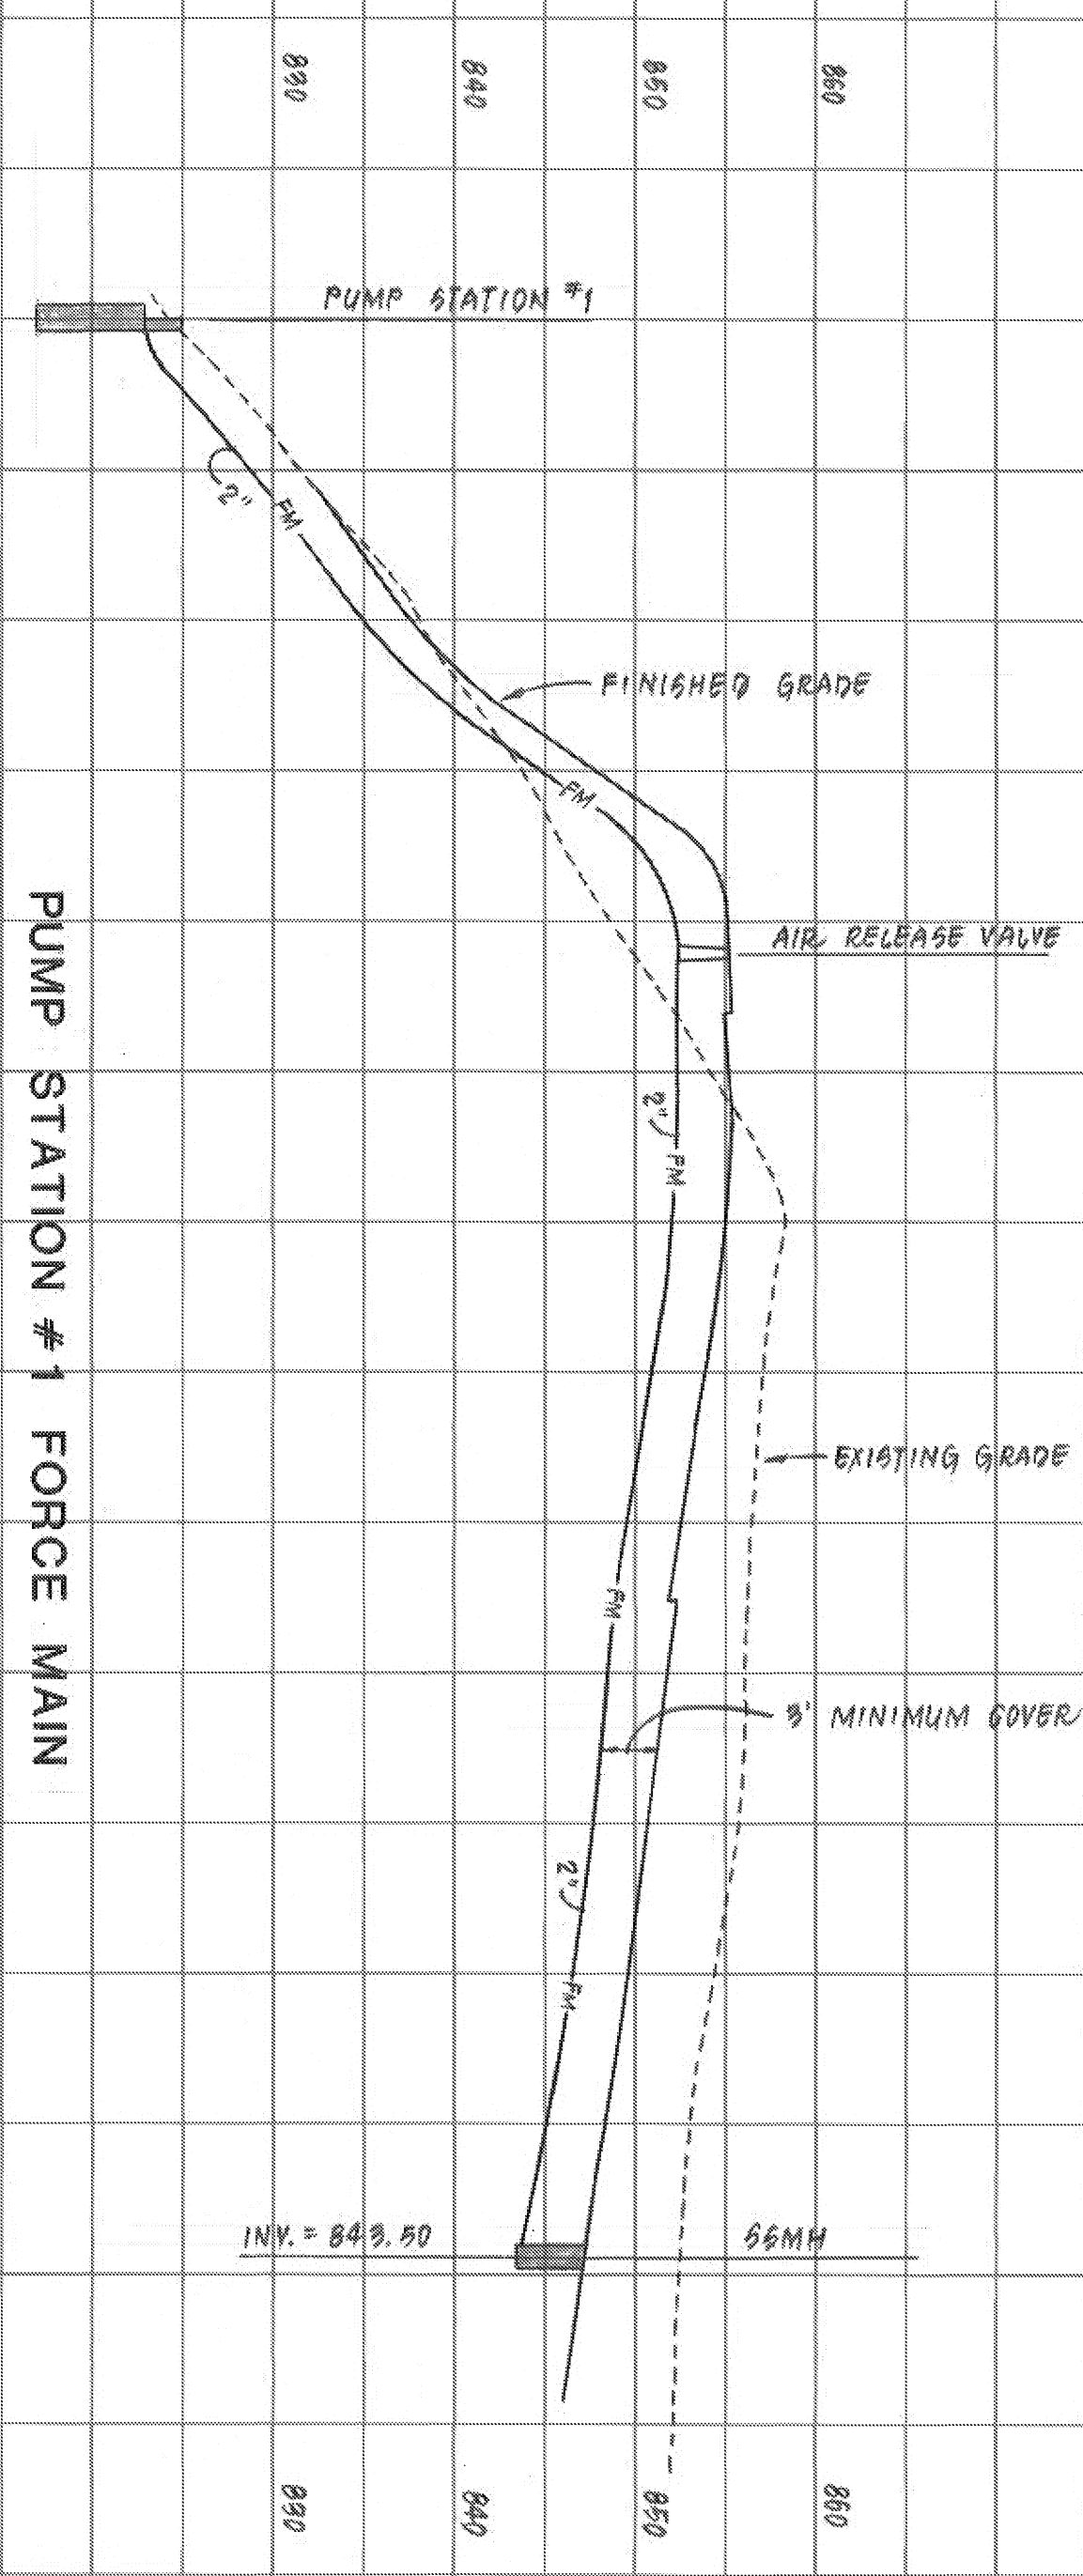

NOTES:
WATER LINES SHALL BE INSTALLED ABOVE SEWER LINES AT CROSSINGS. PROVIDE A MINIMUM OF 12" CLEARANCE BETWEEN THE TOP OF SEWER LINES AND THE BOTTOM OF THE WATER LINES.

LUMSDEN ASSOCIATES, P.C. ENGINEERS-SURVEYORS-PLANNERS ROANOKE, VIRGINIA		WESTLAKE PROPERTIES, INC. GILLS CREEK MAGISTERIAL DISTRICT FRANKLIN COUNTY, VIRGINIA	
DESIGNED	DAW	DATE	14 SEP 1990
DRAWN	EAO	DATE	14 SEP 1990
CHECKED	MAM	DATE	14 SEP 1990

FORCE MAIN PROFILES
FOR
"WESTLAKE POINTE"
PREPARED FOR
WESTLAKE PROPERTIES, INC.
GILLS CREEK MAGISTERIAL DISTRICT
FRANKLIN COUNTY, VIRGINIA

SCALE: 1" = 10' HORIZ.
1" = 10' VERT.

DATE: 7 AUG 1993

SHEET 9 OF 13