

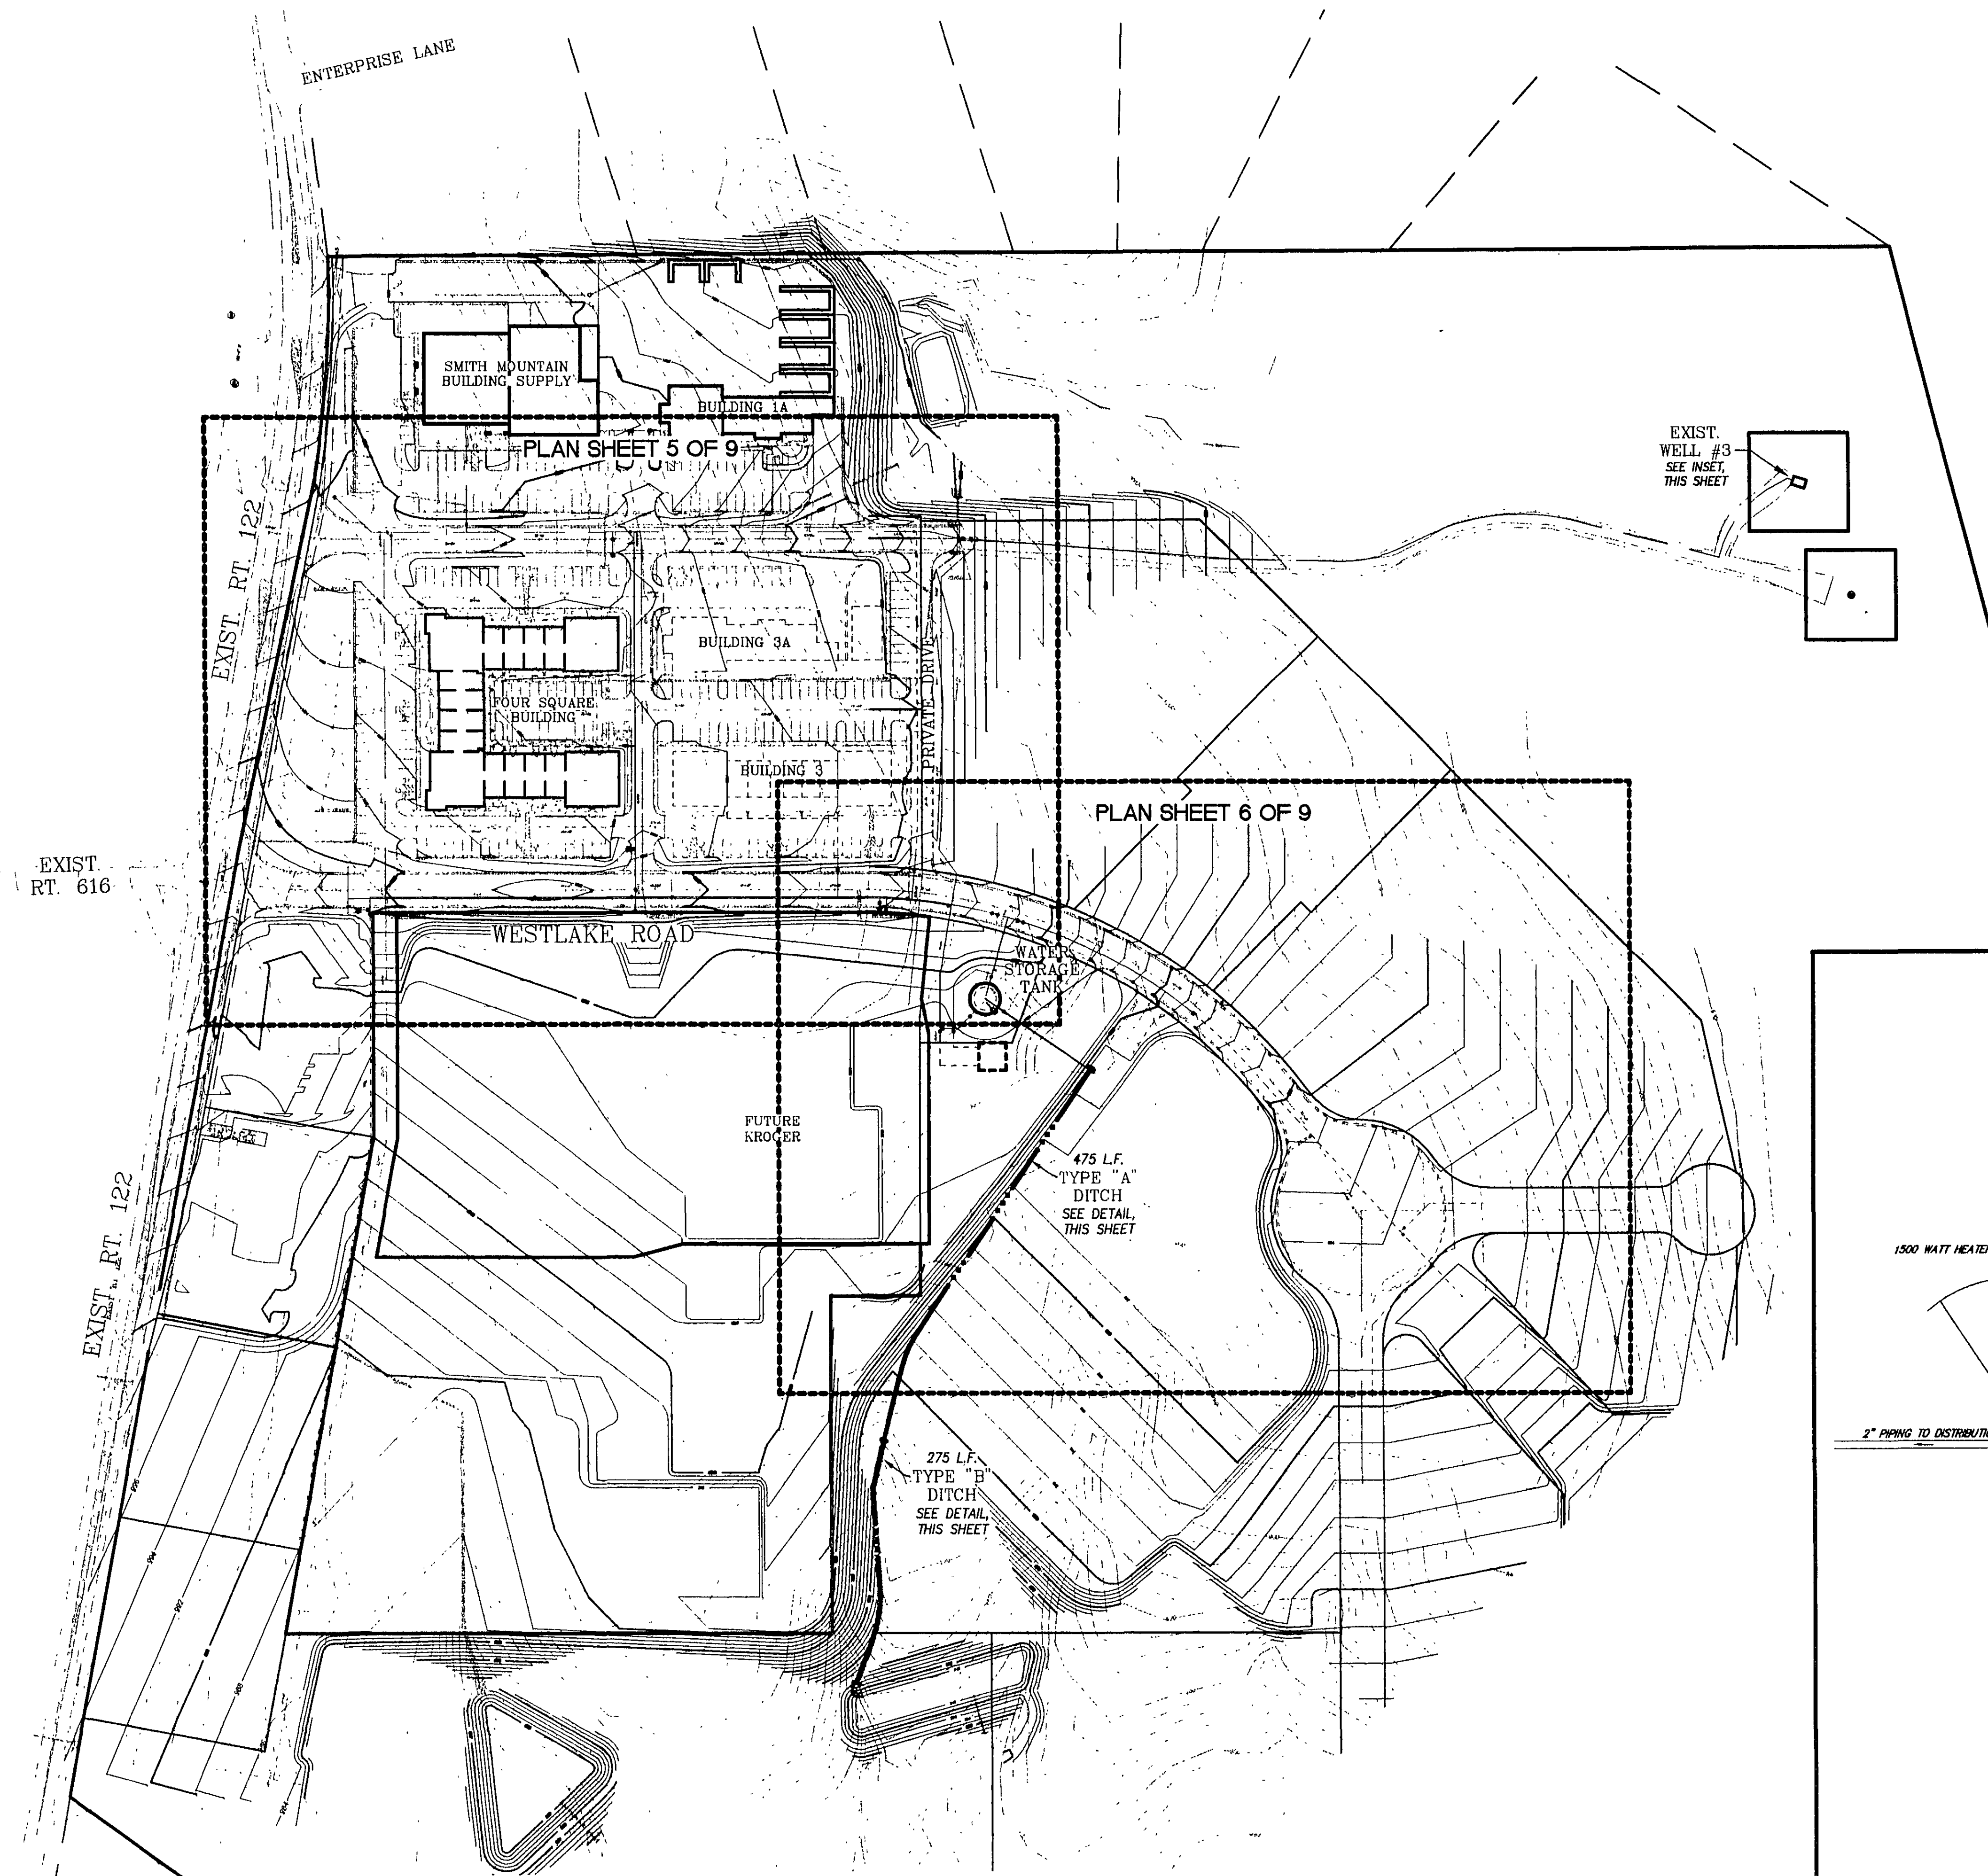


TYPE "A" DITCH
NO SCALE

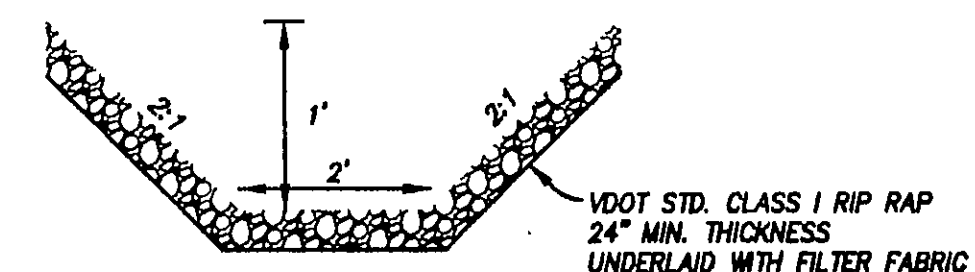

TYPE "B" DITCH
NO SCALE

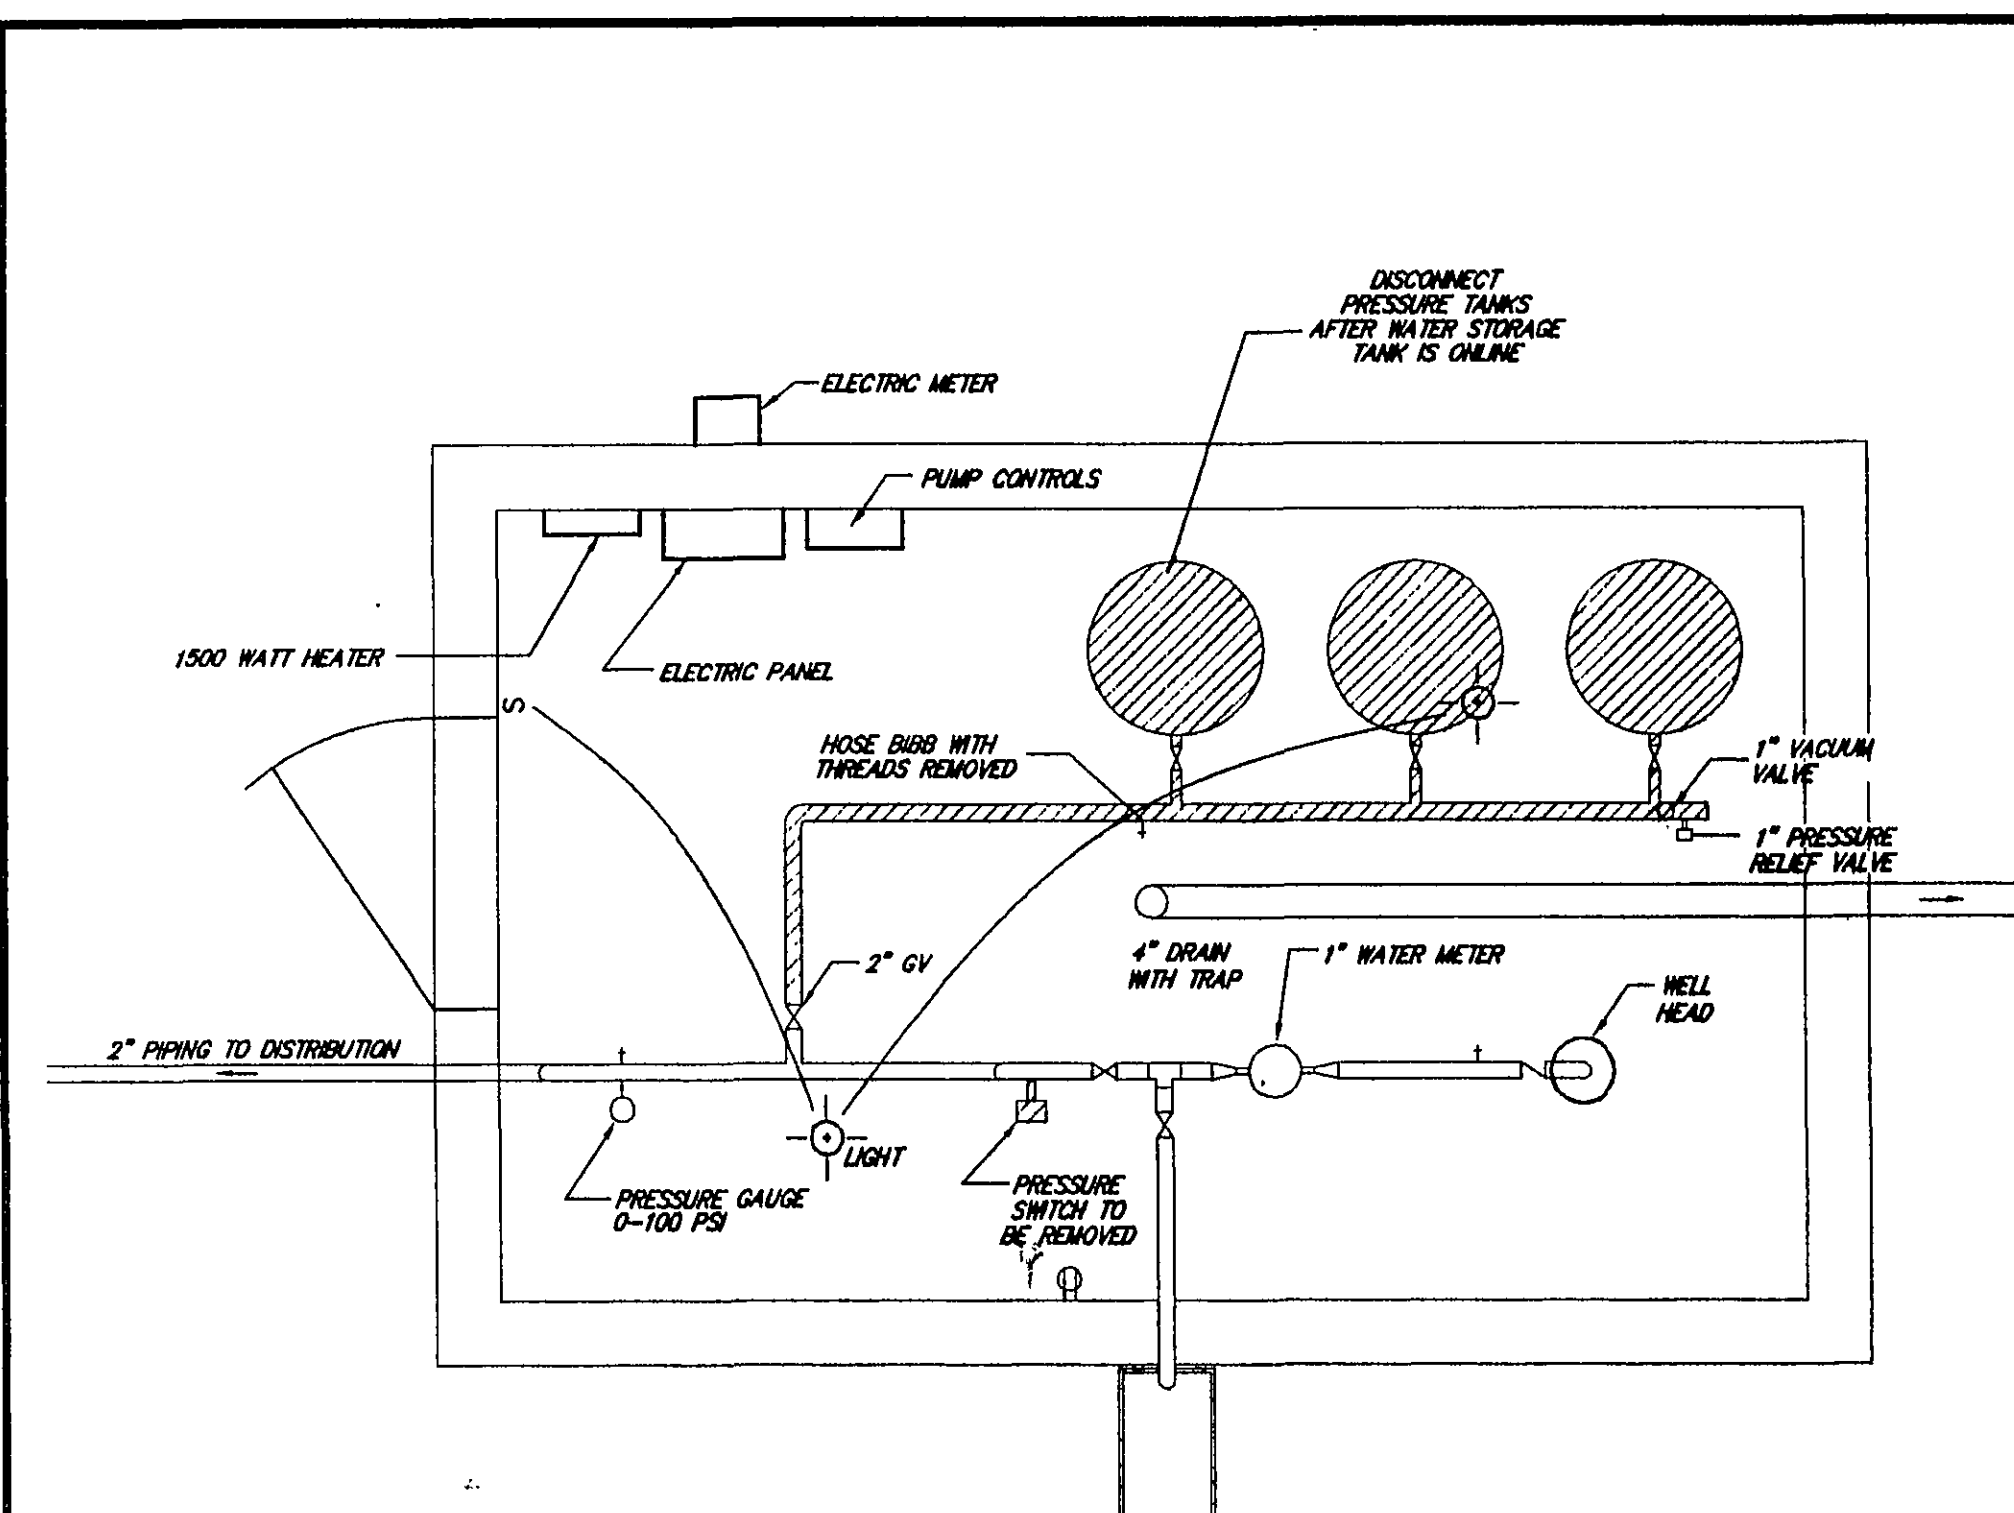

WELL #3

SCALE: 1" = 2'

NOTES:

1. REMOVE THE EXISTING PRESSURE SWITCH FROM THE DISCHARGE PIPING WITHIN THE WELL HOUSE AND DISCONNECT THE PRESSURE TANKS ONCE THE WATER STORAGE TANK IS READY TO BE PUT INTO OPERATION.
2. THE WELL PUMP WILL BE ACTIVATED BY A REMOTE DIALER LOCATED IN THE BASE OF THE WATER STORAGE TANK. THE REMOTE DIALER WILL BE CONNECTED TO A CONTROLLER WHICH MONITORS THE WATER LEVEL IN THE STORAGE TANK BY A HIGH PERFORMANCE PRESSURE TRANSDUCER LOCATED ON THE DRAIN OF THE WATER STORAGE TANK.



LUMSDEN ASSOCIATES, P.C.
ENGINEERS-SURVEYORS-PLANNERS
ROANOKE, VIRGINIA

664 BRAMBLETON AVENUE
P.O. BOX 2060
ROANOKE, VIRGINIA 24060
PHONE (540) 774-4411
FAX (540) 772-3445
E-MAIL: LUMSDEN@LUMSDENPC.COM

OVERVIEW MAP & MISCELLANEOUS

PHASE 2 WATER LINE PLANS FOR
"WESTLAKE TOWNE CENTER"
PREPARED FOR
WILLARD CONSTRUCTION OF
SMITH MOUNTAIN LAKE, LLC
GILLS CREEK MAGISTERIAL DISTRICT
FRANKLIN COUNTY, VIRGINIA

NO.	DATE	REVISIONS	DESCRIPTION
1			
2			
3			
4			

DATE: JANUARY 10, 2002

SCALE: 1" = 100'

COMMISSION NO. 00-080

CADD FILE: C:\WORK\WATER\WILLARD\CONSTR\DWG\00-080.DWG

SHEET 4 OF 10