
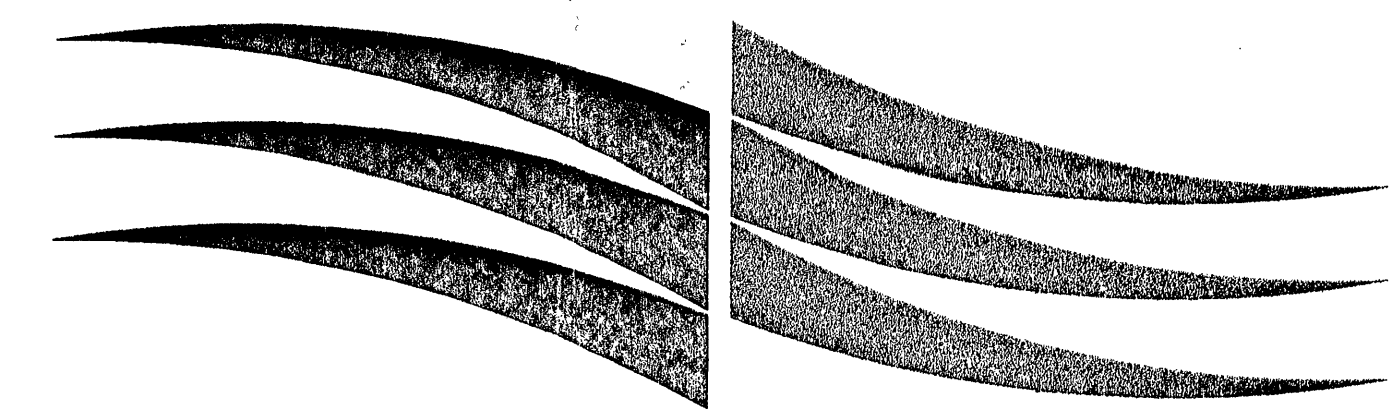


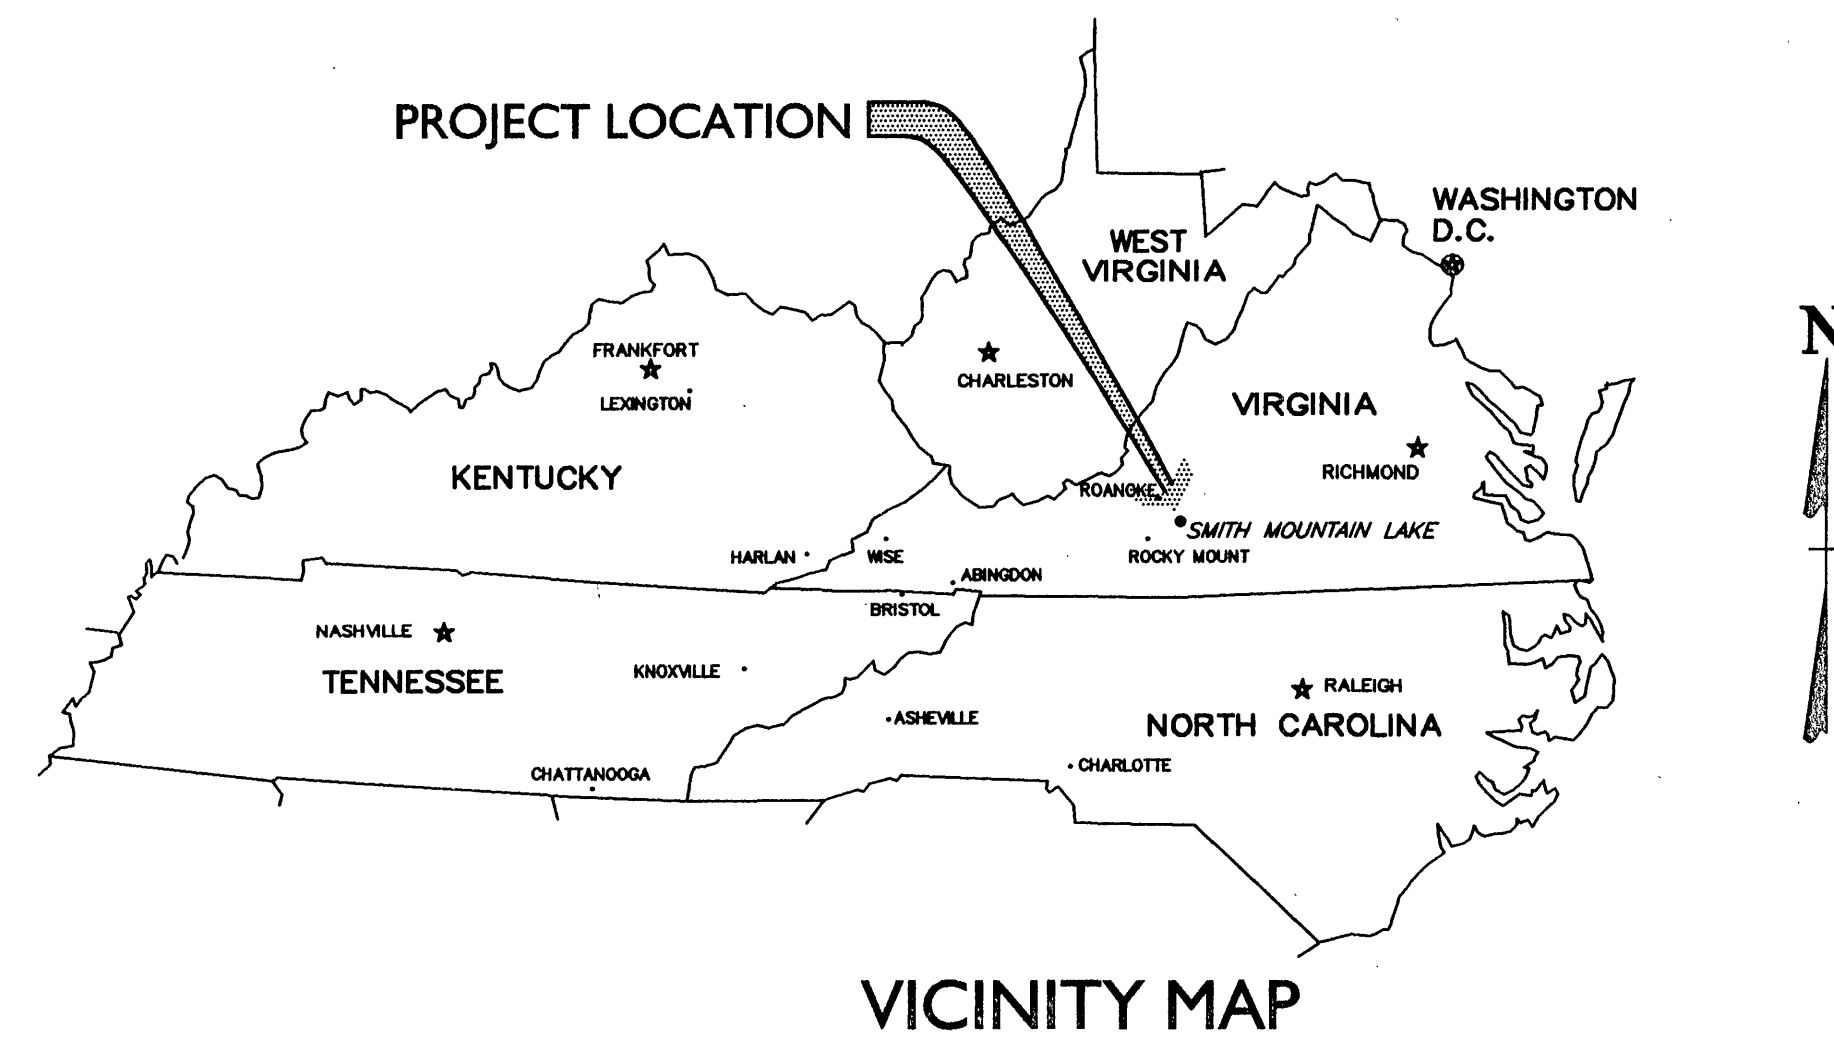



THOMPSON & LITTON

Radford Corporate Campus West
203C Rock Road
Radford, Virginia 24141

CONNECTION TO EXISTING WESTLAKE TOWNE CENTER WATER SYSTEM FOR THE FRANKLIN COUNTY BOARD OF SUPERVISORS

VIRGINIA DEPARTMENT OF HEALTH
OFFICE OF DRINKING WATER
APPROVED BY:
ENGINEERING FIELD DIRECTOR
DATE: 5/31/06

Office of Drinking Water
Danville Field Office
APR 17 2006
RECEIVED

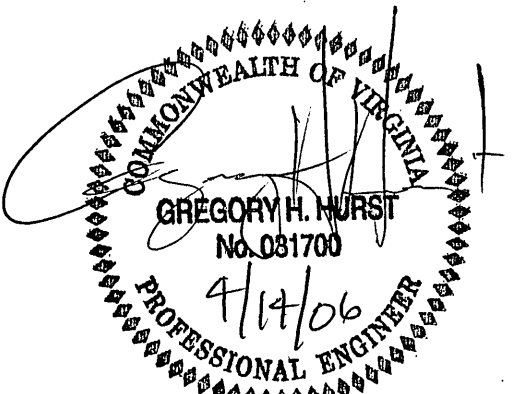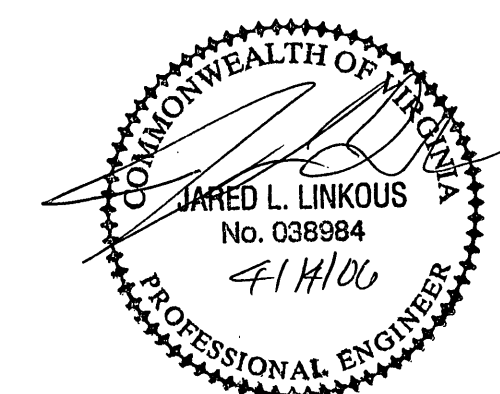

FRANKLIN COUNTY BOARD OF SUPERVISORS
40 EAST COURT STREET
ROCKY MOUNT, VIRGINIA 24151
(540) 483-3030

BONNIE N. JOHNSON - ASSISTANT COUNTY ADMINISTRATOR

T&L PROJECT NO.: 8200-03

MARCH 2006

CONSTRUCTION DOCUMENTS ISSUED APRIL 14, 2006