


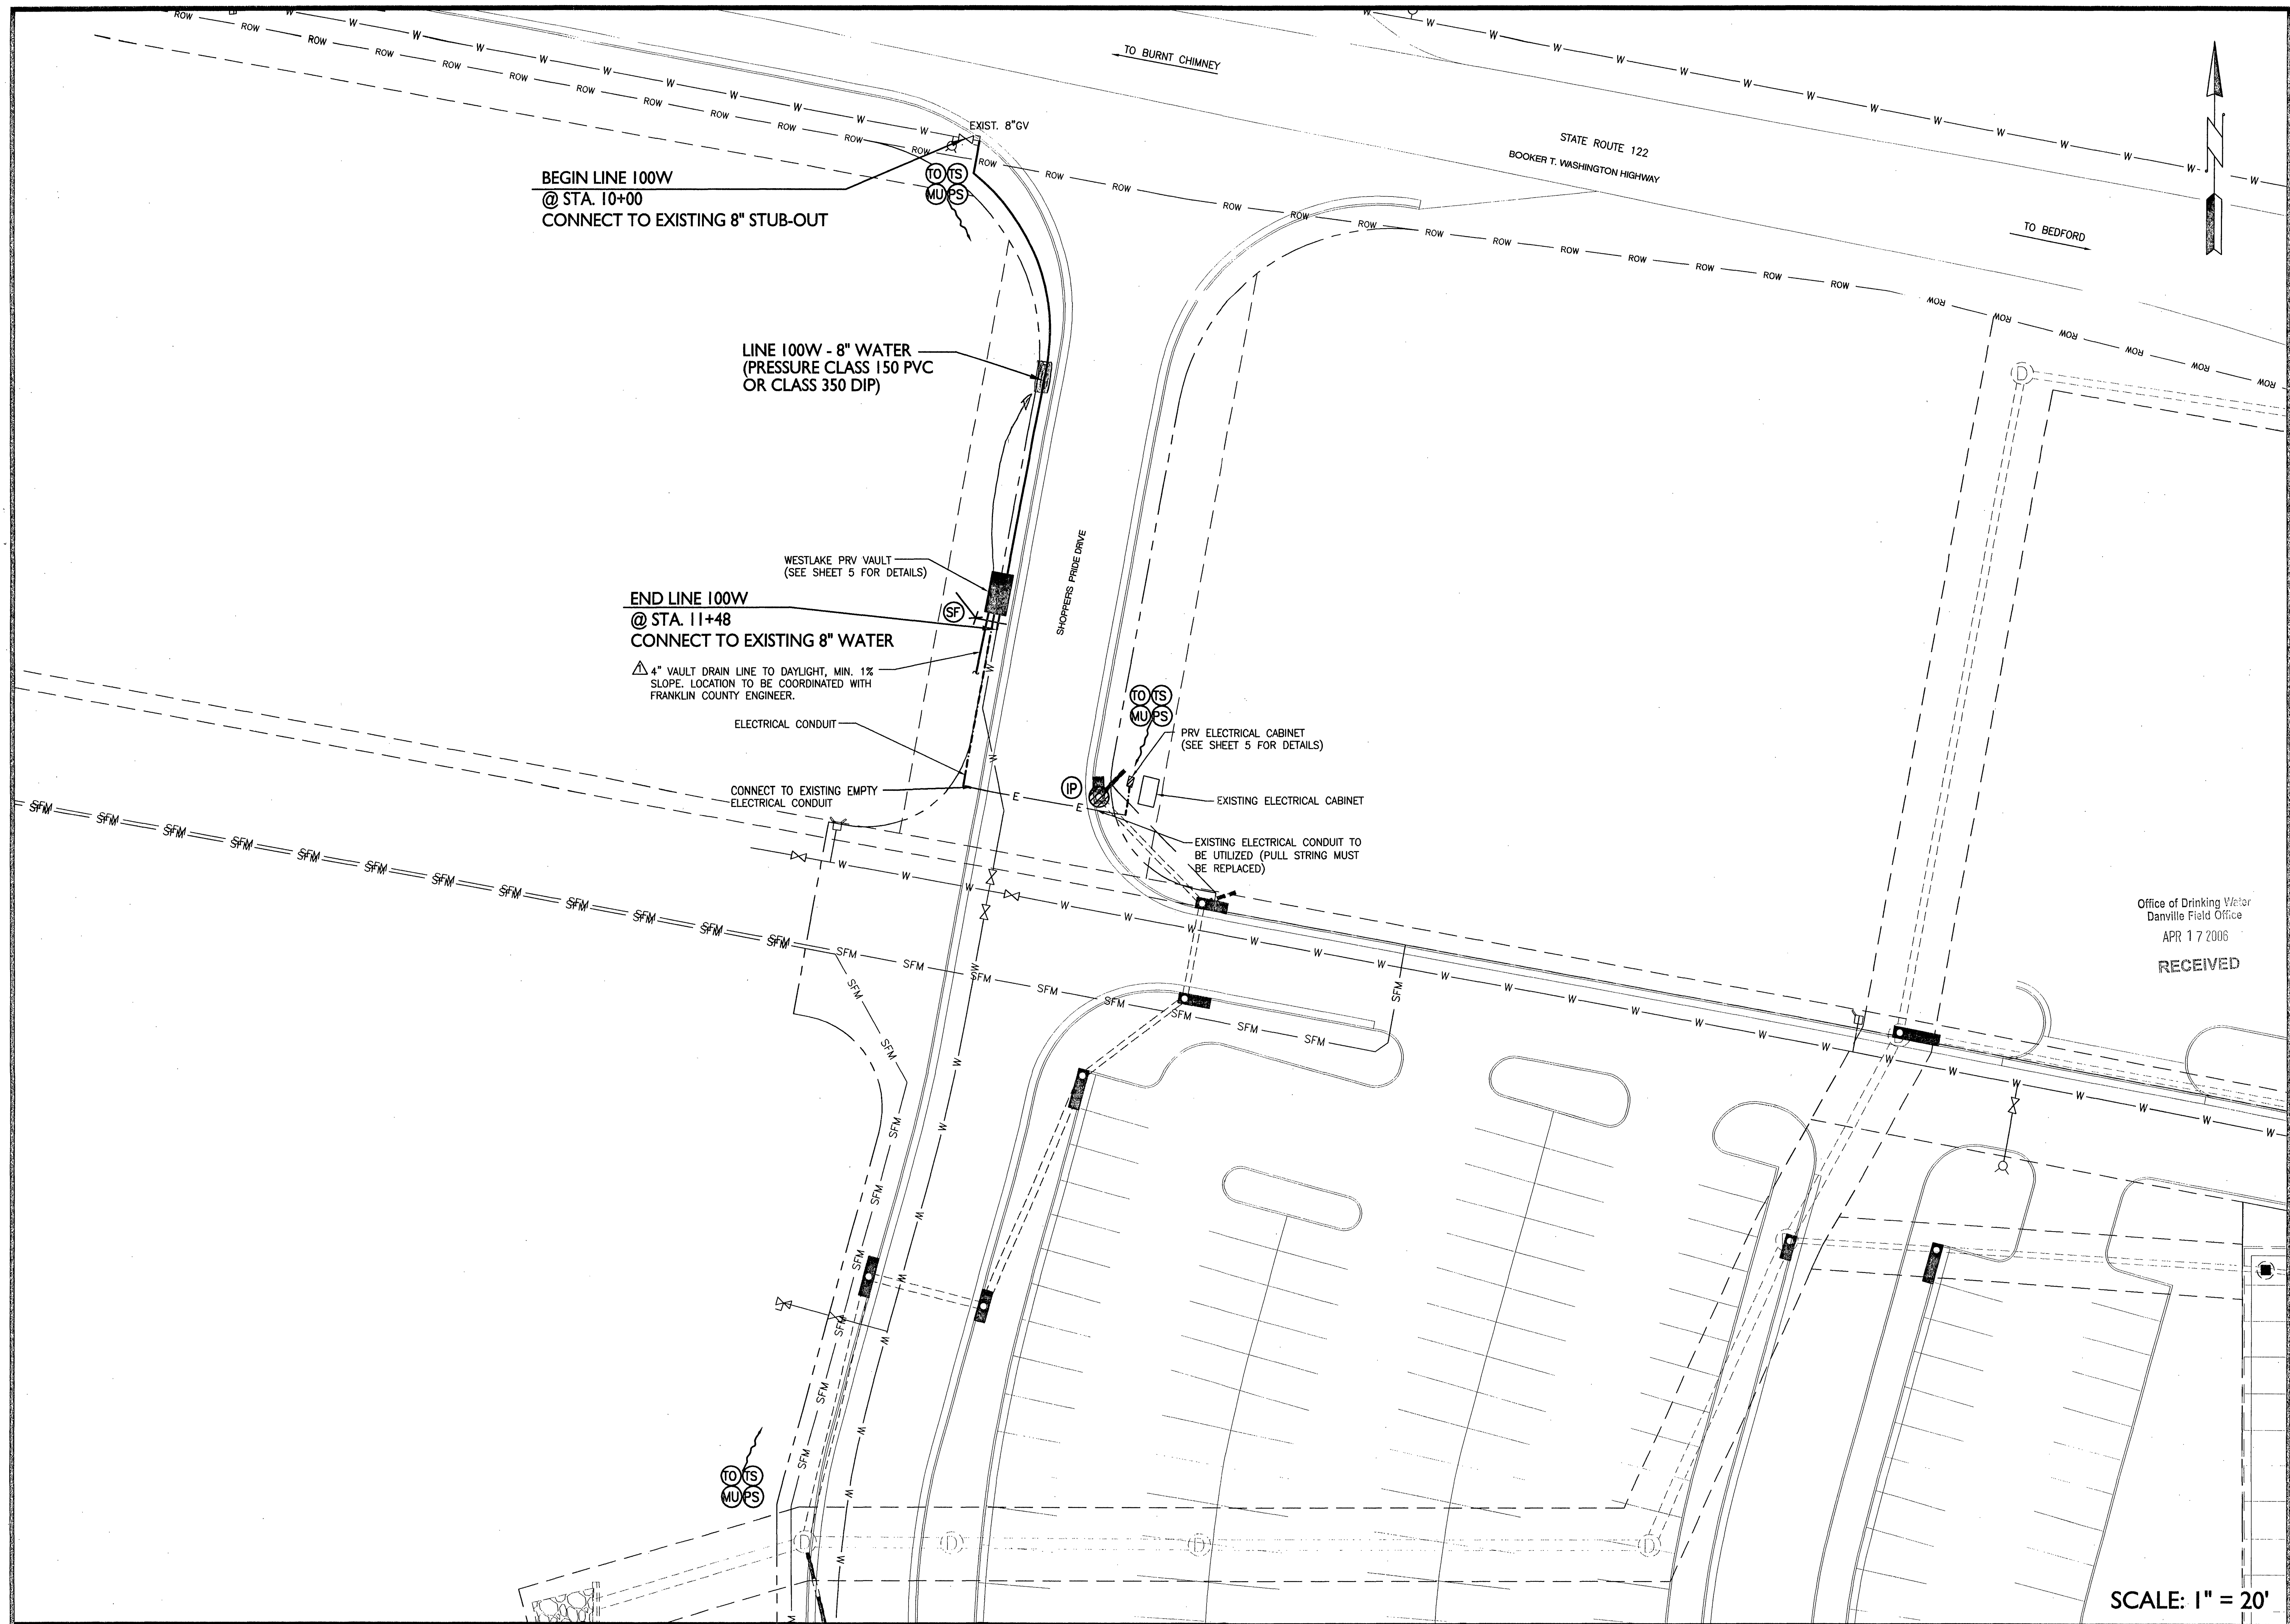

BEGIN LINE 100W
@ STA. 10+00
CONNECT TO EXISTING 8" STUB-OUT

LINE 100W - 8" WATER
(PRESSURE CLASS 150 PVC
OR CLASS 350 DIP)

END LINE 100W
@ STA. 11+48
CONNECT TO EXISTING 8" WATER

4" VAULT DRAIN LINE TO DAYLIGHT, MIN. 1%
SLOPE. LOCATION TO BE COORDINATED WITH
FRANKLIN COUNTY ENGINEER.

ELECTRICAL CONDUIT

CONNECT TO EXISTING EMPTY
ELECTRICAL CONDUIT

WESTLAKE PRV VAULT
(SEE SHEET 5 FOR DETAILS)


SHOPPEERS PRIDE DRIVE

PRV ELECTRICAL CABINET
(SEE SHEET 5 FOR DETAILS)

EXISTING ELECTRICAL CABINET
EXISTING ELECTRICAL CONDUIT TO
BE UTILIZED (PULL STRING MUST
BE REPLACED)

Office of Drinking Water
Danville Field Office
APR 17 2006
RECEIVED

SCALE: 1" = 20'

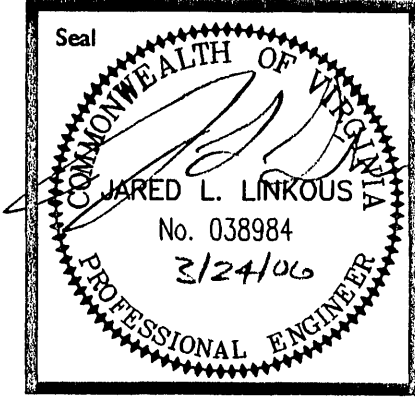

CONNECTION TO EXISTING
WESTLAKE TOWNE CENTER WATER SYSTEM
FOR THE
FRANKLIN COUNTY BOARD OF SUPERVISORS
PLAN - LINE 100W

No.	Date	Review	Documents Issued
1	03/02/06	REVIEW	DOCUMENTS ISSUED
2	03/24/06	OWNER	REVISIONS
3	03/27/06	BID	DOCUMENTS ISSUED
4	04/14/06	CONSTRUCTION	DOCUMENTS ISSUED

Designed	MLL
Drawn	JL
Checked	SHA/KL
Date	MARCH 2006
File No.	PLANS

Project No.
8200-03

THOMPSON & LITTON
Radford Corporate Campus West
200C Rock Road
Radford, Virginia 24141

Sheet No.
3