
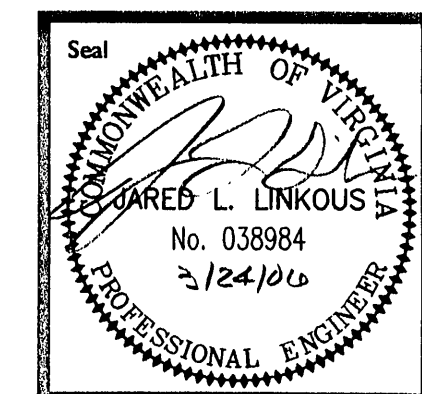


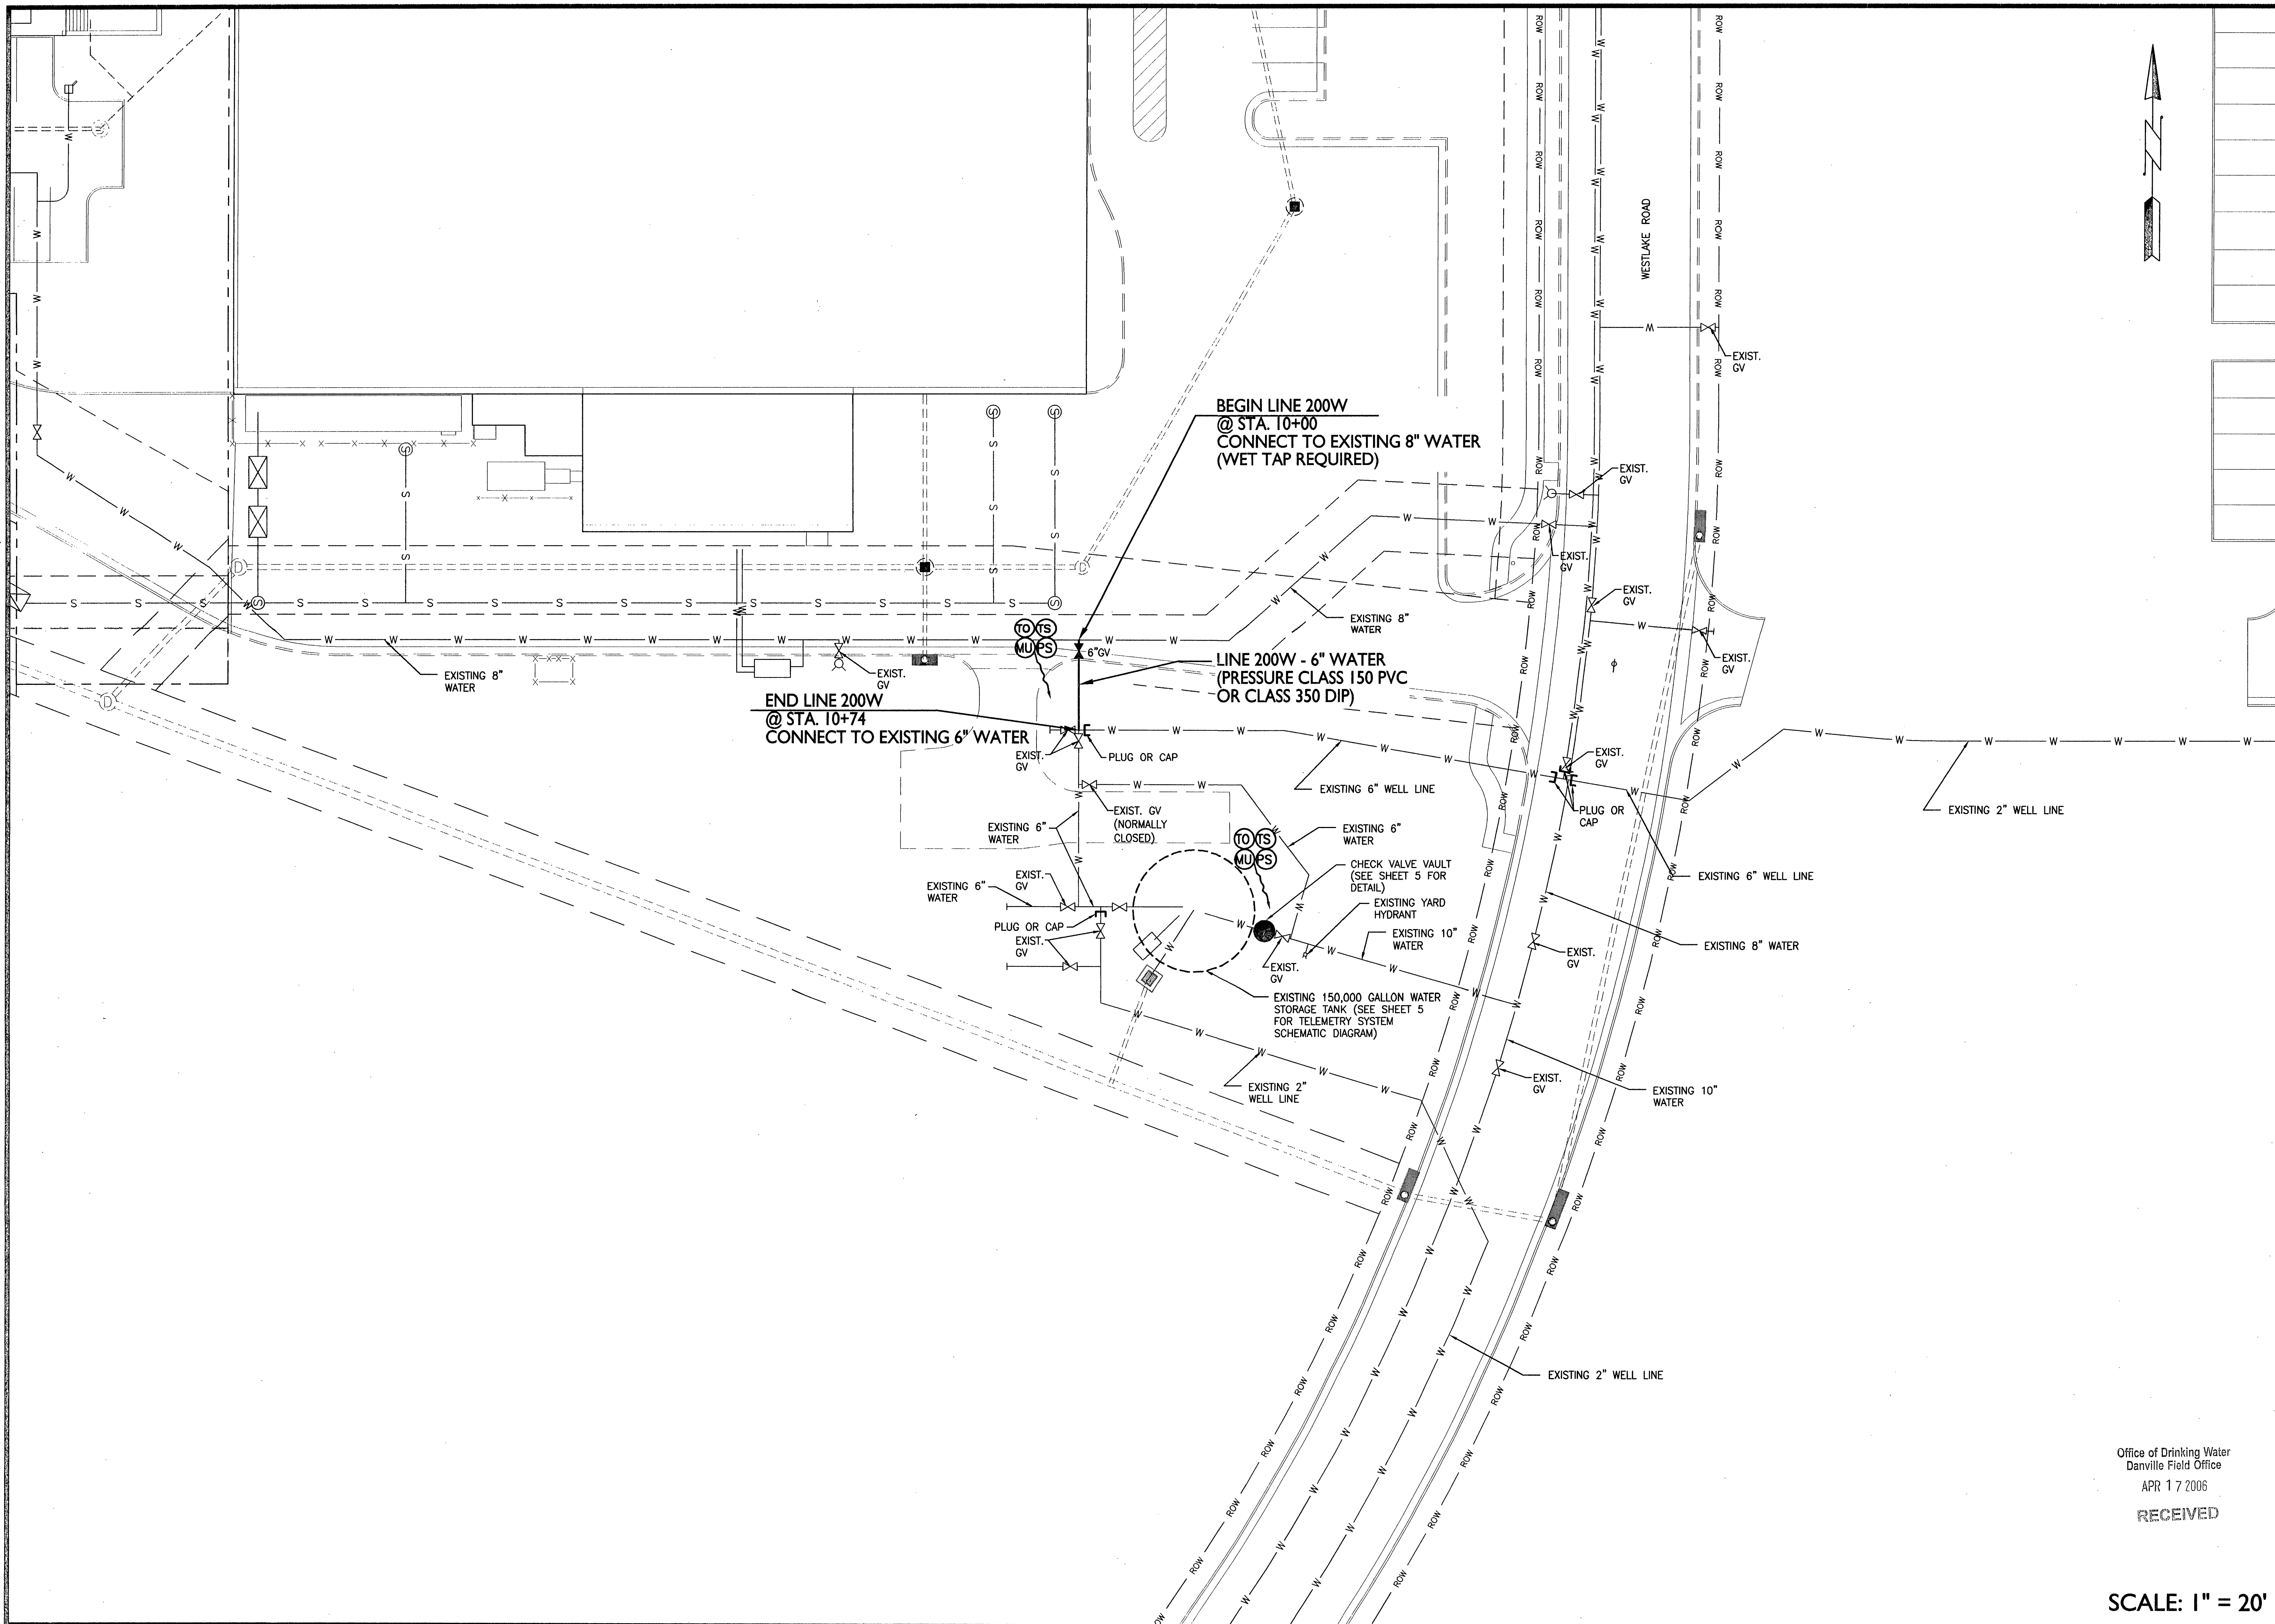

CONNECTION TO EXISTING
 WESTLAKE TOWNE CENTER WATER SYSTEM
 FOR THE
 FRANKLIN COUNTY BOARD OF SUPERVISORS
 PLAN - LINE 200W

No.	Date	Purpose of Document Issue
	03/02/06	REVIEW DOCUMENTS ISSUED
	03/27/06	BID DOCUMENTS ISSUED
	04/14/06	CONSTRUCTION DOCUMENTS ISSUED

Designed	MJC
Drawn	JK
Checked	CHAS
Date	MARCH 2006
File No.	PLANS

Project No.
8200-03



Radford Corporate Campus West
 2015 Rock Road
 Radford, Virginia 24141

Sheet No.
4

Office of Drinking Water
 Danville Field Office
 APR 17 2006
 RECEIVED

SCALE: 1" = 20'