


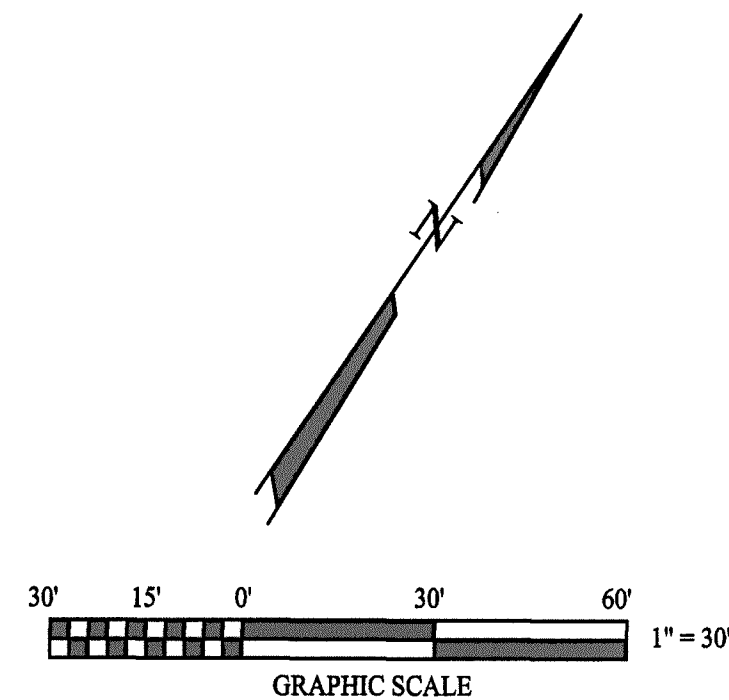

MATCHLINE STATION 11+50 (SEE SHEET C3.1)

INSTALL 6"Ø C-900 CL 200 SDR-14 PVC FORCEMAIN

BOOKER T. WASHINGTON
NATIONAL MONUMENT
D.B. 148 PG. 427
T.M. 30-24

STA. 13+32
INSTALL 1" AIR RELEASE
VALVE ASSEMBLY @ HIGH
POINT IN FORCE MAIN

existing gravel road

WESTLAKE WASTEWATER L.L.C.

MULTIPLE 1-1/2" EFFLUENT
LINES TO DRAINFIELDS


WESTLAKE WASTEWATER L.L.C.

INSTALL 6"Ø C-900 CL 200 SDR-14 PVC FORCEMAIN


BOOKER T. WASHINGTON
NATIONAL MONUMENT
D.B. 148 PG. 427
T.M. 30-24

MATCHLINE STATION 18+50 (SEE SHEET C3.3)

GRAPHIC SCALE:
HORIZ.: 1"=10'
VERT.: 1"=30'

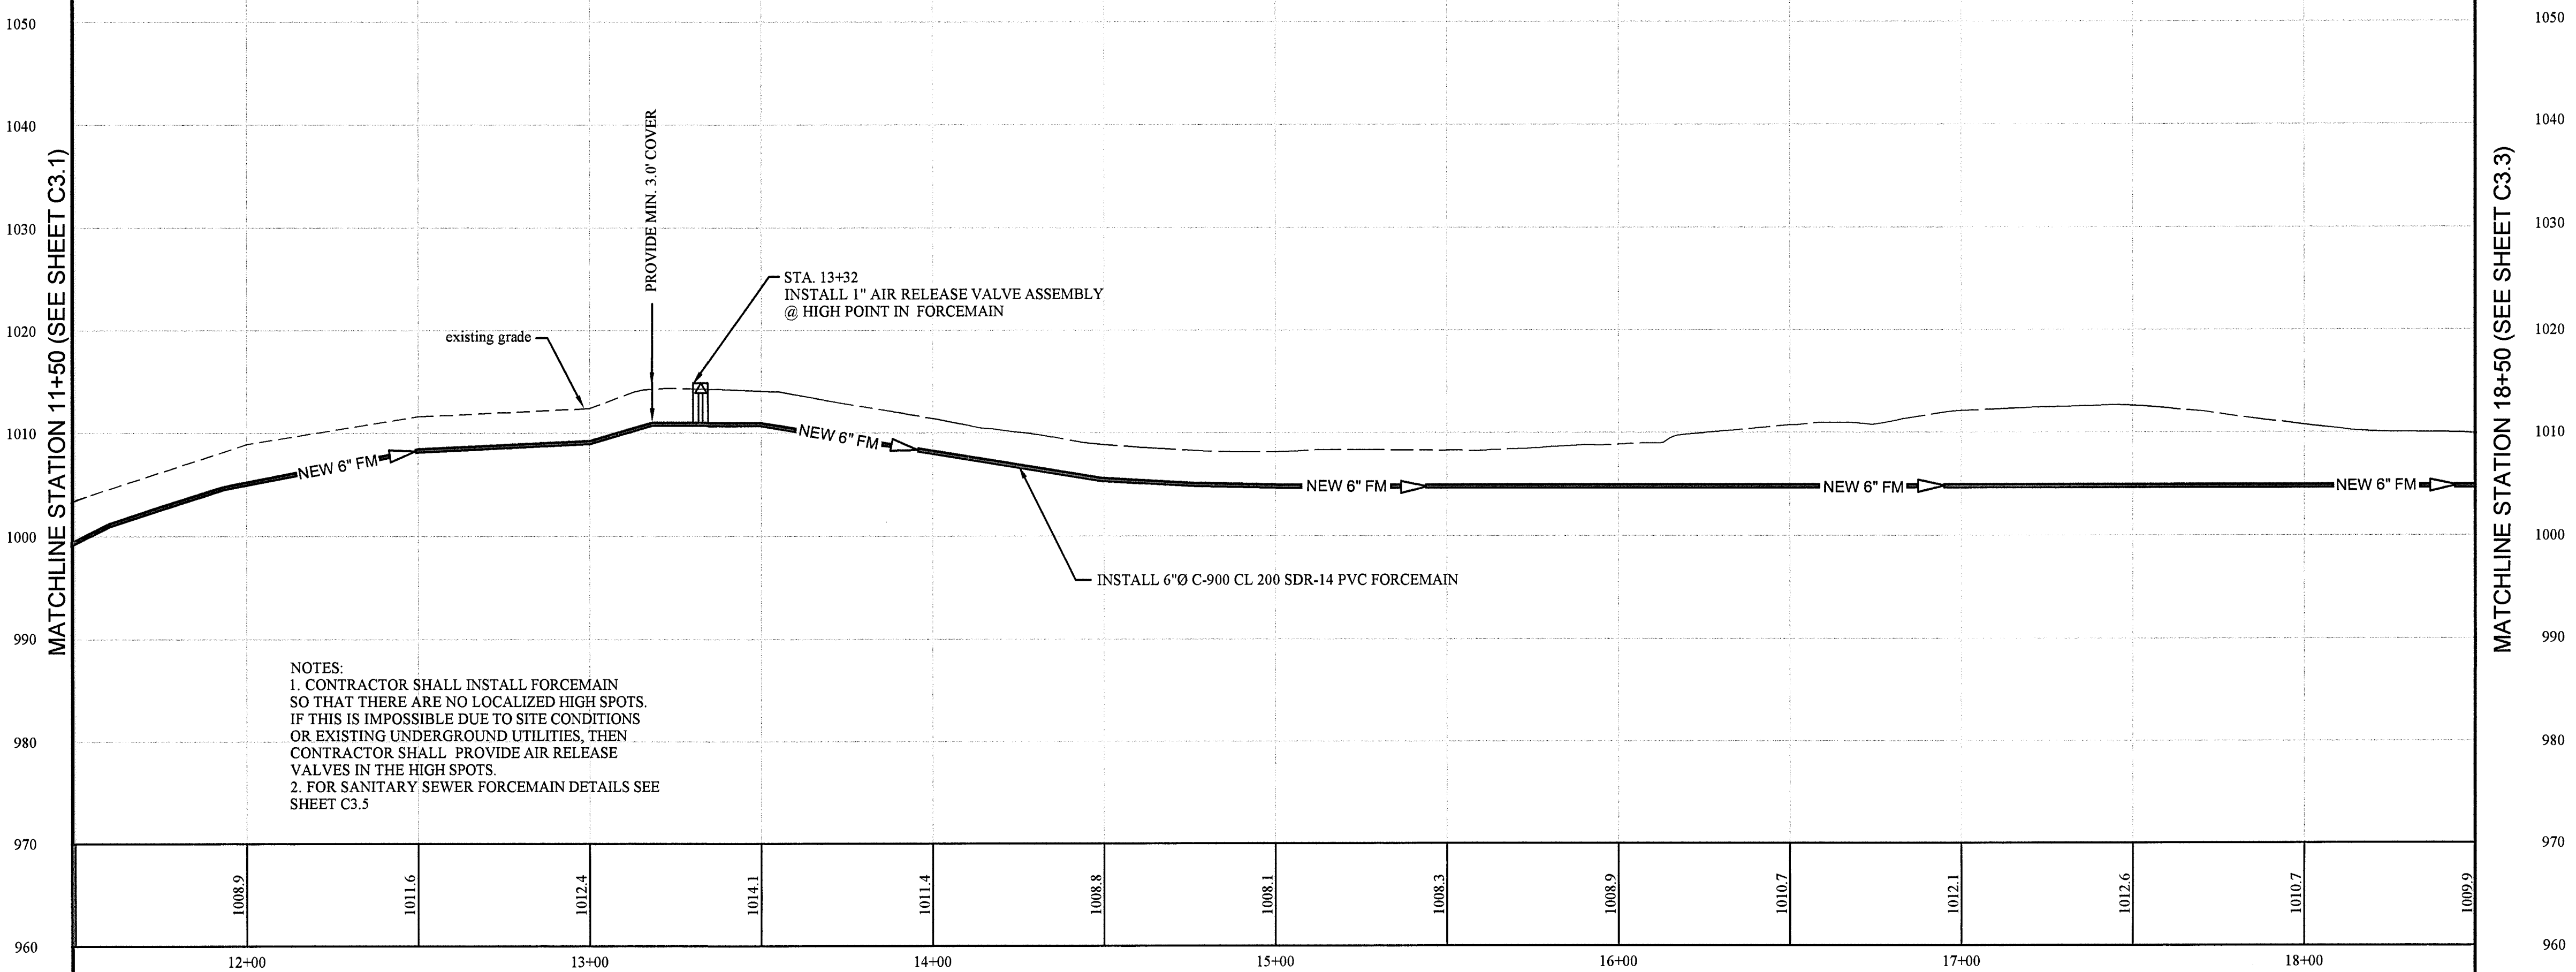

NOTES:
1. CONTRACTOR SHALL INSTALL FORCEMAIN
SO THAT THERE ARE NO LOCALIZED HIGH SPOTS.
IF THIS IS IMPOSSIBLE DUE TO SITE CONDITIONS
OR EXISTING UNDERGROUND UTILITIES, THEN
CONTRACTOR SHALL PROVIDE AIR RELEASE
VALVES IN THE HIGH SPOTS.
2. FOR SANITARY SEWER FORCEMAIN DETAILS SEE
SHEET C3.5

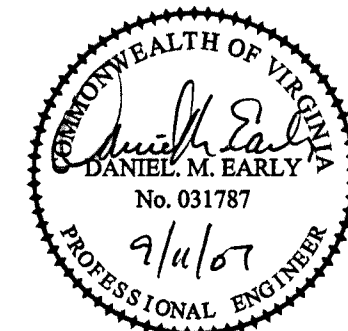

**ACS
DESIGN**

ENGINEERING • SURVEYING
LANDSCAPE ARCHITECTURE
CONSTRUCTION MANAGEMENT

2203 PETERS CREEK ROAD
ROANOKE, VIRGINIA 24017
P 540.562.2345 F 562.2344
INFO@ACSDSIGNLLC.COM
WWW.ACSDESIGNLLC.COM

**WESTLAKE VILLAGE
CENTRAL SEWER SYSTEM
FRANKLIN COUNTY, VIRGINIA**

DRAWN BY: CEK
DESIGNED BY: CEK
CHECKED BY: DME
DATE: 15 JUNE 2007
JOB NUMBER: 06145

REVISIONS:
No. 1
No. 2
No. 3
No. 4

SHEET NO.:
C3.2

FORCEMAIN FM-100
PLAN & PROFILE