



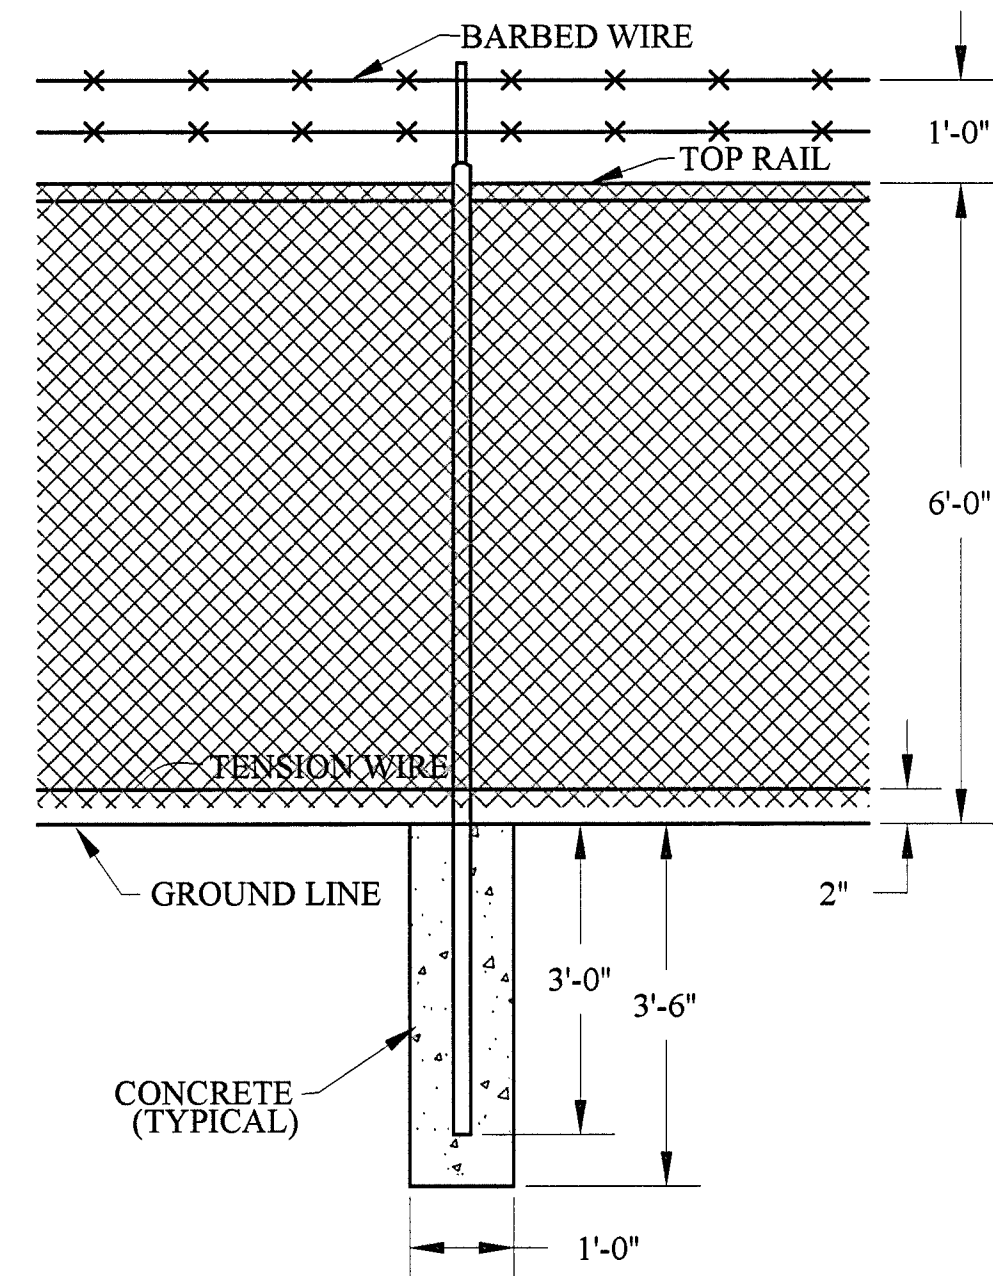


STANDARD LINE POST
NOT TO SCALE

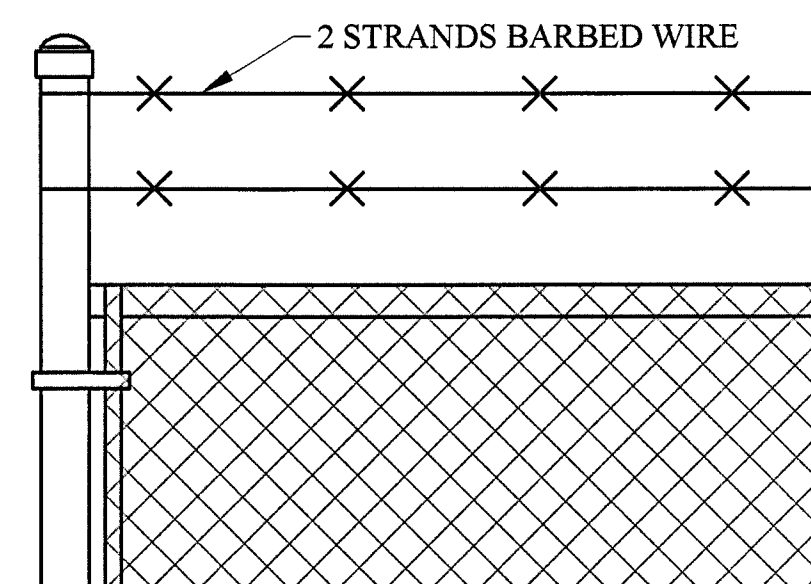


BARBED WIRE - 2 STRANDS, 12 1/2 GAUGE WIRE WITH 14 GAUGE 4 POINT BARBS SPACED APPROXIMATELY 6 INCHES APART.
ALL WIRE SHALL BE ALUMINUM COATED WITH A MINIMUM COATING OF 0.25 OUNCES PER SQUARE FOOT OF SURFACE AREA.
BARBED WIRE SHALL BE DIRECTLY ATTACHED TO EACH CORNER AND GATE POST.
BARBED WIRE SHALL BE ATTACHED TO EACH LINE POST AND PULL POST WITH A SUPPORTING ARM.
SUPPORTING ARM SHALL SLOPE TO THE OUTSIDE OF THE FENCE AT A 45° ANGLE.


BARBED WIRE
NOT TO SCALE

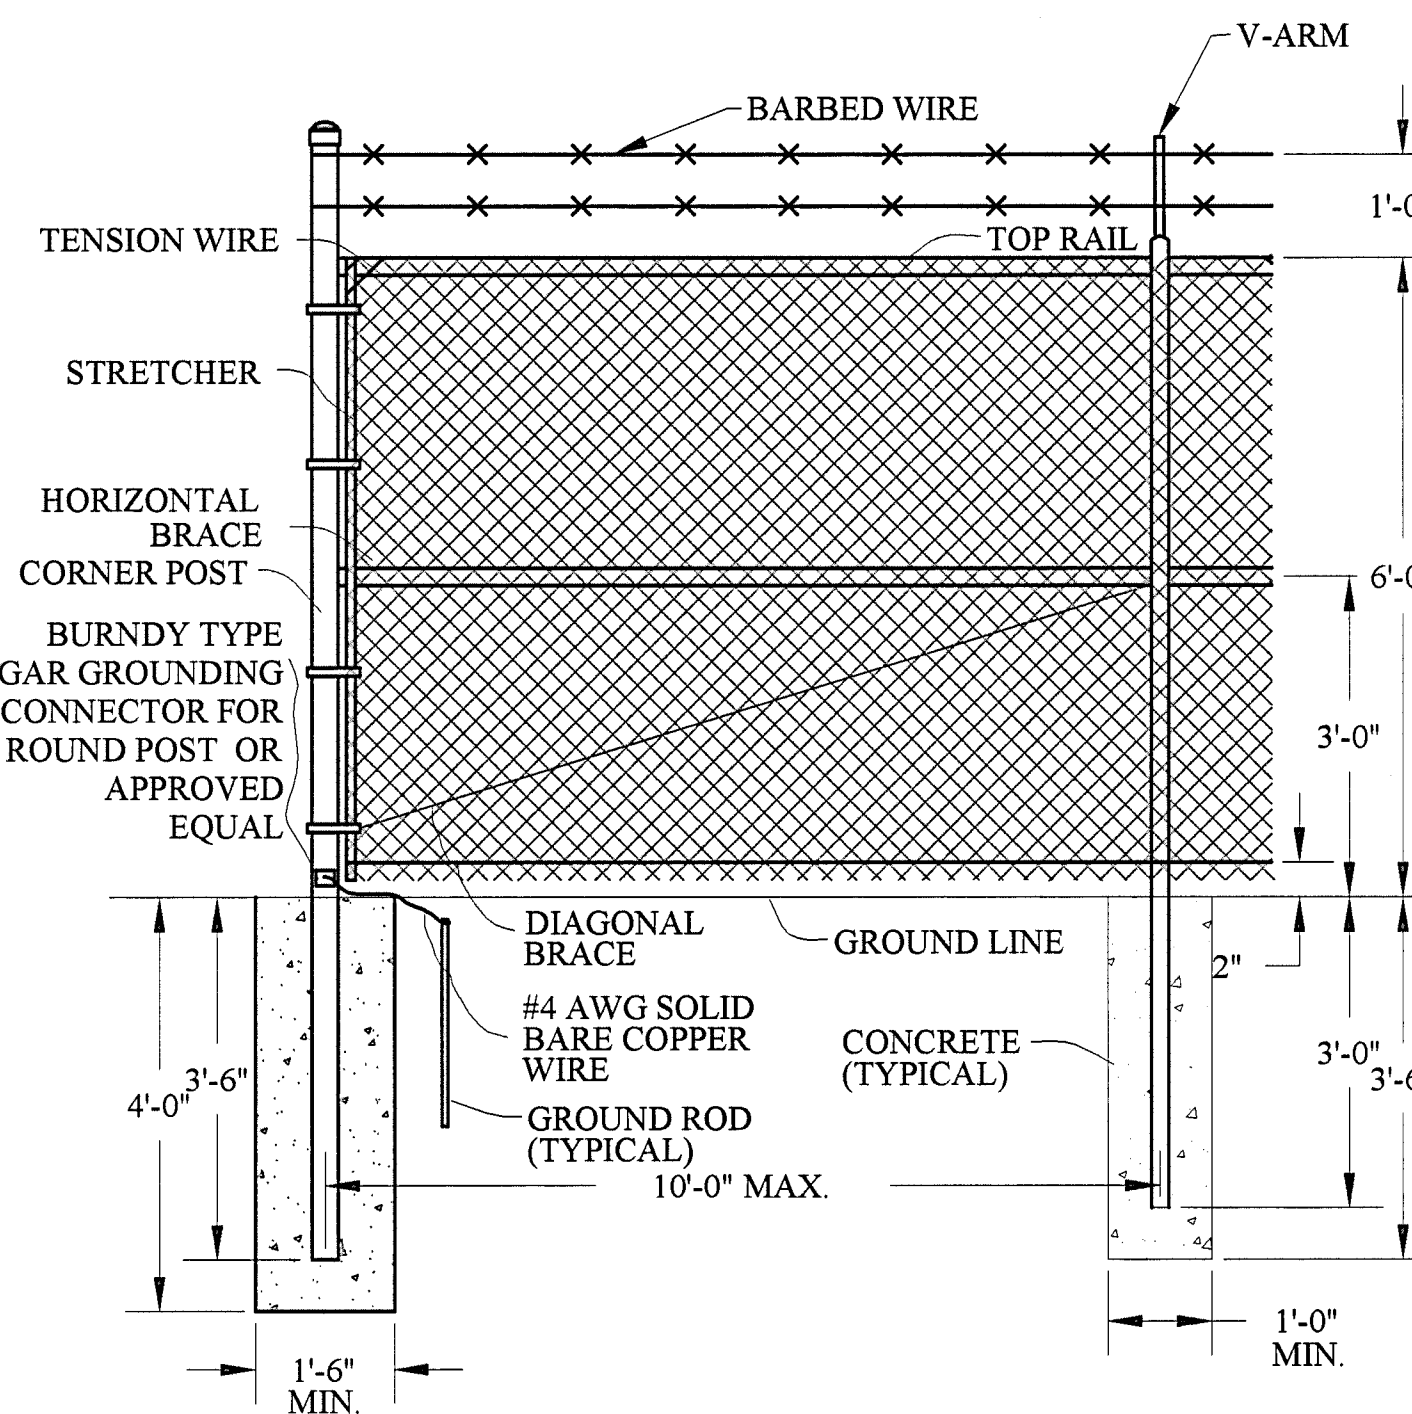

STANDARD CORNER
NOT TO SCALE

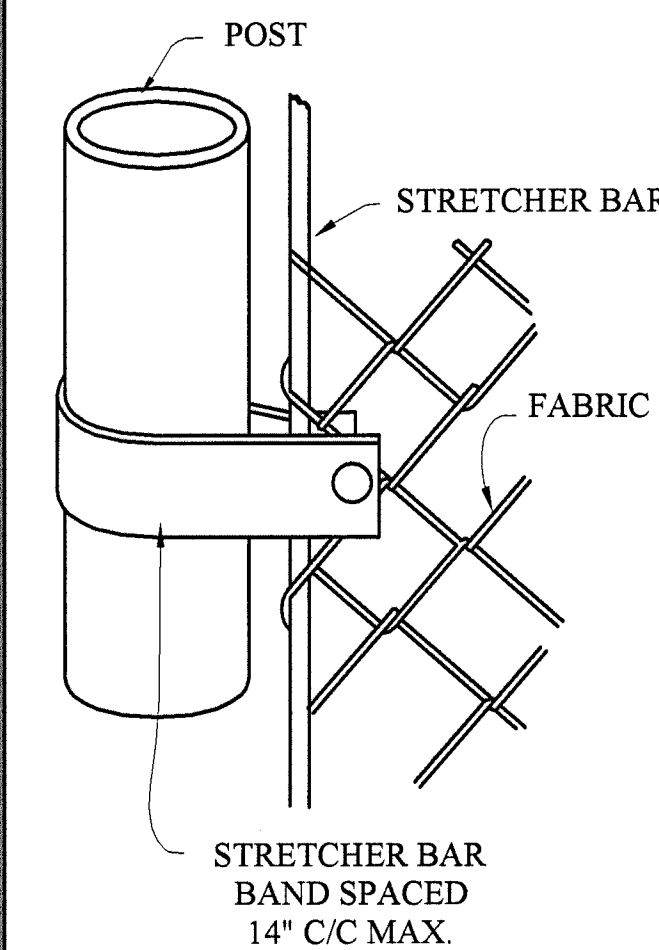

**METHOD OF FASTENING
STRETCHER BAR TO POST**

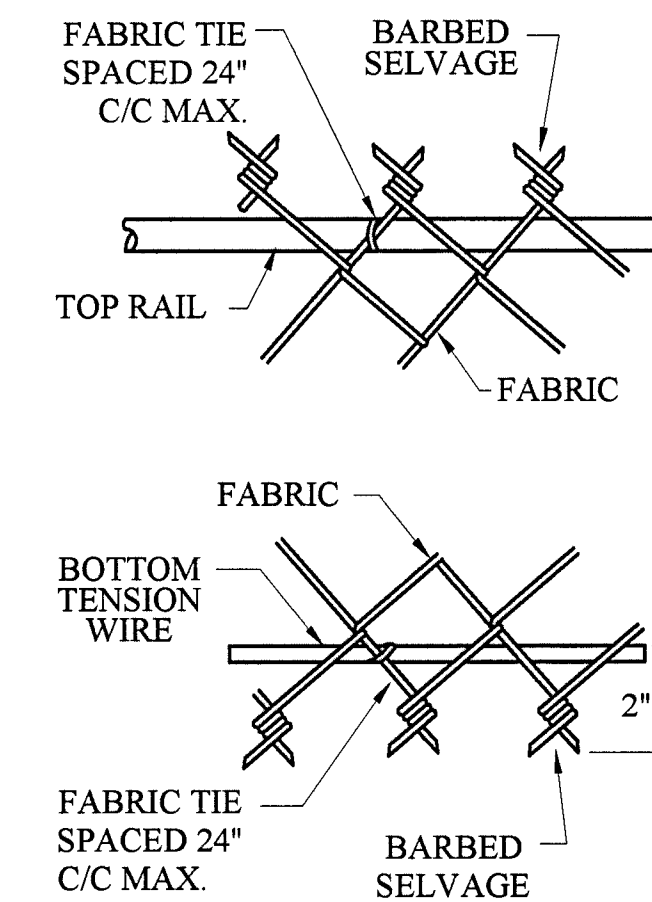


**METHOD OF TYING
FABRIC TO TENSION WIRES**

FASTENING & TYING
NOT TO SCALE




BLOCK LETTERS ON WHITE BACKGROUND
SIGN PANEL SHALL BE STANDARD GAUGE ALUMINUM SHEETS
SIGN SHALL BE FIELD LOCATED


SIGN
NOT TO SCALE

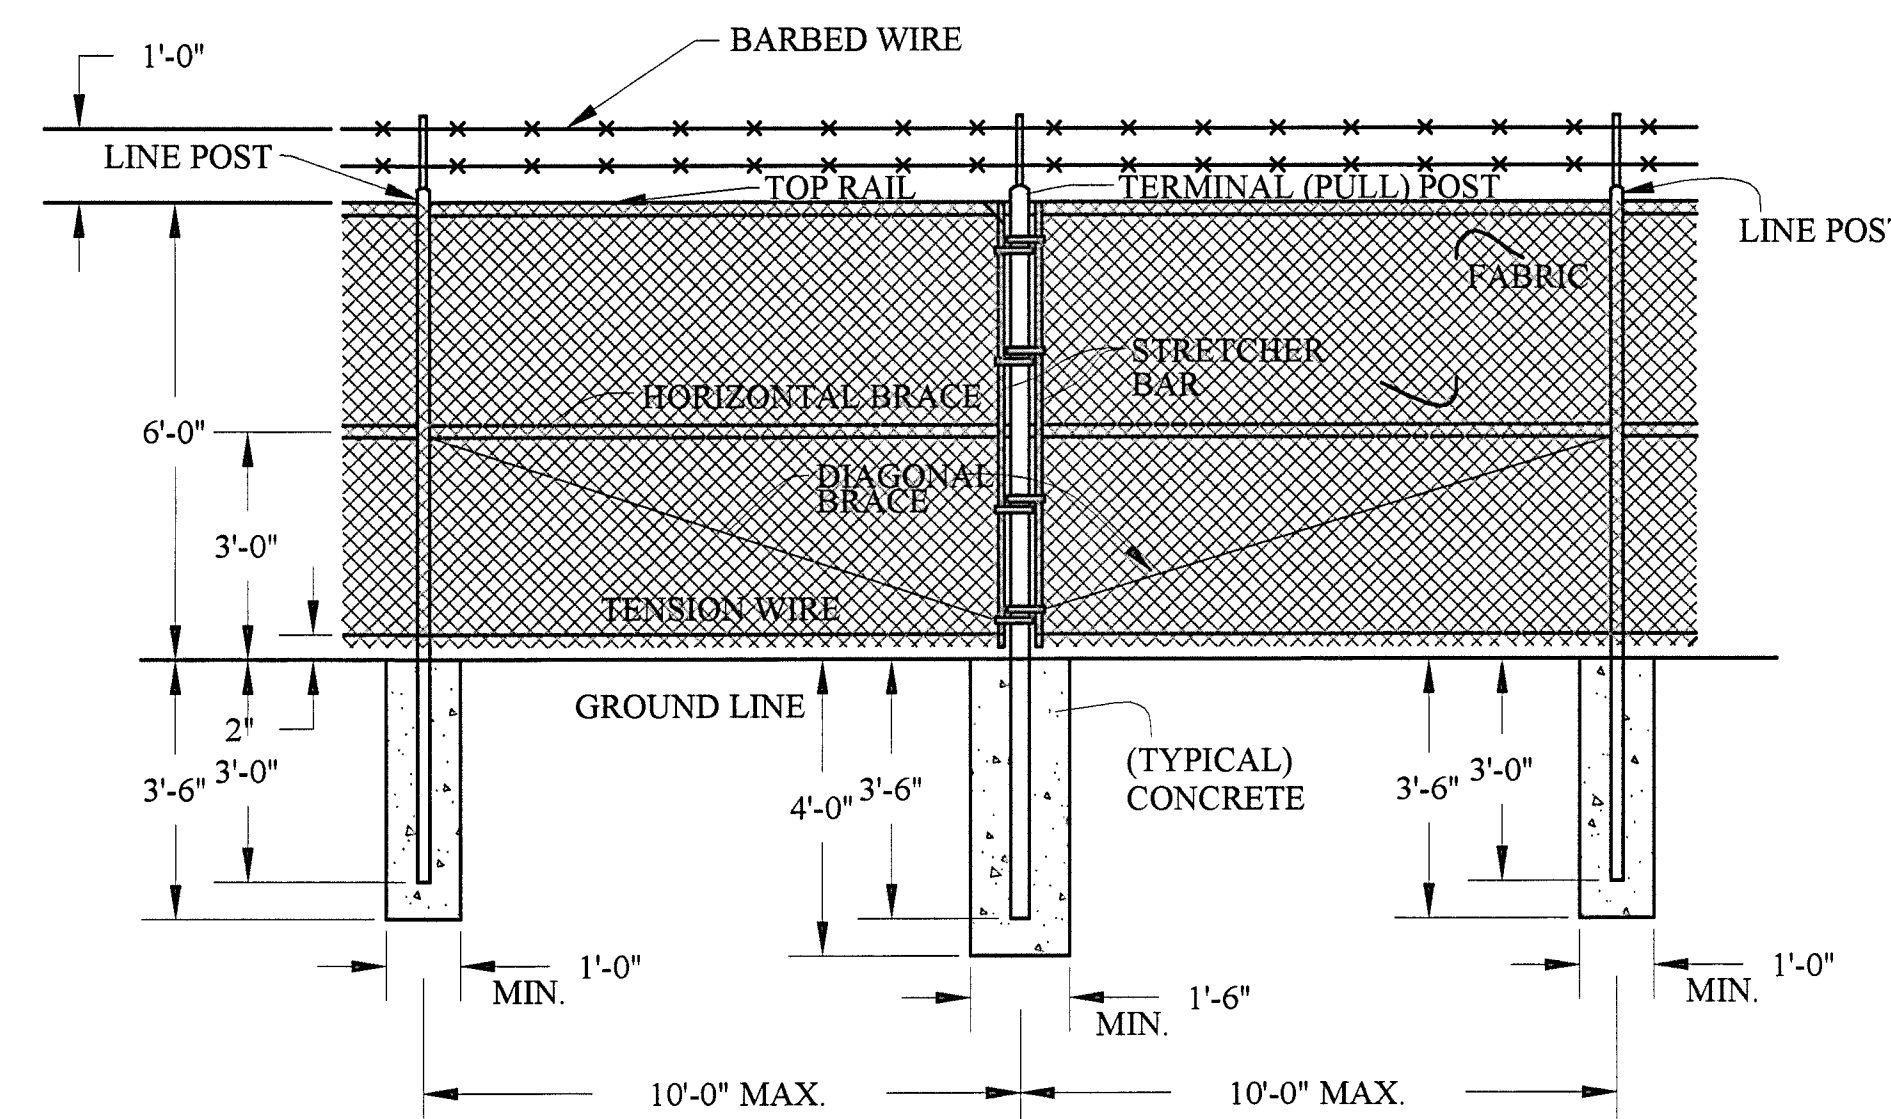

STANDARD PULL POST
NOT TO SCALE

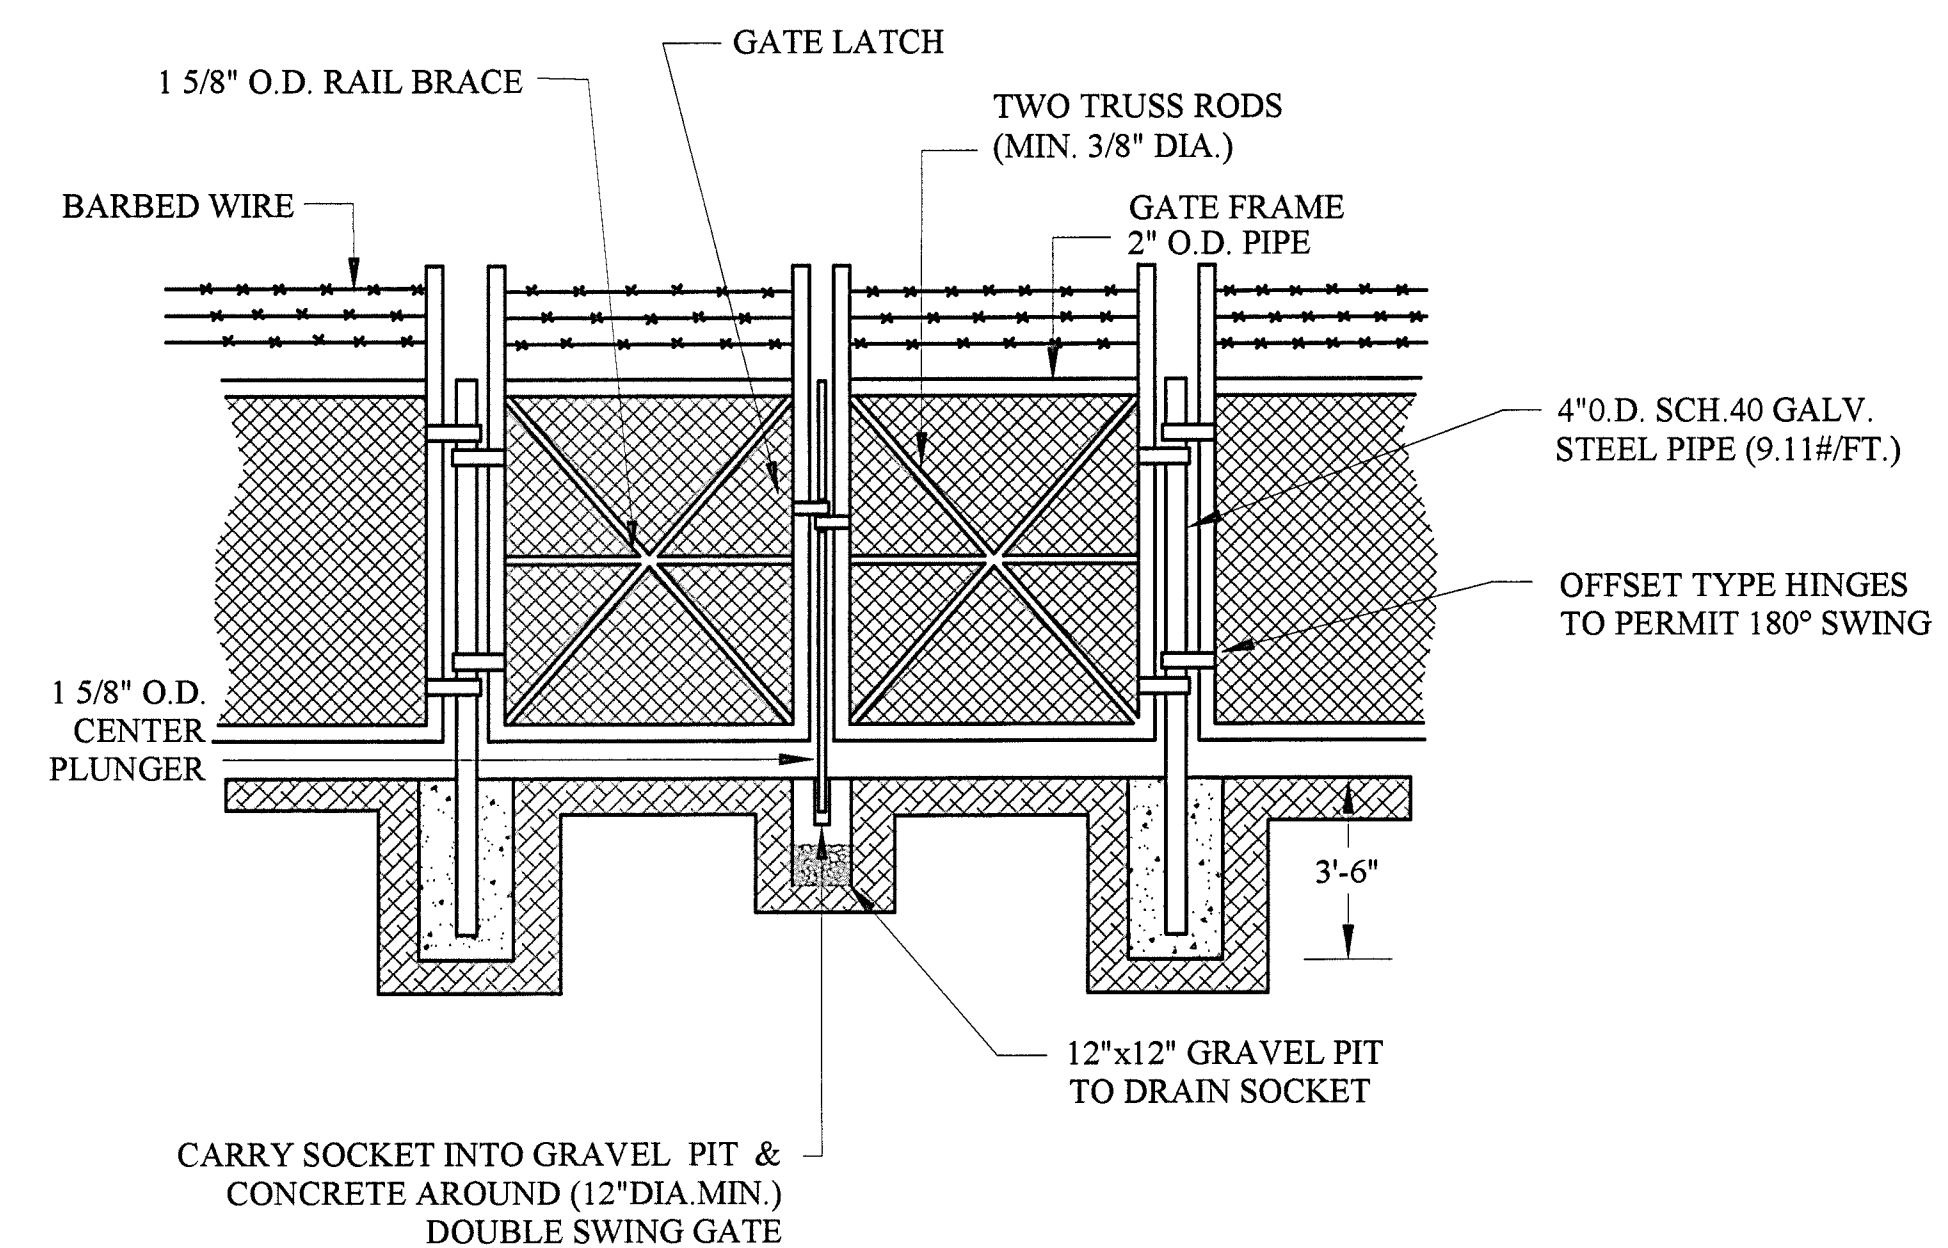

DOUBLE GATE DETAIL
NOT TO SCALE

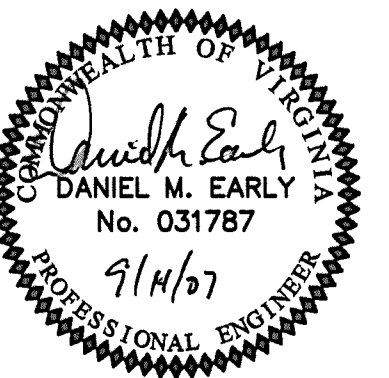

**ACS
DESIGN**

ENGINEERING • SURVEYING
LANDSCAPE ARCHITECTURE
CONSTRUCTION MANAGEMENT

2203 PETERS CREEK ROAD
ROANOKE, VIRGINIA 24017
P 540.562.2345 F 562.2344
INFO@ACSDSIGNLLC.COM
WWW.ACSDESIGNLLC.COM

**WESTLAKE VILLAGE
CENTRAL SEWER SYSTEM
FRANKLIN COUNTY, VIRGINIA**

DRAWN BY: KMF
DESIGNED BY: JJD
CHECKED BY: JJD
DATE: 15 JUNE 2007
JOB NUMBER: 06145

REVISIONS:
No. 1
No. 2
No. 3
No. 4

SHEET NO.:
C4.7

STANDARD WWTP
FENCE DETAILS