
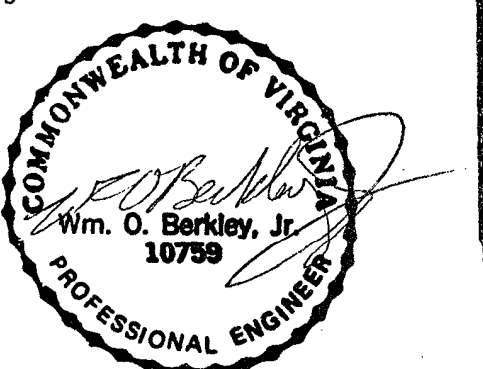
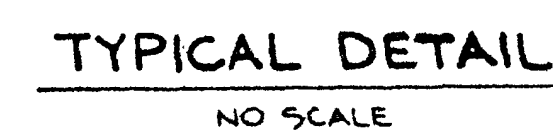
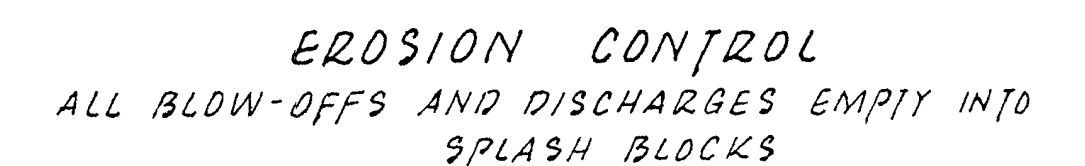

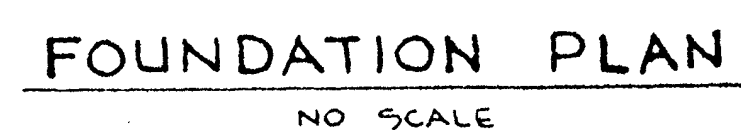


1. ALL PIPING BELOW GRADE AND UNDER CONCRETE SLAB SHALL BE GALVANIZED STEEL OR DUCTILE IRON.
2. ALL EXPOSED PIPING SHALL BE INSULATED TO PREVENT FREEZING TO A DEPTH 3' BELOW GRADE W/ CERTAINTIED* WRAP OR APPROVED EQUAL.
3. CUT OR FILE ALL THREADS FROM DISCHARGE OF SAMPLE TAPS.
4. GALVANIZED STEEL OR DUCTILE IRON PIPE SHALL BE USED FOR ALL ABOVE- GRADE PIPING AT THE WELL AND AT THE STANDPIPE STORAGE TANK.

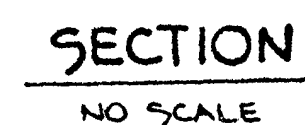

Berkley Howell & Assoc. ENGINEERS • SURVEYORS • PLANNERS		
SCALE:	APPROVED BY:	DRAWN BY
DATE: 4-15-87		REVISED 7-23-87
CEDAR RIDGE SUBDIVISION CENTRAL WATER SYSTEM		
MISC. DETAILS		DRAWING NUMBER 00 F 7