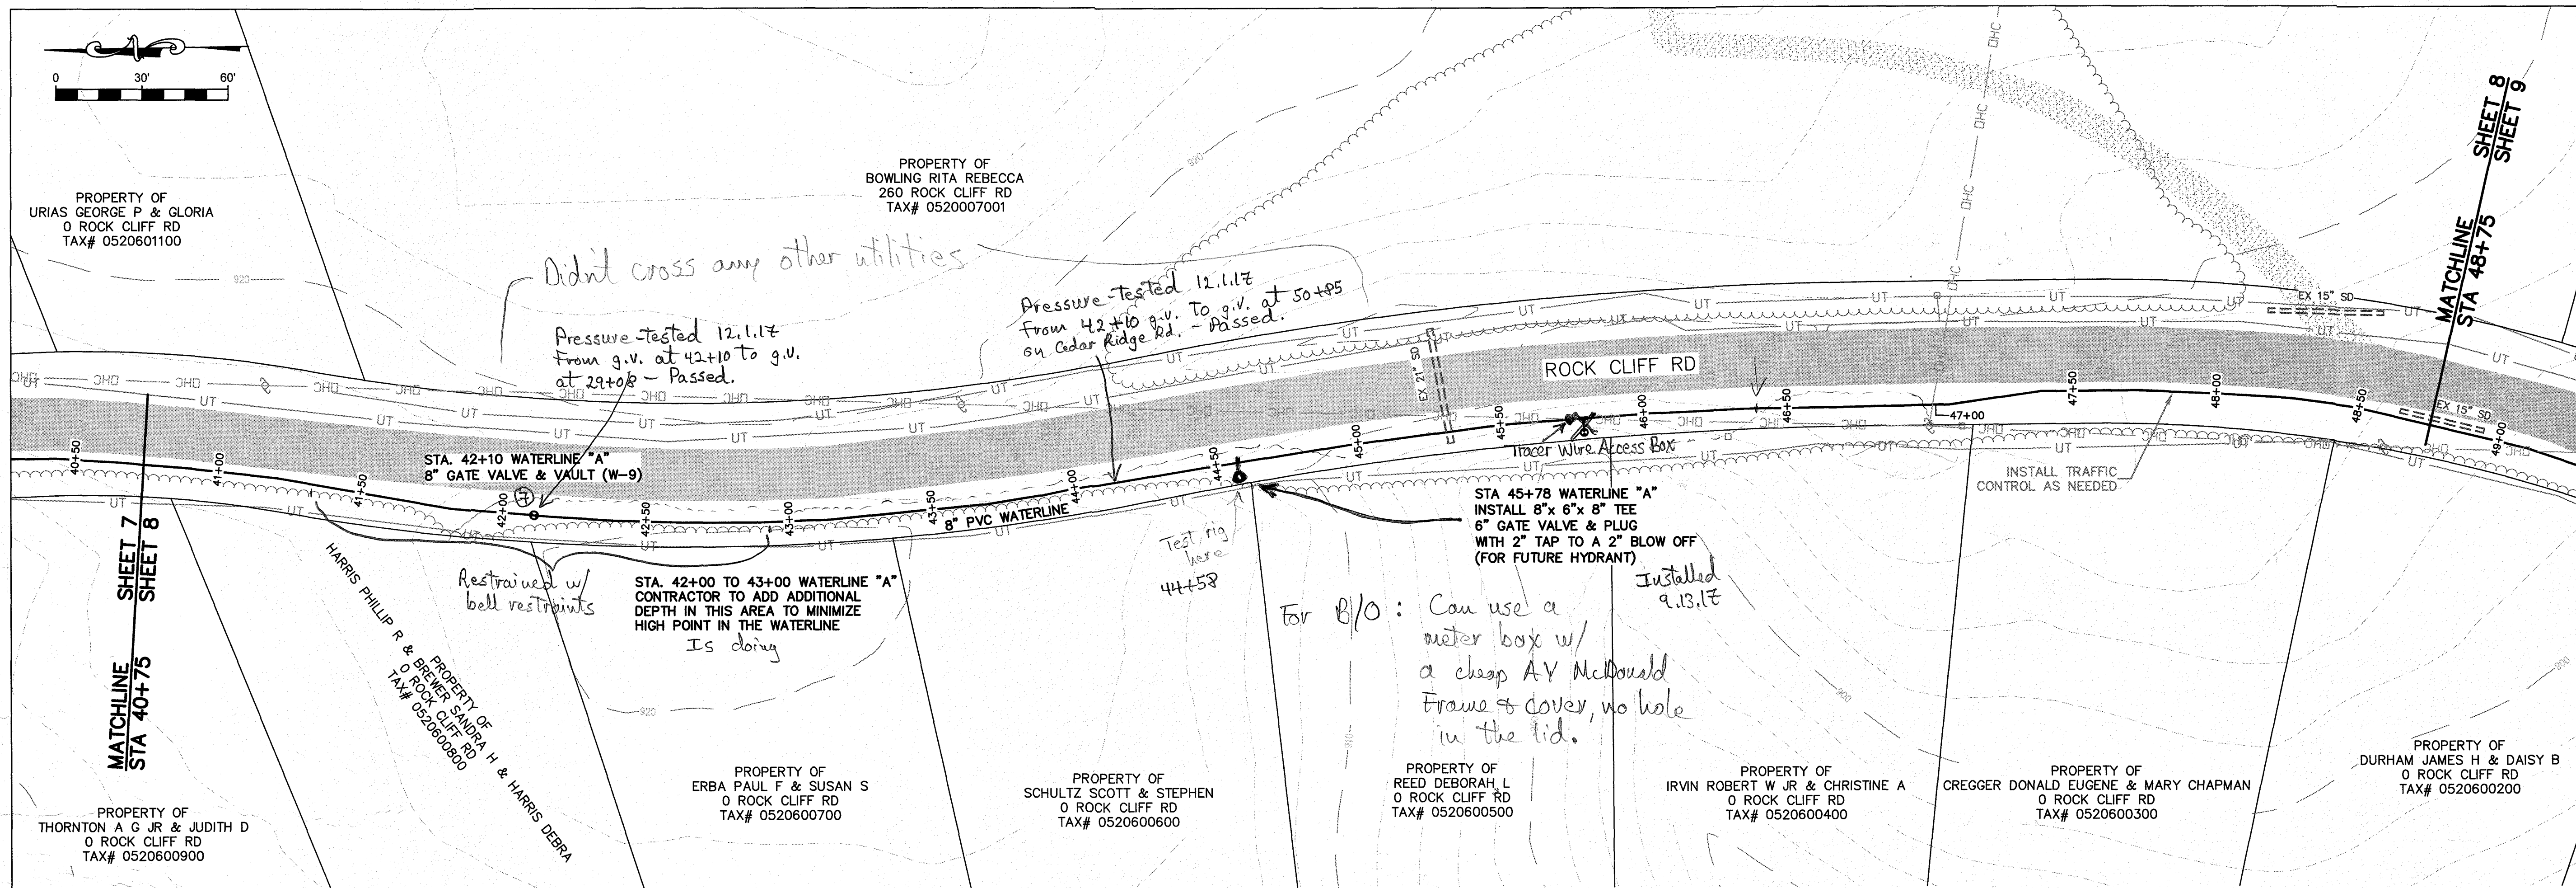


WATERLINE "A"

SCALE
VERTICAL: 1" = 10'
HORIZONTAL: 1" = 30'

SCALE
VERTICAL: 1" = 10'
HORIZONTAL: 1" = 30'

VERTICAL: 1" = 10'
HORIZONTAL: 1" = 30'

VERTICAL: 1" = 10'
HORIZONTAL: 1" = 30'

WATERLINE NOTES:

1. ALL UTILITY CROSSINGS SHALL BE POTHOLED AHEAD OF CONSTRUCTION TO VERIFY CROSSING ELEVATIONS.
2. MINIMUM COVER ON ALL WATERLINES SHALL BE 3'.
3. WATERMAIN SHALL BE INSTALLED 3' OFF EDGE OF PAVEMENT.
4. ALL UTILITY CROSSINGS SHALL HAVE 18" MIN. SEPARATION OR CONTRACTOR SHALL UTILIZE WYMA STANDARD G-8 CONCRETE PIER DETAIL.

2. MINIMUM COVER ON ALL WATERLINES SHALL BE 3'.

3. WATERMAIN SHALL BE INSTALLED 3' OFF EDGE OF PAVEMENT.

4. ALL UTILITY CROSSINGS SHALL HAVE 18" MIN. SEPARATION OR CONTRACTOR. SHALL UTILIZE WWA STANDARD G-8 CONCRETE PIER DETAIL.

WESTERN VIRGINIA
WATER AUTHORITY


WATER AUTHORITY

ENGINEERING SERVICES

JEFFERSON ST, SUITE 300
ROANOKE, VA 24011

RUANOKE, VA 24011
540-853-5700

RUANOKE, VA 24011
540-853-5700

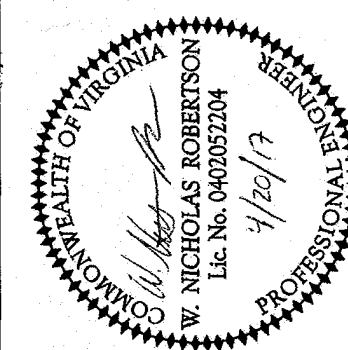

FRANKLIN COUNTY WATER
SYSTEMS CONNECTIONS 2017

FRANKLIN COUNTY WATER
SYSTEMS CONNECTIONS 2017

PLAN & PROFILE

Rev	Description	Date	By

Designed:
Drawn: NSS, DRJ
Checked:
Approved:
Date:
Project: