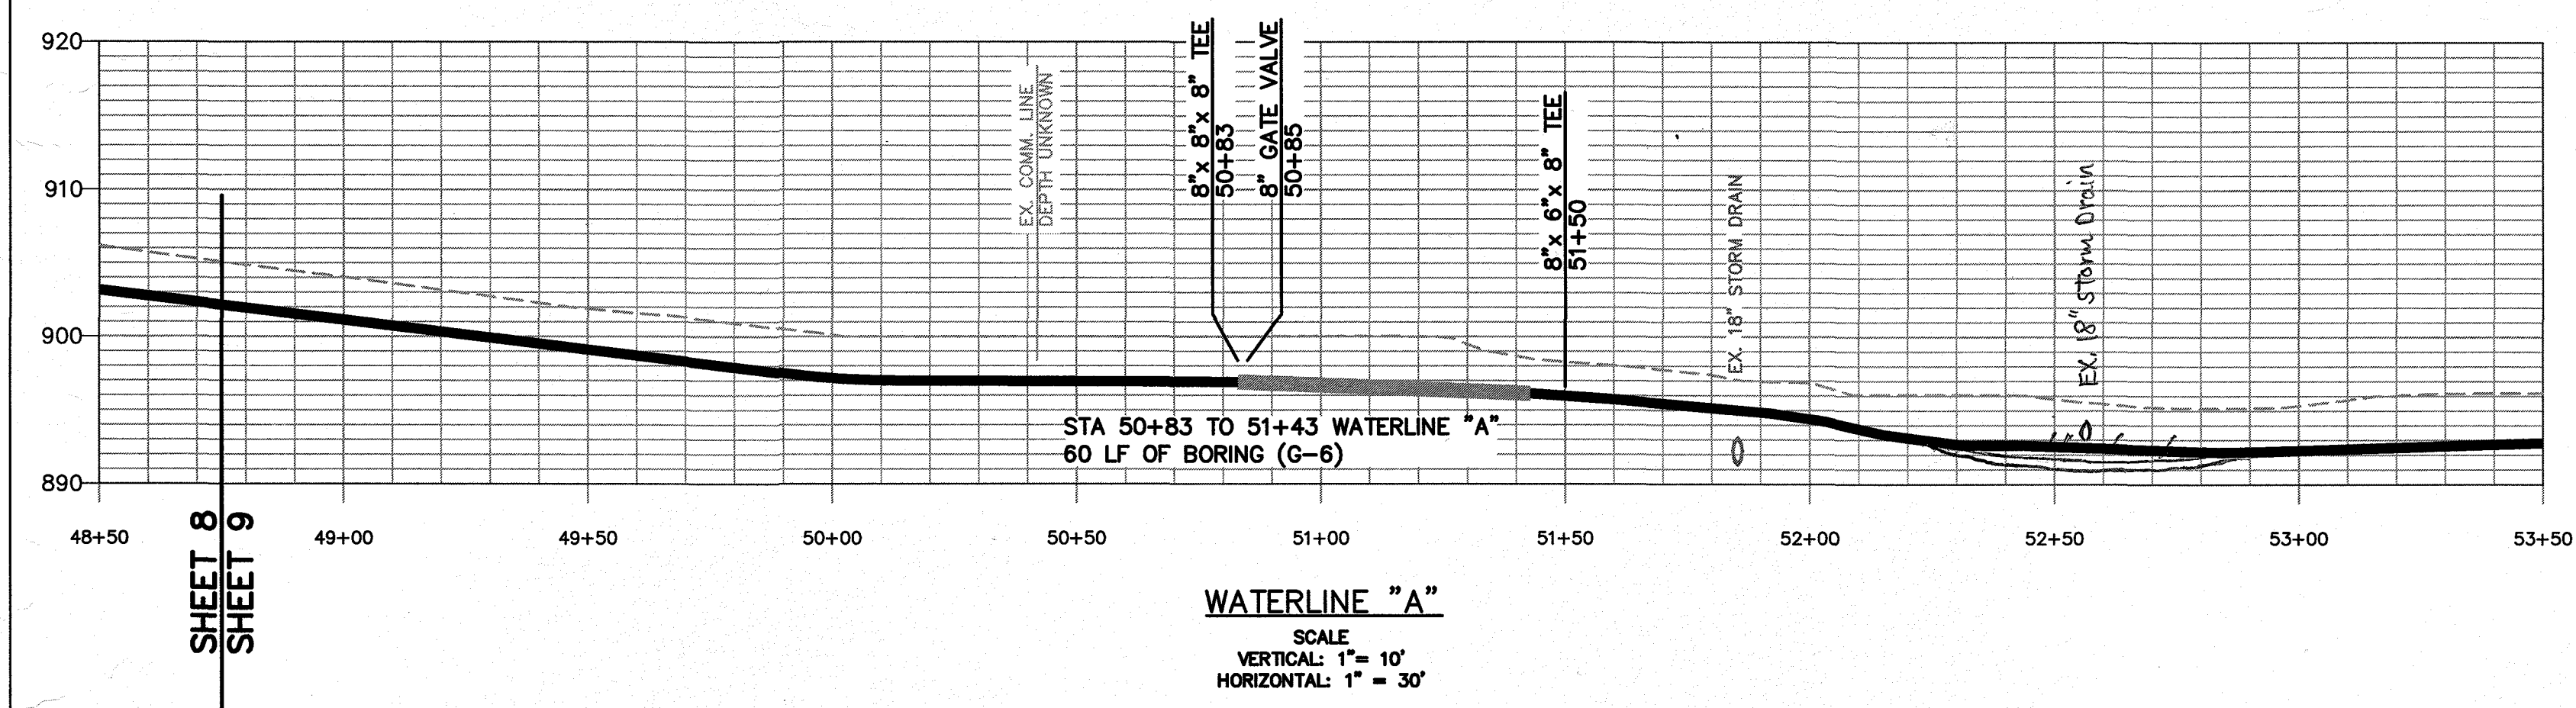
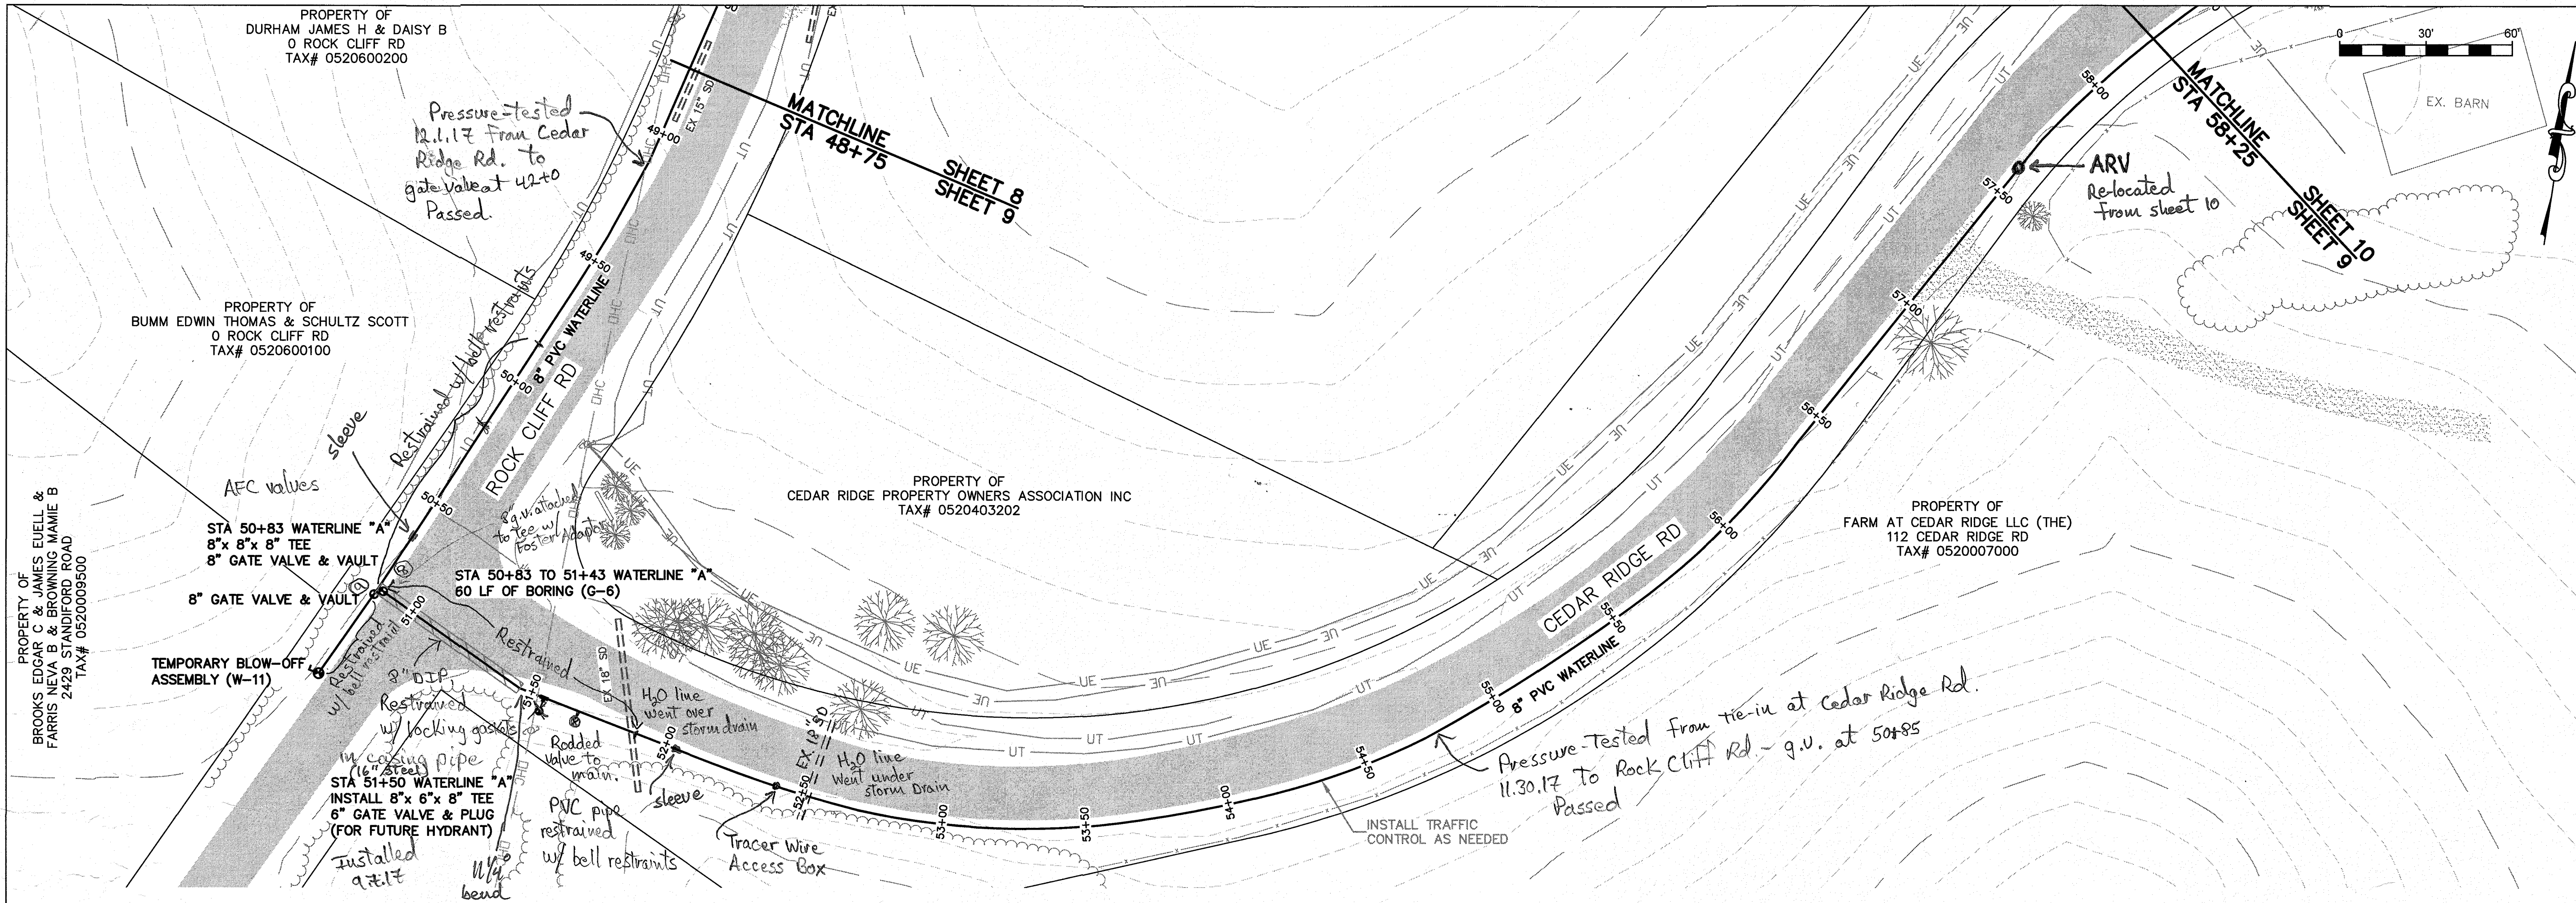


- WATERLINE NOTES:
1. ALL UTILITY CROSSINGS SHALL BE POTHOLED AHEAD OF CONSTRUCTION TO VERIFY CROSSING ELEVATIONS.
 2. MINIMUM COVER ON ALL WATERLINES SHALL BE 3'.
 3. WATERMAIN SHALL BE INSTALLED 3' OFF EDGE OF PAVEMENT.
 4. ALL UTILITY CROSSINGS SHALL HAVE 18" MIN. SEPARATION OR CONTRACTOR SHALL UTILIZE WYMA STANDARD G-8 CONCRETE PIER DETAIL.

WESTERN VIRGINIA

FRANKLIN COUNTY WATER

ENGINEERING SERVICES

601 S JEFFERSON ST, SUITE 300
ROANOKE, VA 24011
540-853-5700

SYSTEMS CONNECTIONS 2017

PLAN & PROFILE

Rev	Description	Date	By
1	CHANGED OPEN CUT TO BORE	6/1/17	DRJ

Designed:
Drawn: NSS, DRJ
Checked:
Approved:
Date:
Project:

9
Sheet 9 of 19