
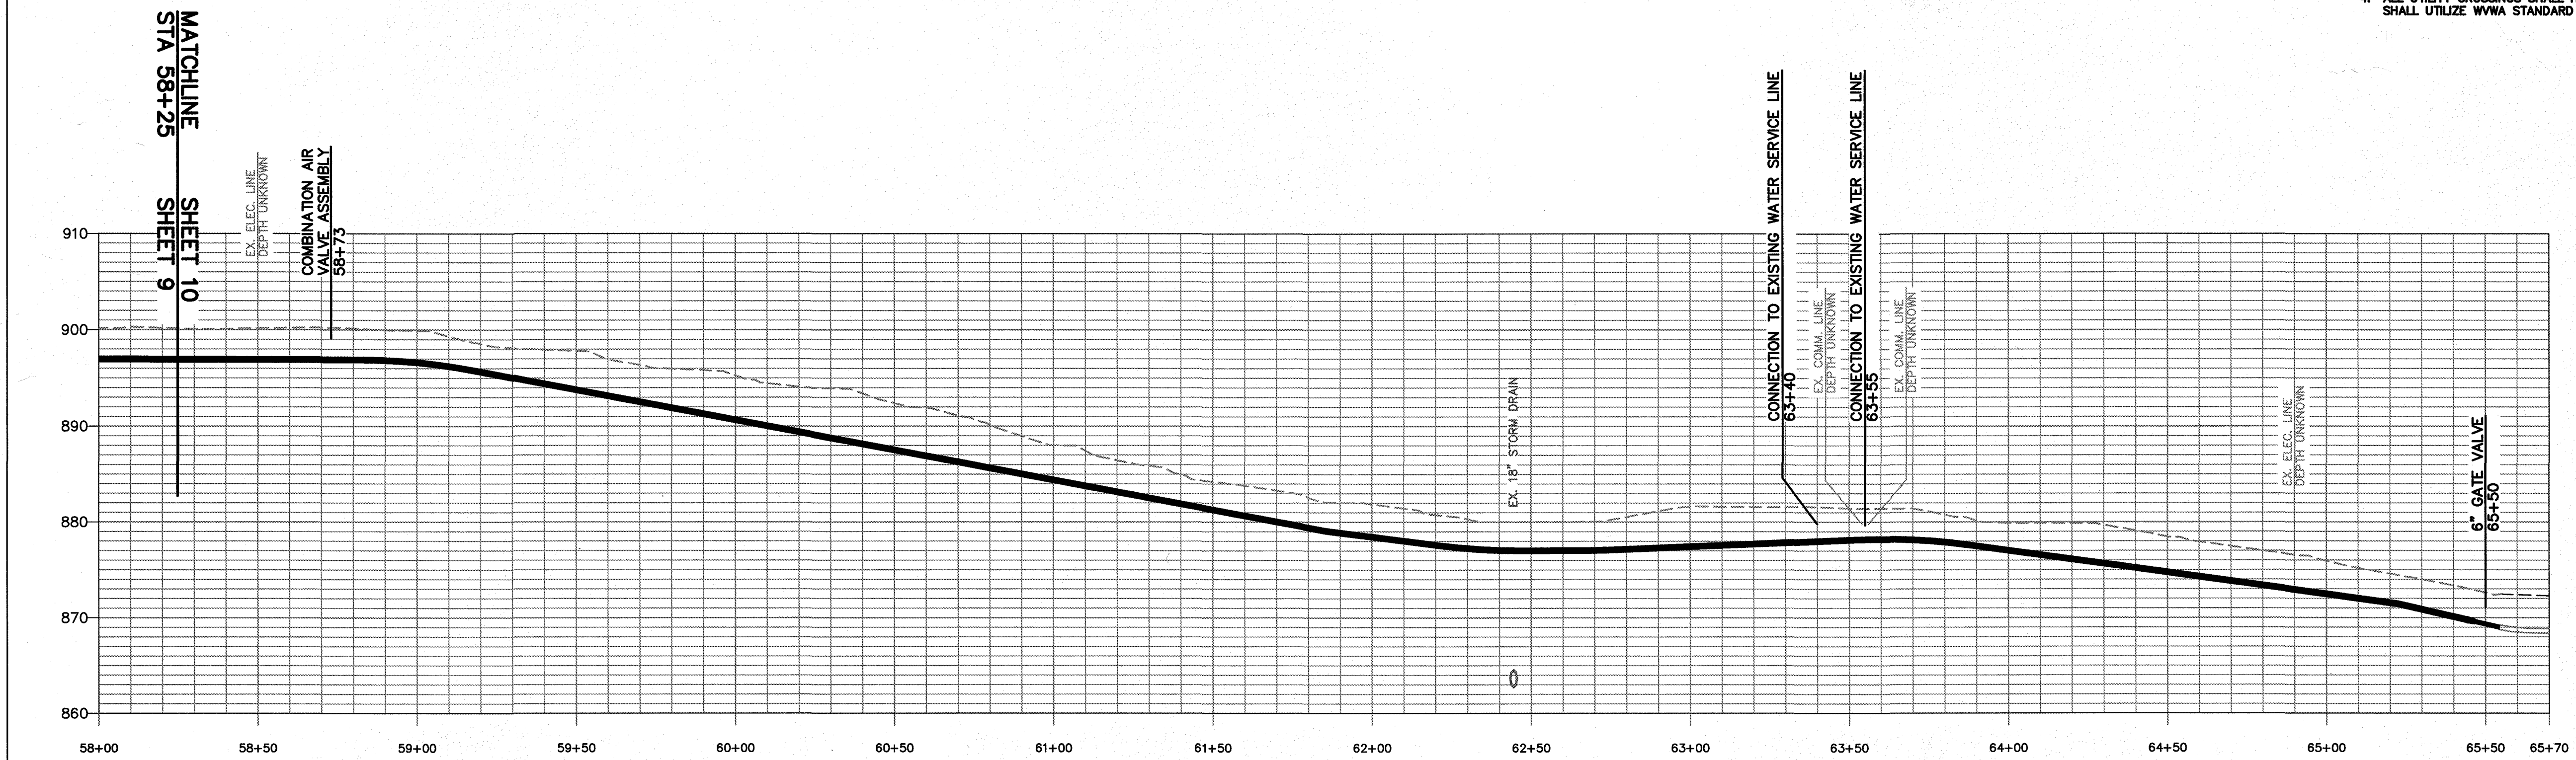


A capped 6" line was found in place of the shown 2" line - 225 Cedar Ridge Rd. is tied into it - Greg found the connection.

Greg will install an 8" g.v. just before the 6". they make the connection after Eac-Ts pass. Will do away w/ the 1" R/O.

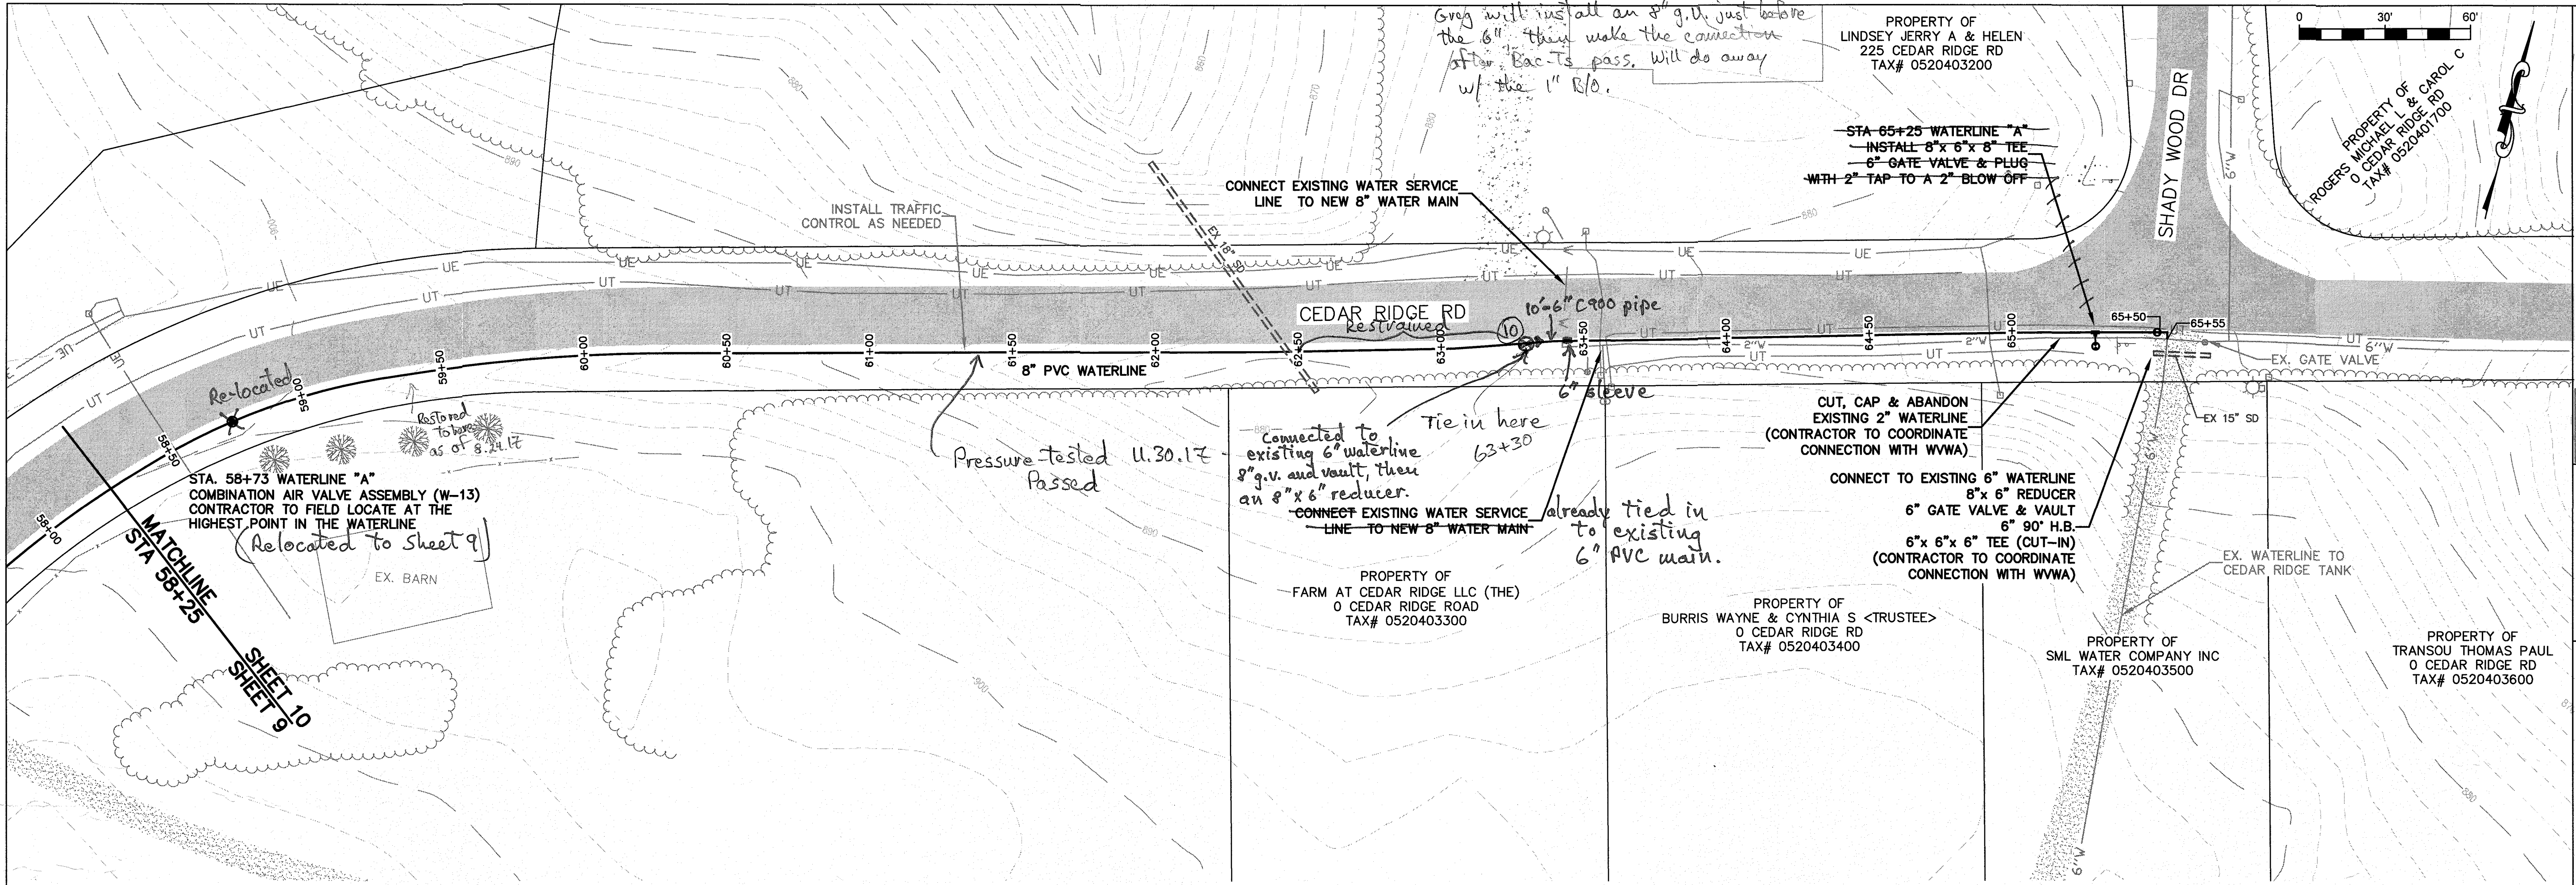

WATERLINE "A"
SCALE
VERTICAL: 1" = 10'
HORIZONTAL: 1" = 30'

- WATERLINE NOTES:
1. ALL UTILITY CROSSINGS SHALL BE POTHoled AHEAD OF CONSTRUCTION TO VERIFY CROSSING ELEVATIONS.
 2. MINIMUM COVER ON ALL WATERLINES SHALL BE 3'.
 3. WATERMAIN SHALL BE INSTALLED 3' OFF EDGE OF PAVEMENT.
 4. ALL UTILITY CROSSINGS SHALL HAVE 18" MIN. SEPARATION OR CONTRACTOR SHALL UTILIZE WYMA STANDARD G-8 CONCRETE PIER DETAIL.

WESTERN VIRGINIA
WATER AUTHORITY
ENGINEERING SERVICES
601 S JEFFERSON ST, SUITE 300
ROANOKE, VA 24011
540-853-5700

FRANKLIN COUNTY WATER
SYSTEMS CONNECTIONS 2017

PLAN & PROFILE

Rev	Description	Date	By

Designed:
Drawn: NSS, DRJ
Checked:
Approved:
Date:
Project:
10
Sheet 10 of 19