


- WATERLINE NOTES:**
1. ALL UTILITY CROSSINGS SHALL BE POTHOLED AHEAD OF CONSTRUCTION TO VERIFY CROSSING ELEVATIONS.
  2. MINIMUM COVER ON ALL WATERLINES SHALL BE 3'.
  3. WATERMAIN SHALL BE INSTALLED 3" OFF EDGE OF PAVEMENT.
  4. ALL UTILITY CROSSINGS SHALL HAVE 18" MIN. SEPARATION OR CONTRACTOR SHALL UTILIZE WWVA STANDARD G-6 CONCRETE PIER DETAIL.

STA 12+83 TO 12+93 WATERLINE "C"  
10 LF OF BORING (G-6)  
Casing pipe not used.  
4" C900 PVC carrier pipe used


Tracer Wire Access Box

STA 15+40 TO 16+00 WATERLINE "C"  
60 LF OF BORING (G-6)

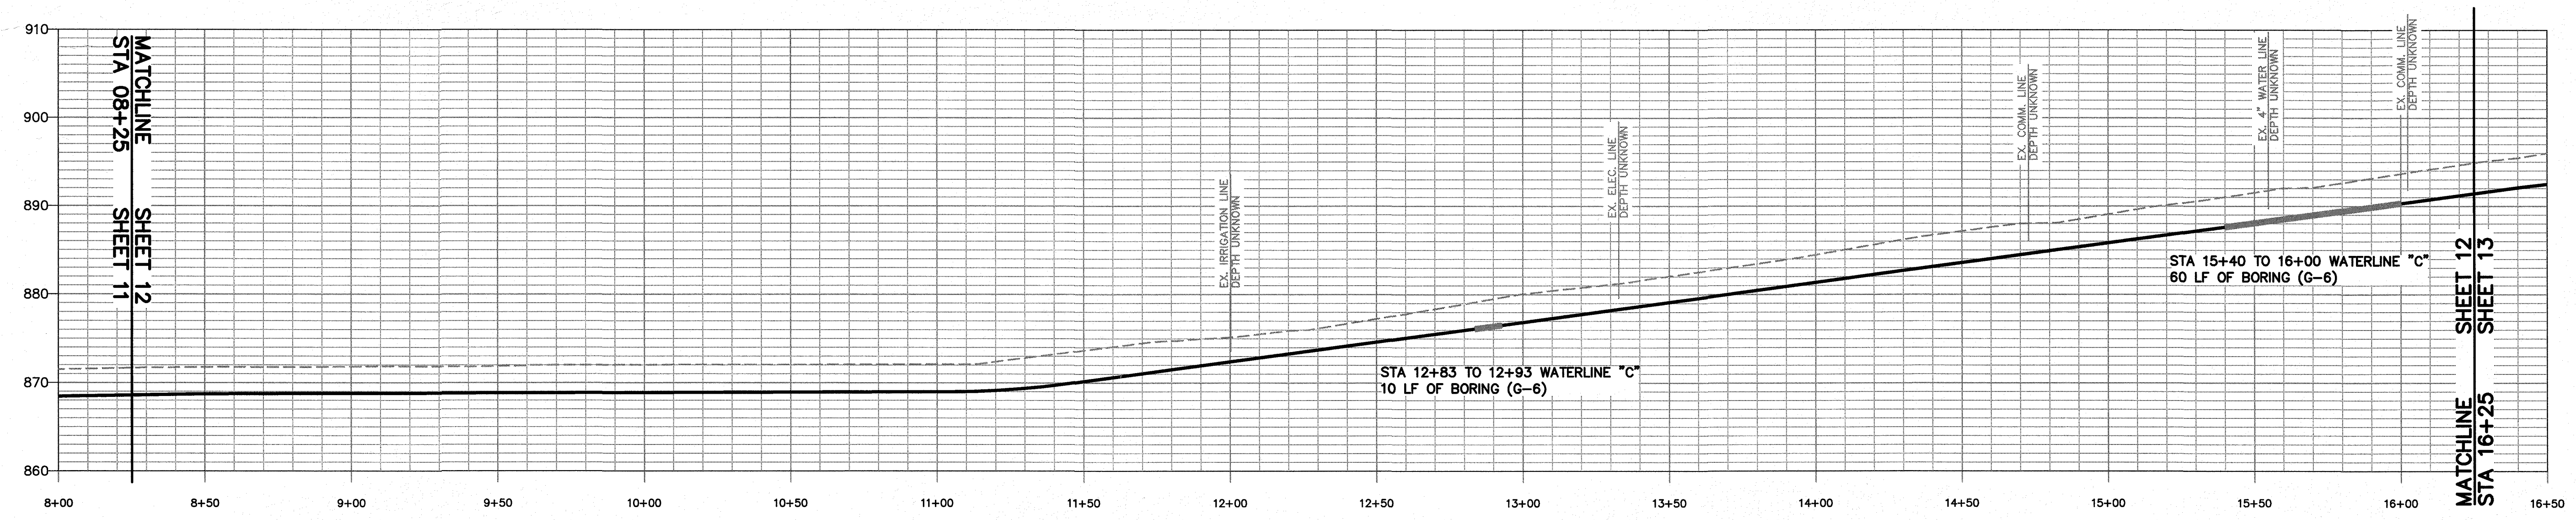

**WATERLINE "C"**  
SCALE:  
VERTICAL: 1" = 10'  
HORIZONTAL: 1" = 30'

WESTERN VIRGINIA  
**WATER AUTHORITY**  
ENGINEERING SERVICES  
601 S JEFFERSON ST, SUITE 300  
ROANOKE, VA 24011  
540-853-5700

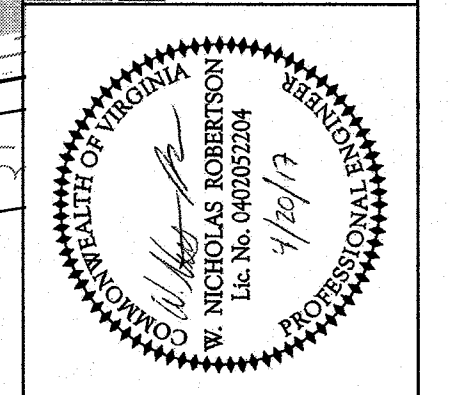

FRANKLIN COUNTY WATER  
SYSTEMS CONNECTIONS 2017  
PLAN & PROFILE

Rev	Description	Date	By

Designed:  
Drawn: DRJ  
Checked:  
Approved:  
Date:  
Project:  
  
12  
Sheet 12 of 19