



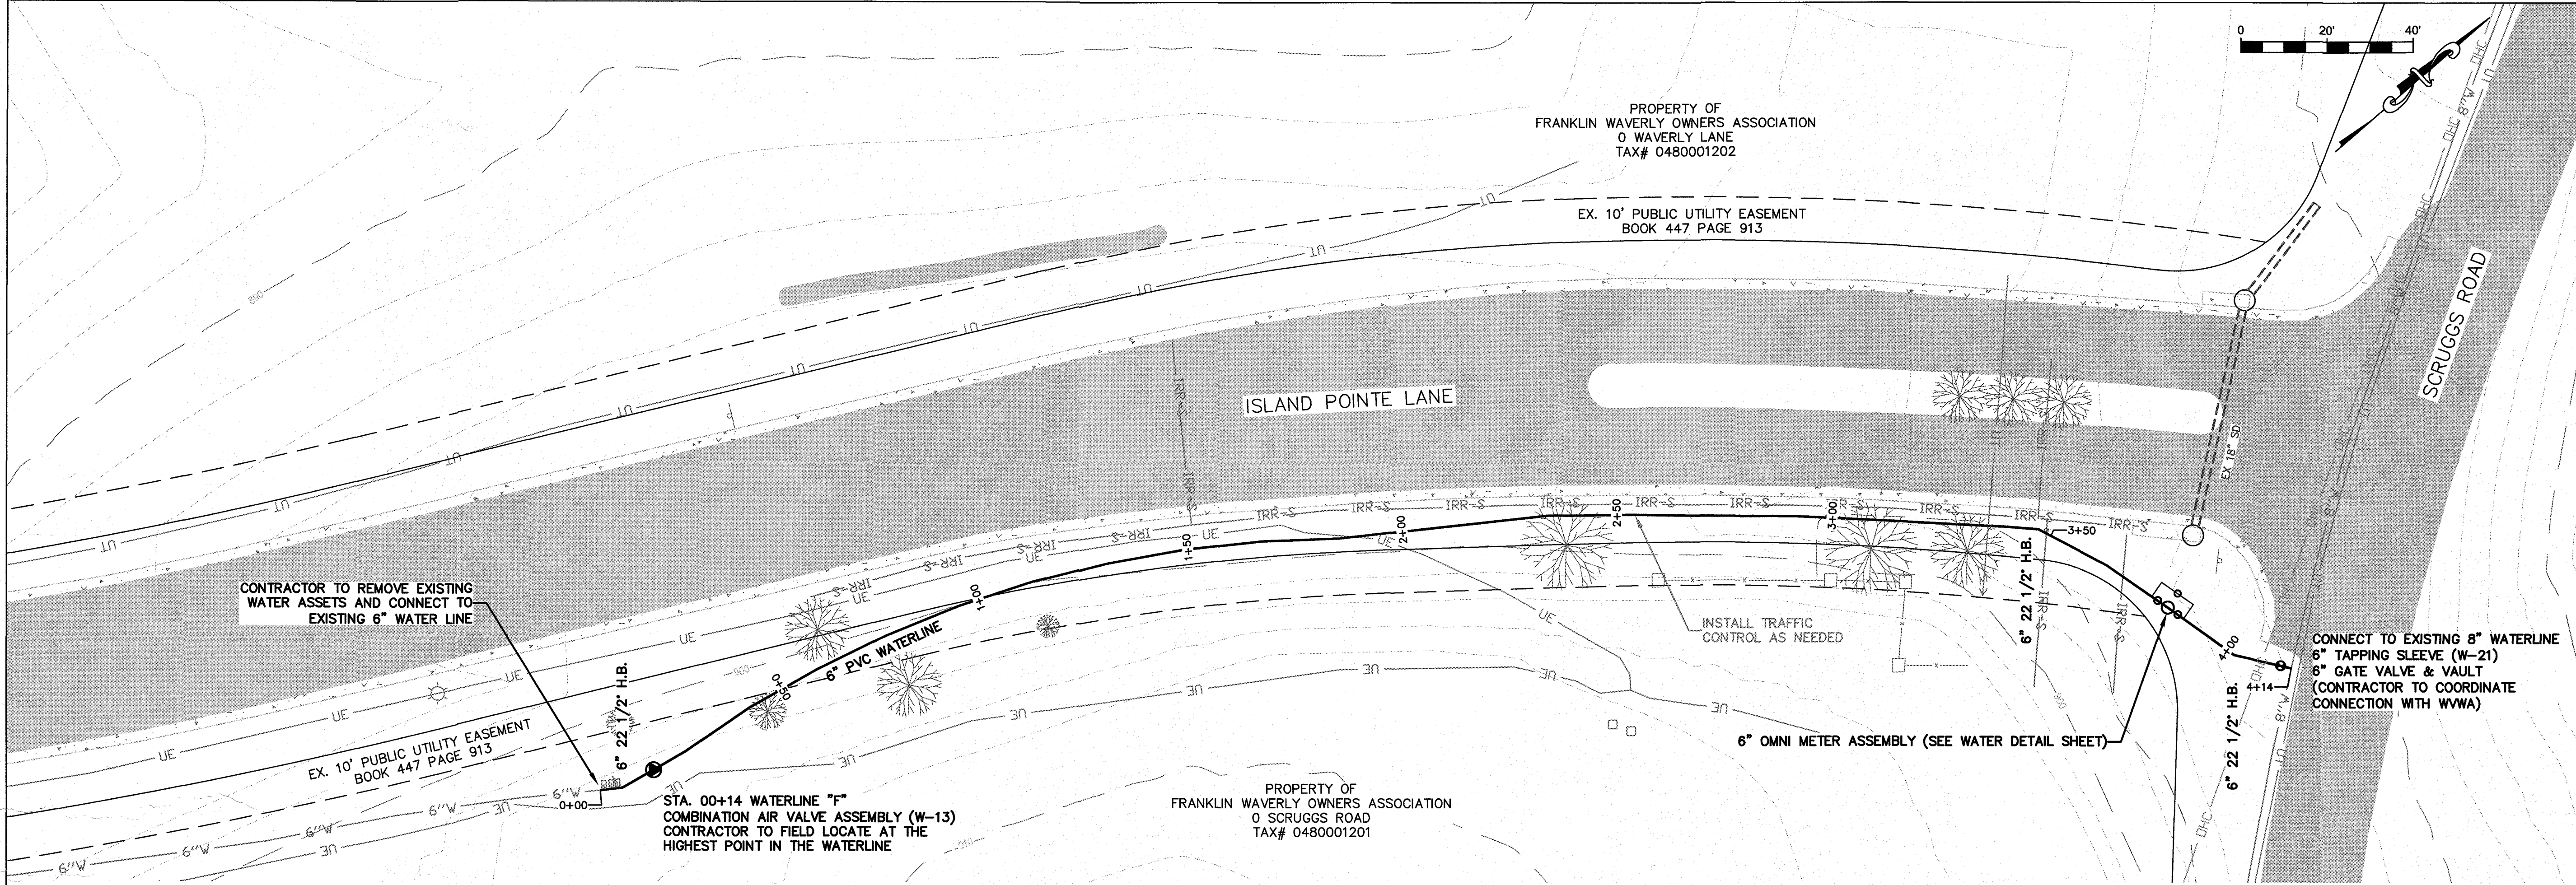

- WATERLINE NOTES:
- 1. ALL UTILITY CROSSINGS SHALL BE POTHOLED AHEAD OF CONSTRUCTION TO VERIFY CROSSING ELEVATIONS.
 - 2. MINIMUM COVER ON ALL WATERLINES SHALL BE 3'.
 - 3. WATERMAN SHALL BE INSTALLED 3' OFF EDGE OF PAVEMENT.
 - 4. ALL UTILITY CROSSINGS SHALL HAVE 18" MIN. SEPARATION OR CONTRACTOR SHALL UTILIZE WVWA STANDARD G-5 CONCRETE PIER DETAIL.

THIS PAGE IS NOT PART OF THIS BID.
WORK ON THIS PAGE WILL BE DONE BY WVWA FORCES.

WORK WAS INSTALLED BY WVWA FIELD OPERATIONS 9/18/2017.
FOR AS-BUILT, SEE SEPARATE PROJECT: ISLAND POINTE LANE WATERLINE INTERCONNECT

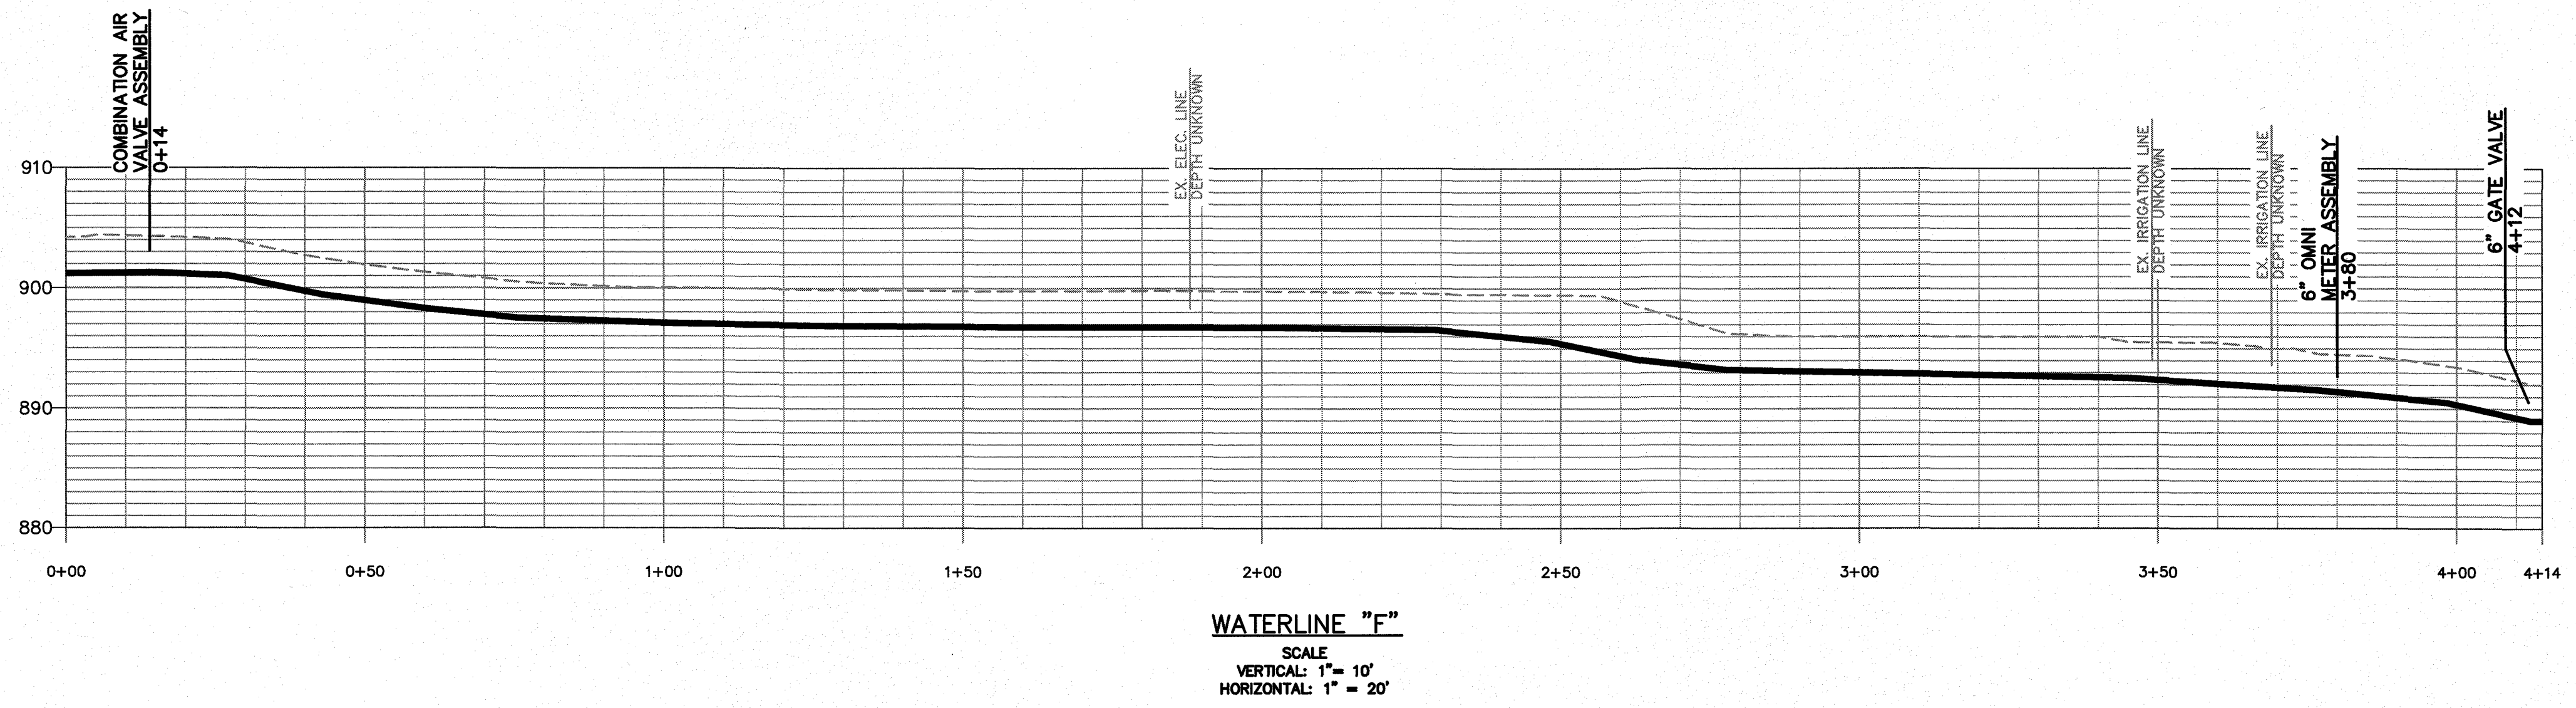

WESTERN VIRGINIA

WATER AUTHORITY

ENGINEERING SERVICES
601 S. JEFFERSON ST., SUITE 300
ROANOKE, VA 24011
540-853-5700

FRANKLIN COUNTY WATER
SYSTEMS CONNECTIONS 2017

PLAN & PROFILE

Rev	Description	Date	By

Designed: _____
Drawn: DRJ
Checked: _____
Approved: _____
Date: _____
Project: _____

16
Sheet 16 of 19