


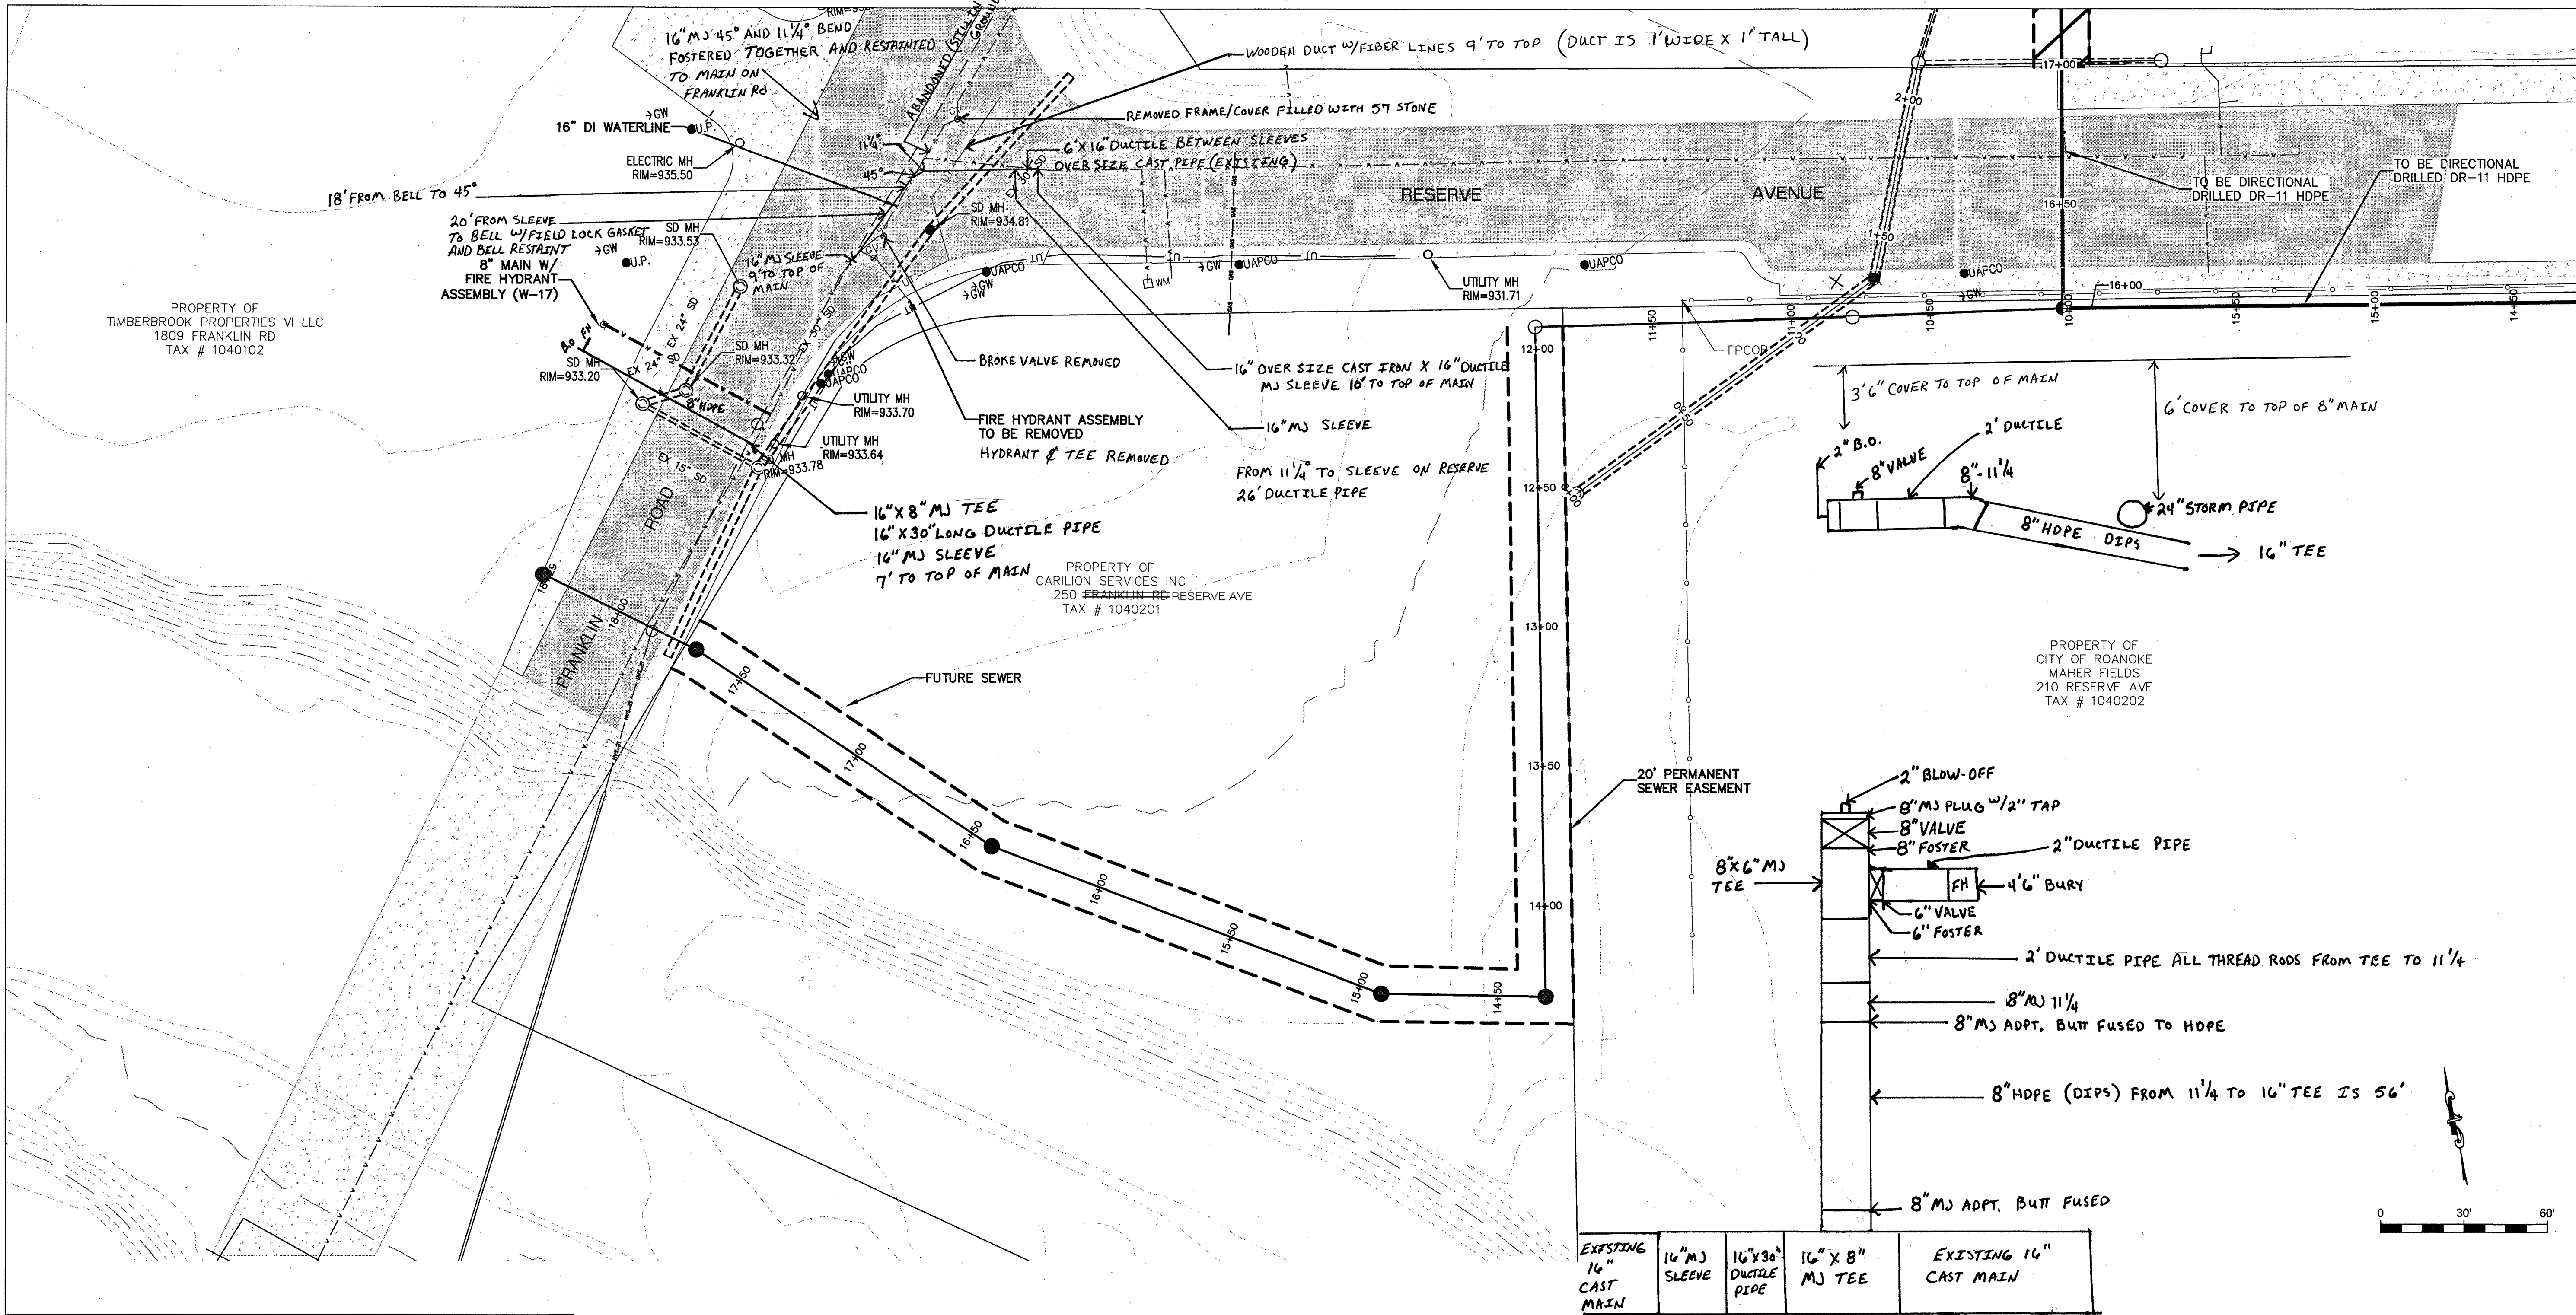

Project Name	
Install Contractor	Western VA Water Authority
Install Date	3-14-2018
Water Main(s)	
Manufacturer	US Pipe
Diameter	16"
Pipe Class	350
Material	Ductile Iron
Comments	
Water Valve(s) 1	
Manufacturer	AVK
Valve Type	GATE
Diameter	8" & 6"
Direction to Open / Turns to Close	LH
Comments	

16" Main goes over existing 30" storm drain and 1' under wooden fiber duct

WESTERN VIRGINIA

WATER AUTHORITY

ENGINEERING SERVICES
601 S JEFFERSON ST, SUITE 300
ROANOKE, VA 24011
540-853-5641 or 540-853-5770

FRANKLIN RD AND RESERVE AVE

WATERLINE RELOCATION

PLAN

By	
Date	
Description	
Rev	
1	HDPE REV. PER NICK

Designed: AAS

Drawn: AAS

Checked:

Approved:

Date: 2/27/18

Project:

1

Sheet 1 of 1

Derek Jones Engineering