


SECTION A-A

METHOD OF TREATMENT IN DROP INLETS

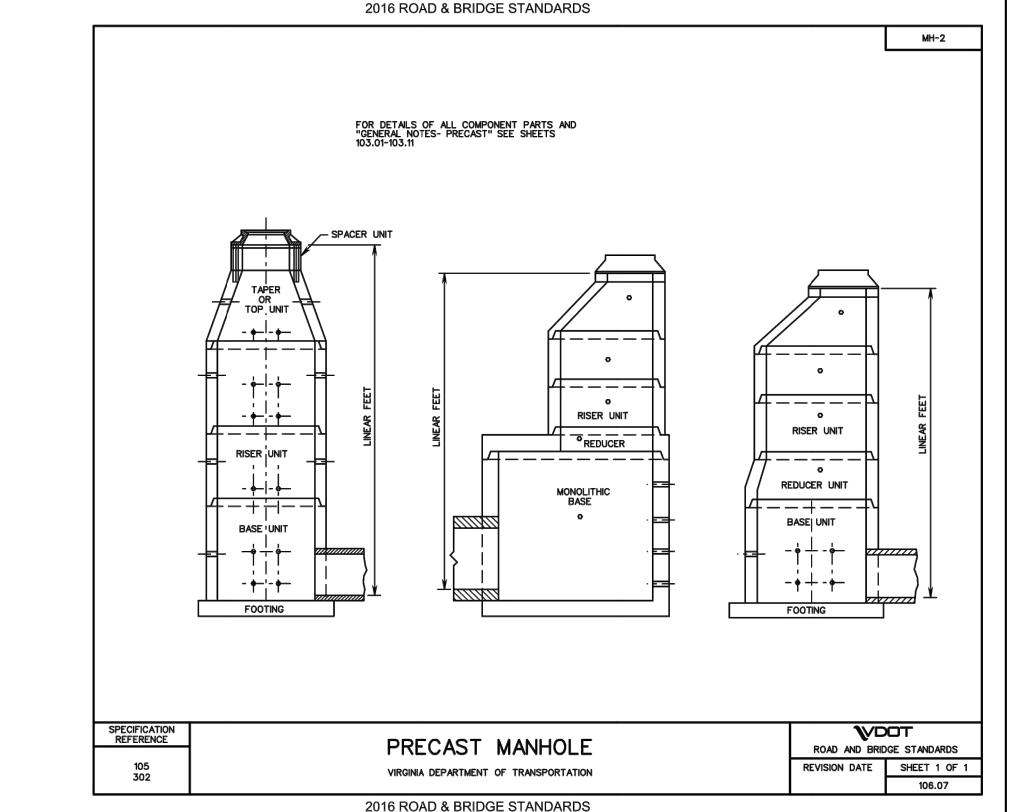

2016 ROAD & BRIDGE STANDARDS


<≥ _4 _4 _4__


RECOMMENDED MINIMUM HEIGHT CHART


<≥ <u>+</u> <u>+</u> <u>+</u> .

ALTERNATE TOP

4'-10"

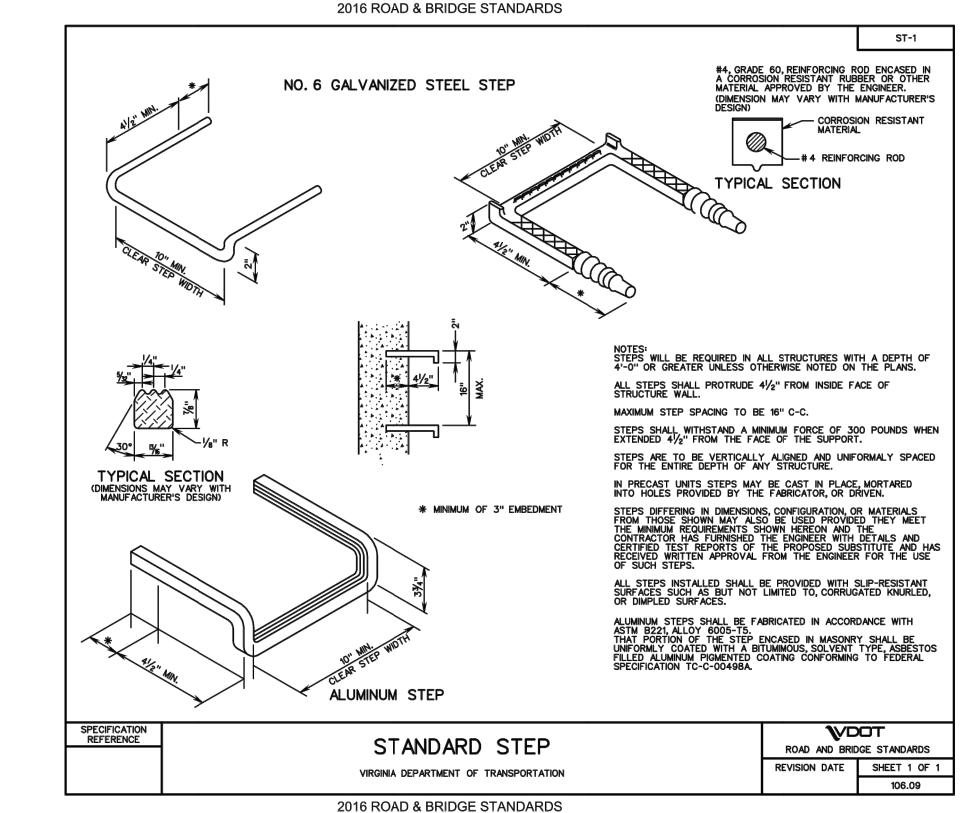

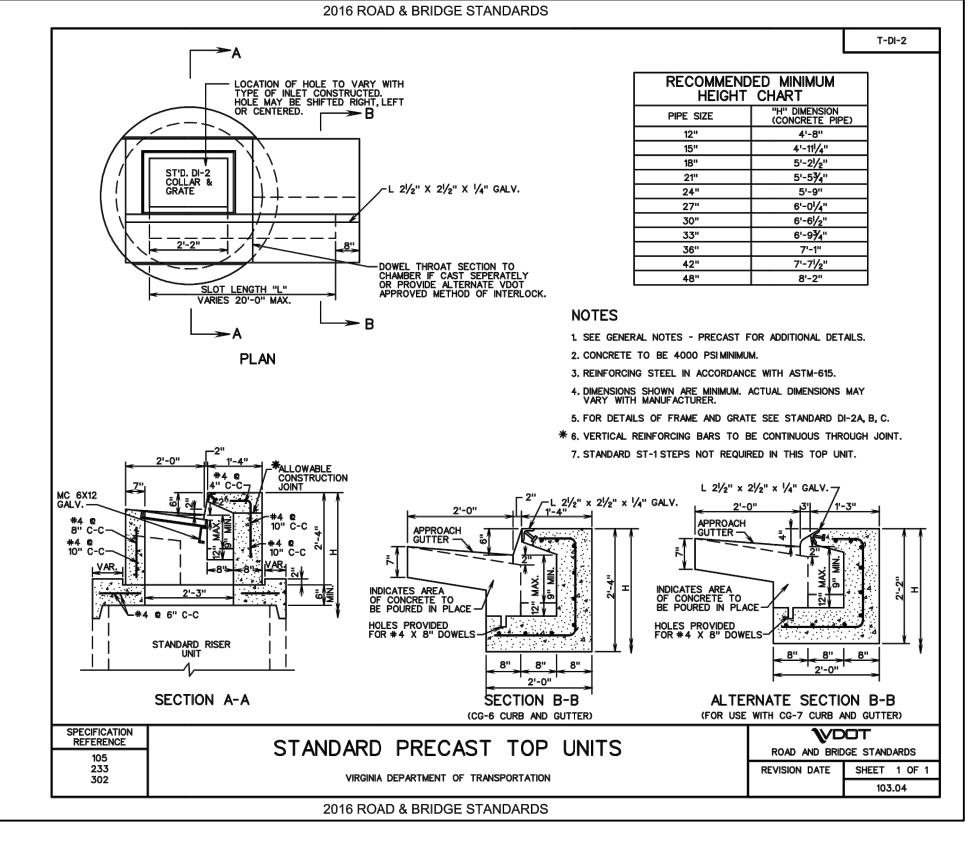


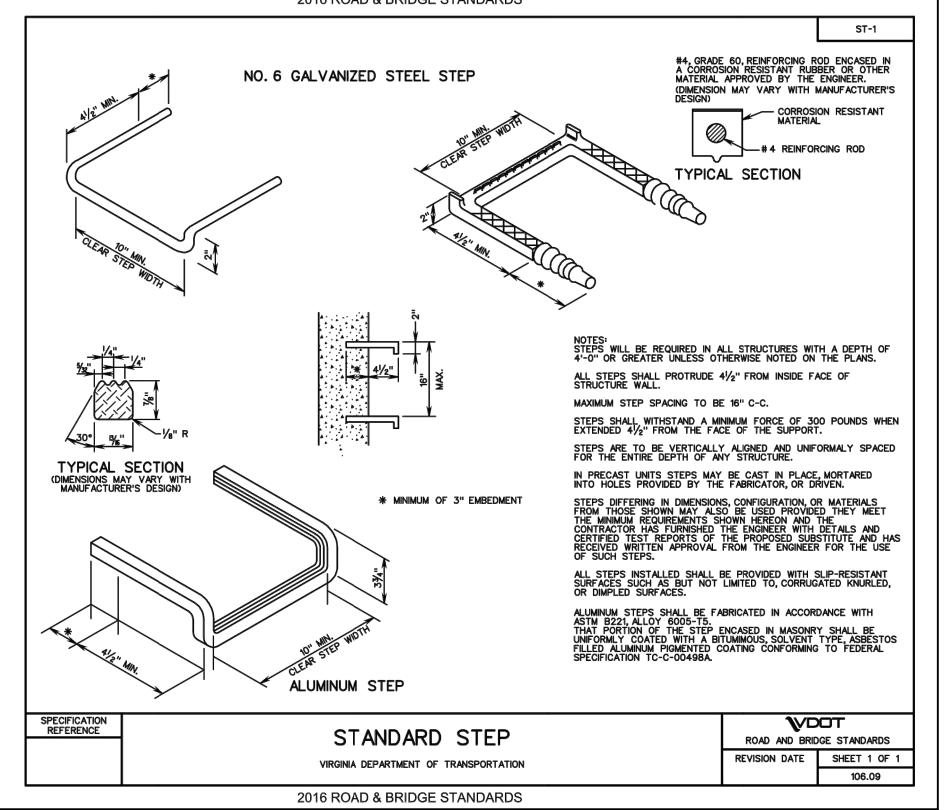



Plaza Suite 1 10 Church Avenue, SE Roanoke, VA 24011 540.342.6001





SPECTRUMPC.COM

NEW CONSTRUCTION FOR

GRTC TRANSIT STATION

CITY OF ROANOKE

Spectrum Design Project No.:



PROJ. MGR.: CHECKED BY: DRAWN BY: MAR CDL

SHEET ISSUE DATE: 07.30.2021

PROJECT PHASE:


CONSTRUCTION DOCUMENTS

KEY PLAN:

SHEET NAME:

CONSTRUCTION **DETAILS**

SHEET NUMBER:

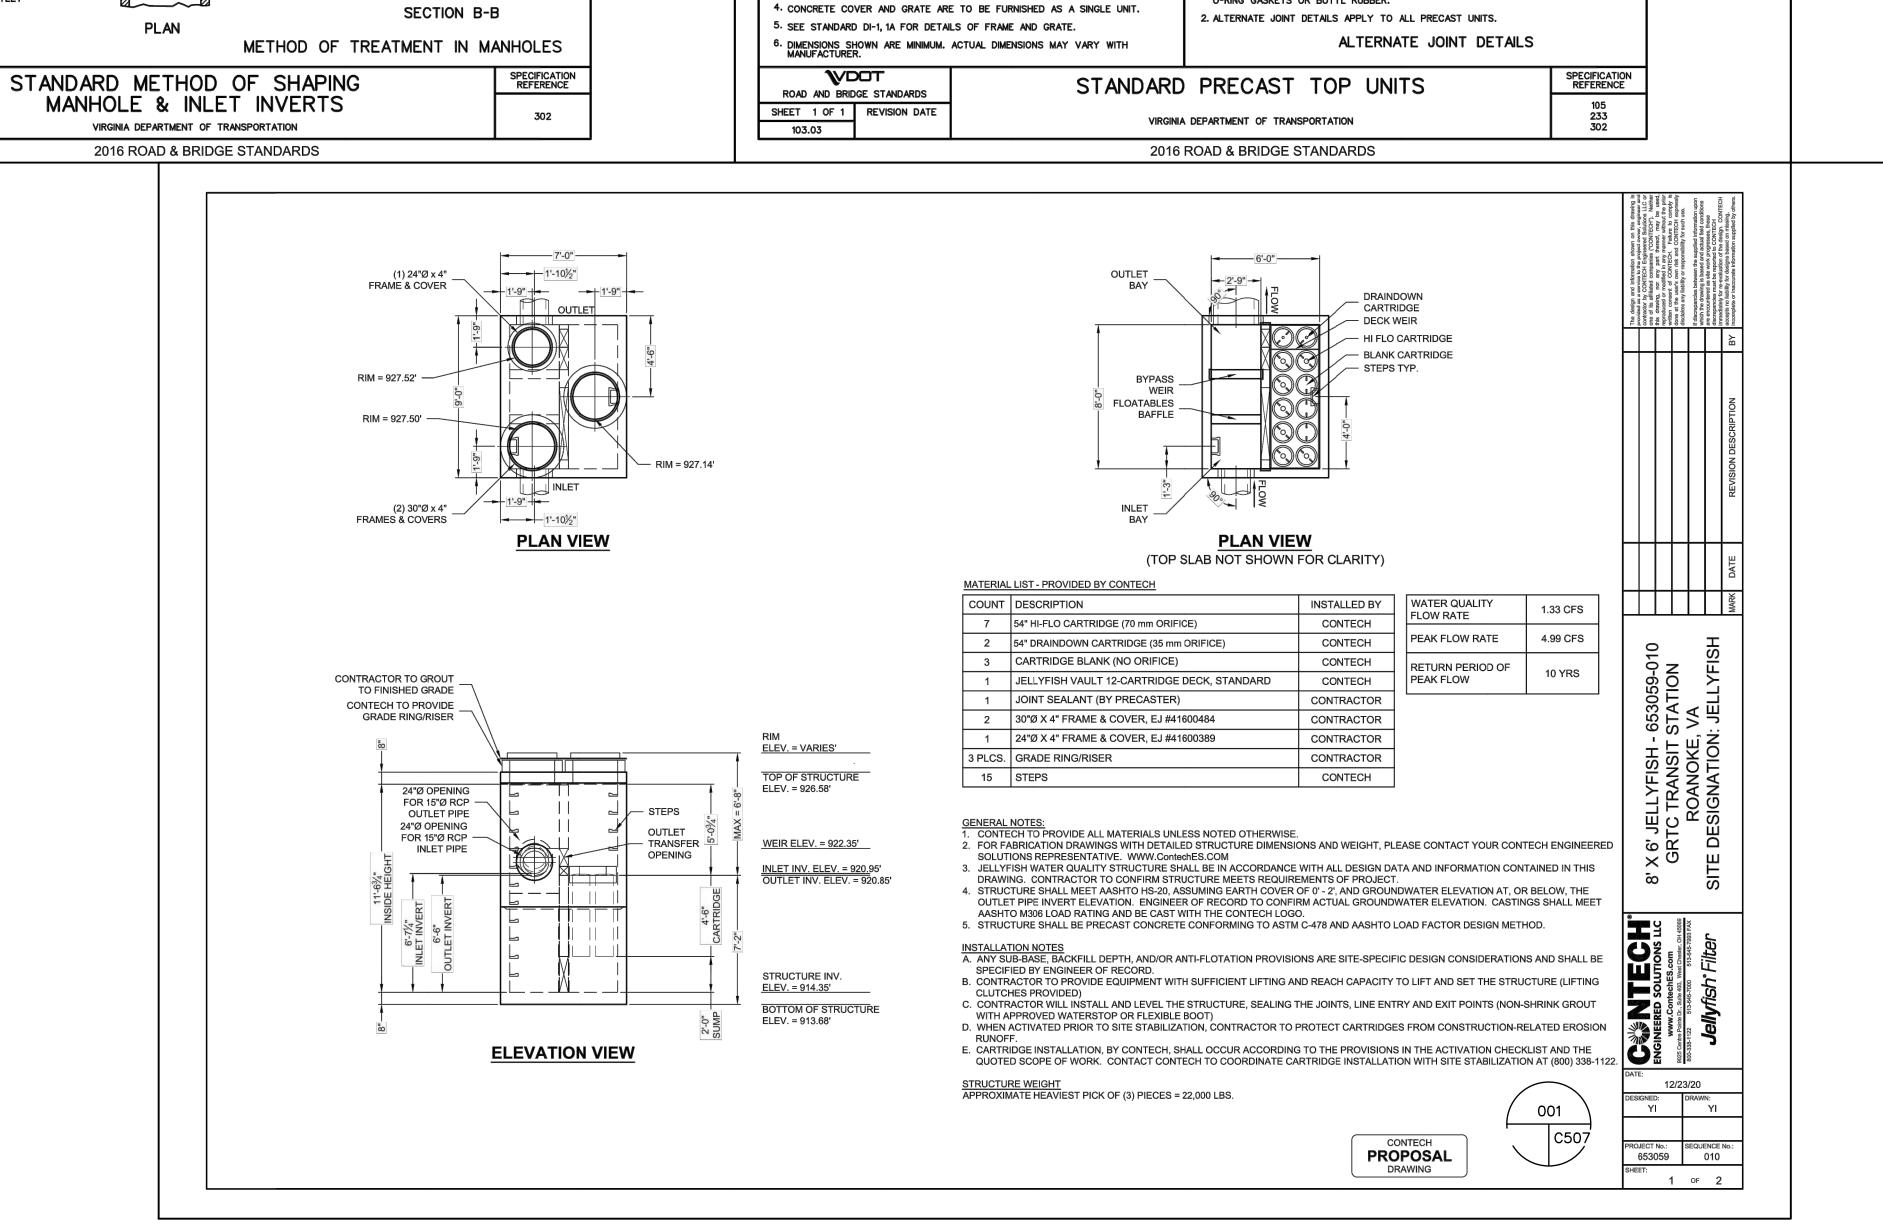

DI-1, 1A PC

1. SEE GENERAL NOTES PRECAST FOR ADDITIONAL DETAILS.

3. REINFORCING STEEL IN ACCORDANCE WITH ASTM C-478, ASTM A-497 (WIRE FABRIC) AND ASTM A-615 (REINFORCING BARS).

2. CONCRETE TO BE 4000 PSI MINIMUM.



ROAD AND BRIDGE STANDARDS

SHEET 1 OF 1 REVISION DATE

106.08