


APPROVED

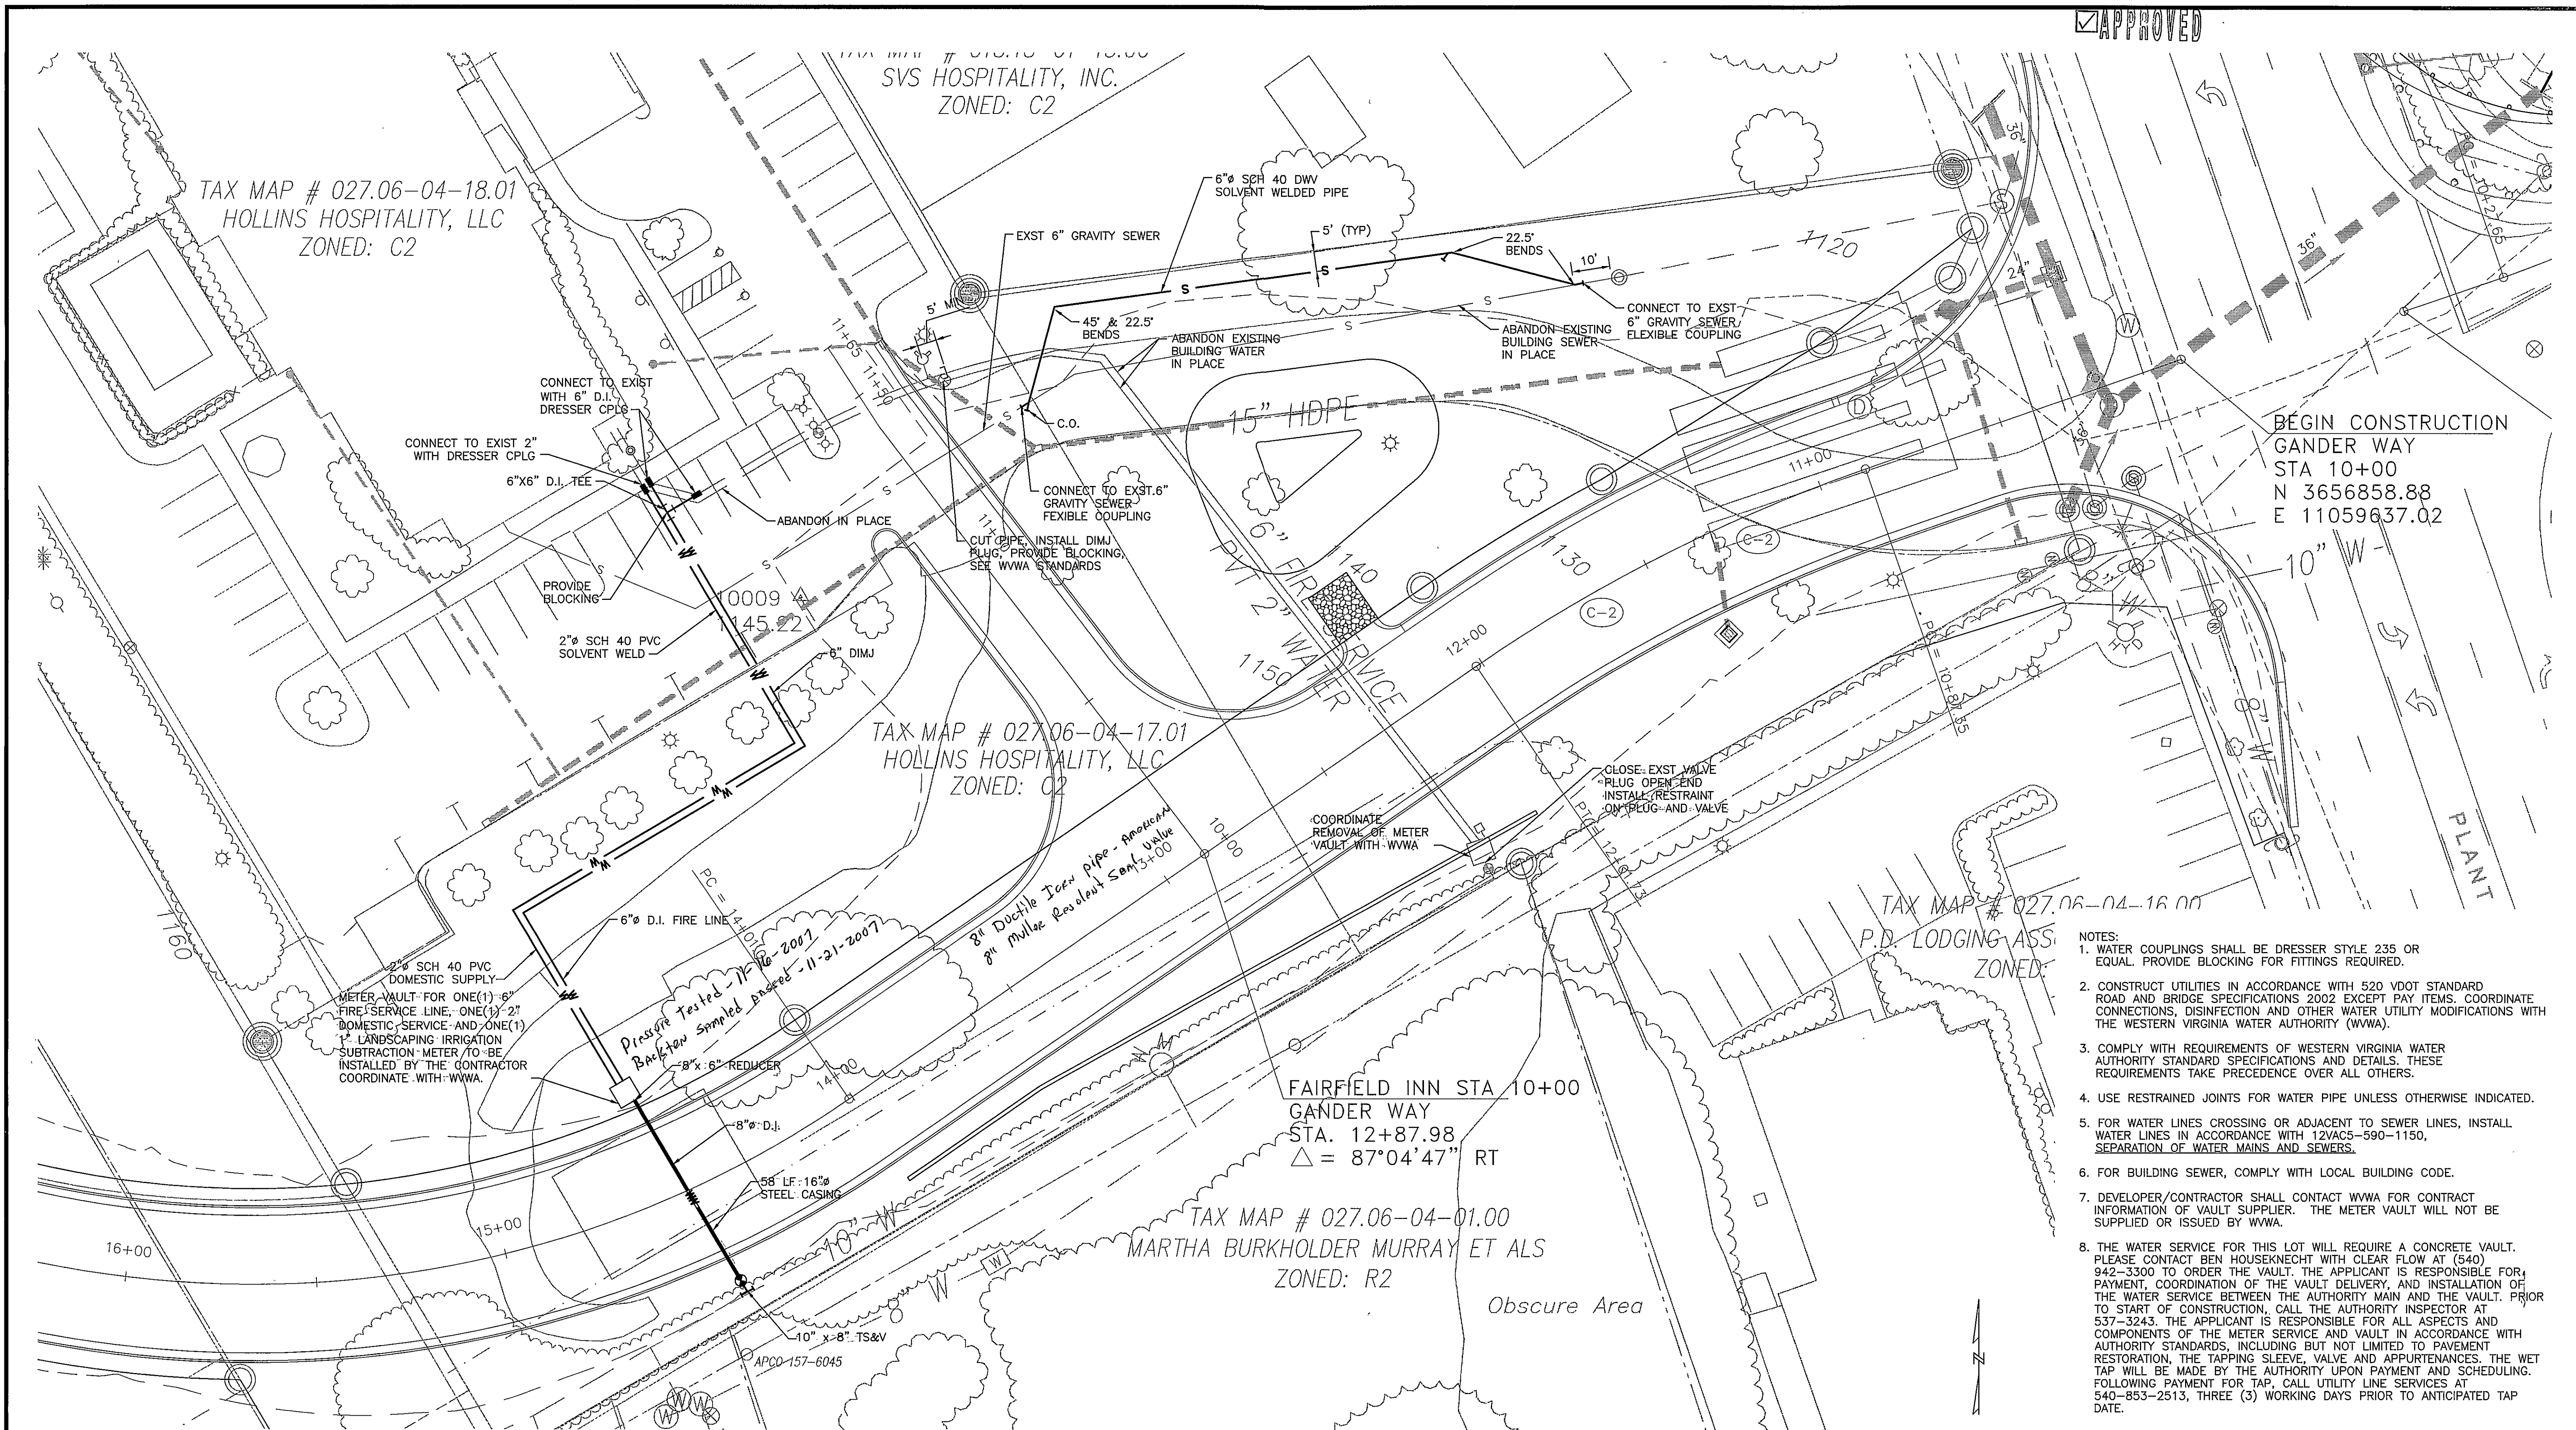

- NOTES:
1. WATER COUPLINGS SHALL BE DRESSER STYLE 235 OR EQUAL. PROVIDE BLOCKING FOR FITTINGS REQUIRED.
 2. CONSTRUCT UTILITIES IN ACCORDANCE WITH 520 VDOT STANDARD ROAD AND BRIDGE SPECIFICATIONS 2002 EXCEPT PAY ITEMS. COORDINATE CONNECTIONS, DISINFECTION AND OTHER WATER UTILITY MODIFICATIONS WITH THE WESTERN VIRGINIA WATER AUTHORITY (WVWA).
 3. COMPLY WITH REQUIREMENTS OF WESTERN VIRGINIA WATER AUTHORITY STANDARD SPECIFICATIONS AND DETAILS. THESE REQUIREMENTS TAKE PRECEDENCE OVER ALL OTHERS.
 4. USE RESTRAINED JOINTS FOR WATER PIPE UNLESS OTHERWISE INDICATED.
 5. FOR WATER LINES CROSSING OR ADJACENT TO SEWER LINES, INSTALL WATER LINES IN ACCORDANCE WITH 12VAC5-590-1150, SEPARATION OF WATER MAINS AND SEWERS.
 6. FOR BUILDING SEWER, COMPLY WITH LOCAL BUILDING CODE.
 7. DEVELOPER/CONTRACTOR SHALL CONTACT WVWA FOR CONTRACT INFORMATION OF VAULT SUPPLIER. THE METER VAULT WILL NOT BE SUPPLIED OR ISSUED BY WVWA.
 8. THE WATER SERVICE FOR THIS LOT WILL REQUIRE A CONCRETE VAULT. PLEASE CONTACT BEN HOUSEKNECHT WITH CLEAR FLOW AT (540) 942-3300 TO ORDER THE VAULT. THE APPLICANT IS RESPONSIBLE FOR PAYMENT, COORDINATION OF THE VAULT DELIVERY, AND INSTALLATION OF THE WATER SERVICE BETWEEN THE AUTHORITY MAIN AND THE VAULT. PRIOR TO START OF CONSTRUCTION, CALL THE AUTHORITY INSPECTOR AT 537-3243. THE APPLICANT IS RESPONSIBLE FOR ALL ASPECTS AND COMPONENTS OF THE METER SERVICE AND VAULT IN ACCORDANCE WITH AUTHORITY STANDARDS, INCLUDING BUT NOT LIMITED TO PAVEMENT RESTORATION, THE TAPPING SLEEVE, VALVE AND APPURTENANCES. THE WET TAP WILL BE MADE BY THE AUTHORITY UPON PAYMENT AND SCHEDULING. FOLLOWING PAYMENT FOR TAP, CALL UTILITY LINE SERVICES AT 540-853-2513, THREE (3) WORKING DAYS PRIOR TO ANTICIPATED TAP DATE.


UTILITY RELOCATION PLAN

SCALE: 1"=20'

GRAPHIC SCALE

20' 10' 0 20' 40'
1"=20'

SEALS

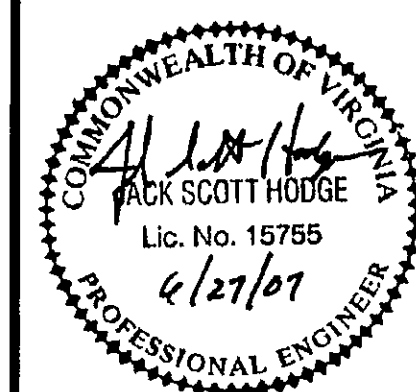

CONSULTANT

OPPIDAN RETAIL CENTER

OPPIDAN INVESTMENT COMPANY

ROANOKE COUNTY, VIRGINIA

HSMM

ARCHITECTS ENGINEERS PLANNERS
HAYES, SEAY, MATTERN & MATTERN, INC.
1315 FRANKLIN ROAD
ROANOKE, VA 24016
(540) 857-3100 WWW.HSMM.COM

COMM NO: 30182C
ISSUE DATE: JUNE 27, 2007
DESIGNED BY: HRM
DRAWN BY: REM
CHECKED BY: SPH
SUBMITTED BY: JSH

© HAYES, SEAY, MATTERN & MATTERN, INC., 2006. ALL RIGHTS RESERVED.

CIVIL

UTILITY RELOCATION
PLAN

C106