

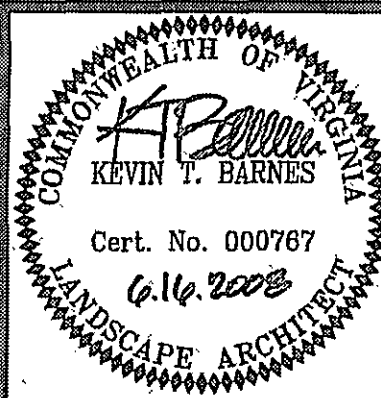


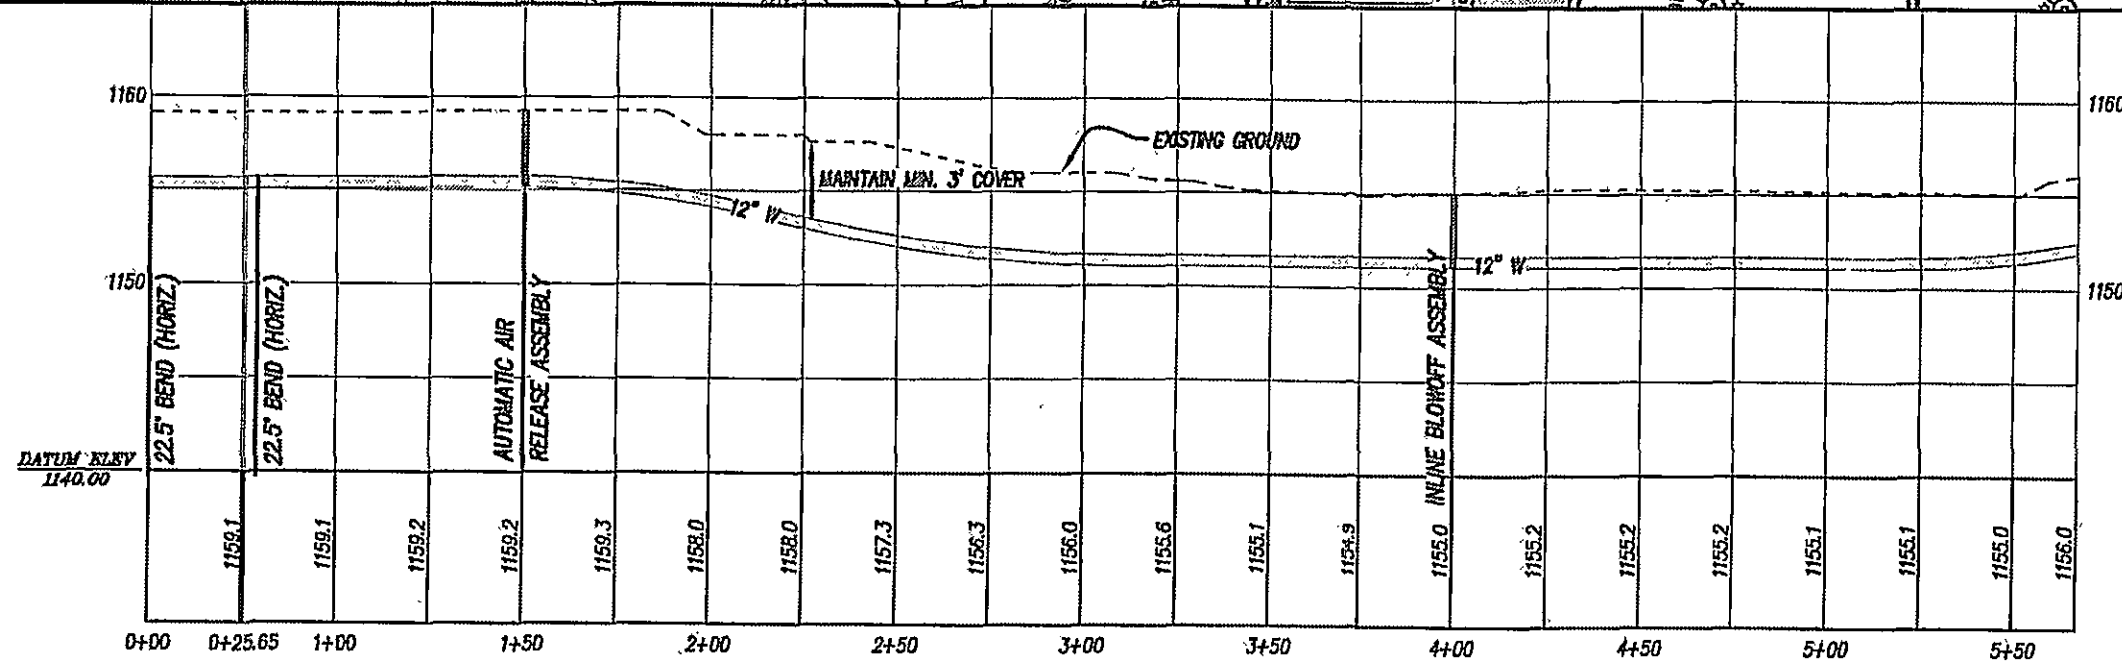

1. ALL CONSTRUCTION IS TO BE IN ACCORDANCE WITH WVWA DESIGN AND CONSTRUCTION STANDARDS.
2. PROPOSED WATERLINE SHALL PASS ALL PRESSURE AND BACTERIA TESTS REQUIRED BY WVWA STANDARDS BEFORE BEING CONNECTED TO EXISTING LINE.
3. A MINIMUM OF ONE FULL JOINT OF THE EXISTING PIPE SHALL BE REMOVED AT EACH END OF THE PORTION OF PIPE TO BE ABANDONED IN PLACE, AND ALL TRACER WIRE ON THE EXISTING PIPE THAT IS EXPOSED DURING THE ABANDONMENT PROCESS IS TO BE REMOVED.
4. WHEN FOUR (4) HOUR WINDOW IS APPROVED BY ROANOKE COUNTY FIRE & RESCUE AND WVWA, SHUT OFF VALVES, AT CLOSEST LOCATION TO RELOCATION TO ISOLATE THIS SECTION OF WATERLINE, DRAIN EXISTING LINE AND INSTALL NEW CONNECTIONS AS SHOWN.
5. COORDINATE TESTING SERVICES WITH WVWA PRIOR TO CONSTRUCTION.
6. ALL WATER OUTAGES MUST BE APPROVED BY THE ROANOKE COUNTY FIRE MARSHAL'S OFFICE. CONTRACTOR TO UTILIZE EX. BLOW-OFF TO PROVIDE "JUMPER" TO ALLOW FOR TESTING.
7. A 2" TAP ALONG THE EX. 12" LINE MAY BE NECESSARY IF BLOW-OFF CONNECTION DOES NOT WORK.

NORTHBOUND I-81

(VARIABLE WIDTH VDOT RIGHT-OF-WAY)

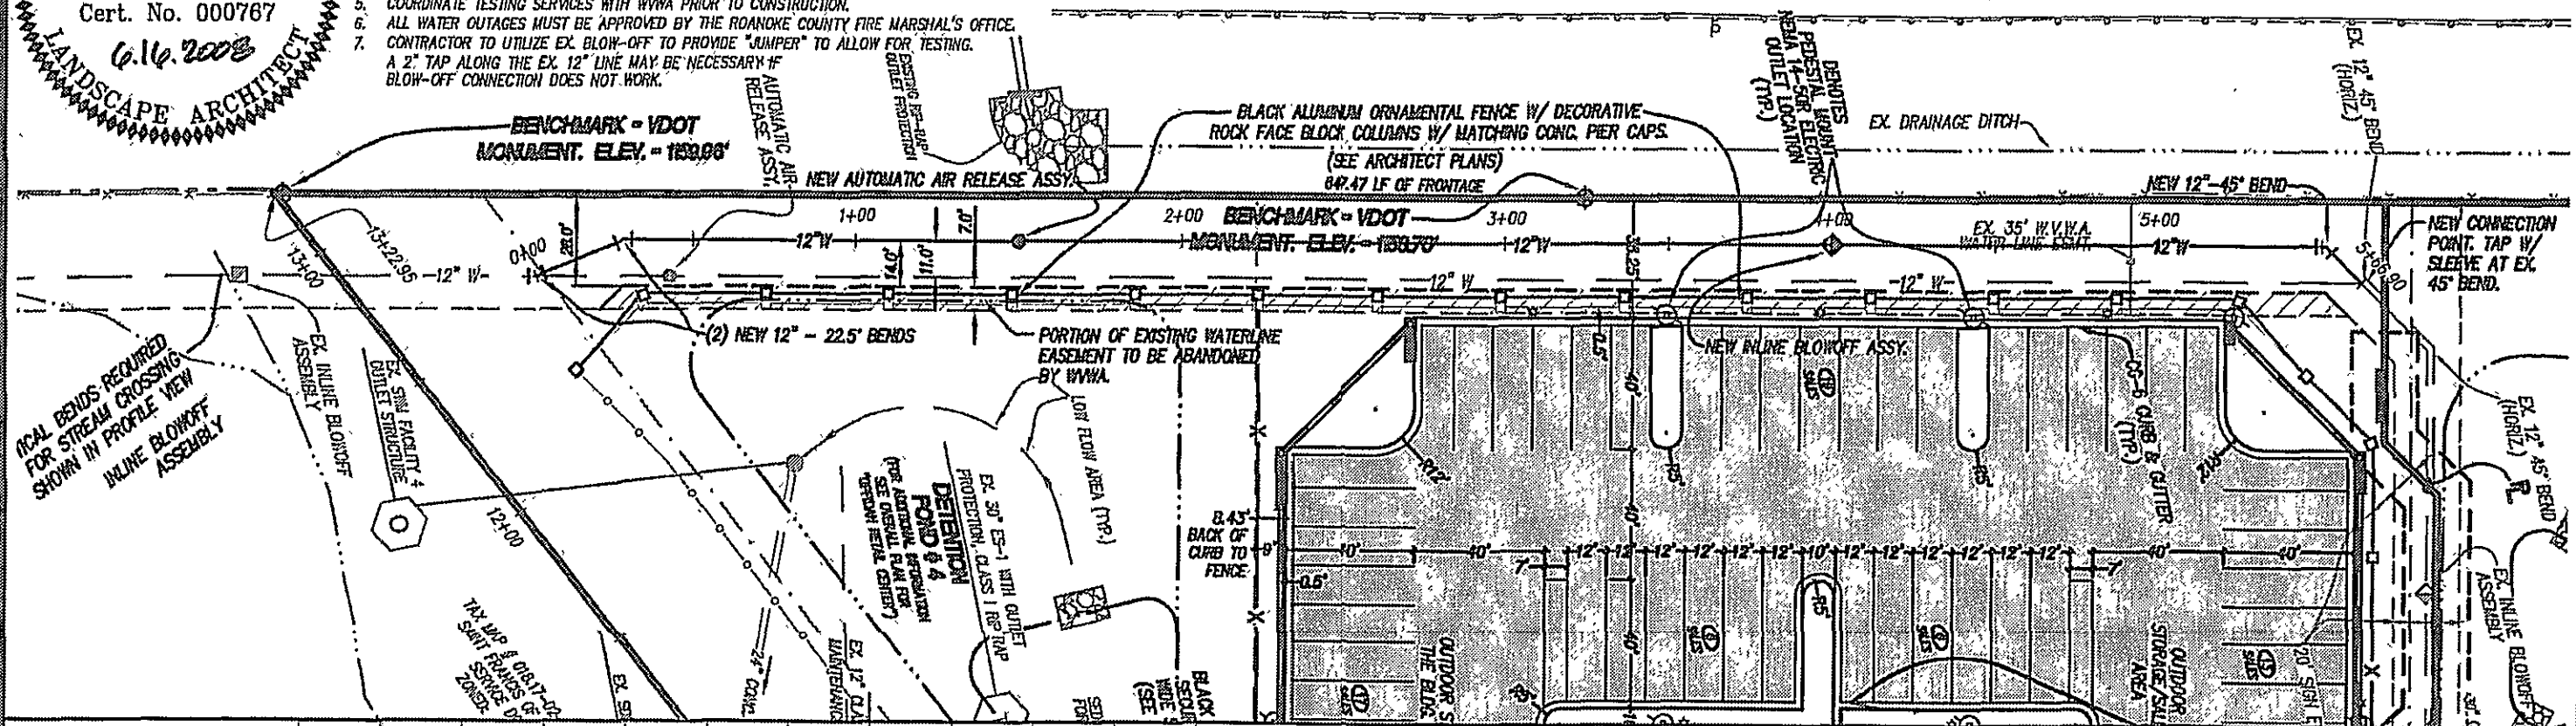

FIELD REVISION NO.02

CAMPING WORLD

AT THE OPPIDAN RETAIL CENTER

PREPARED FOR

OPPIDAN INVESTMENT COMPANY

HOLLINS MAGISTERIAL DISTRICT ROANOKE COUNTY, VIRGINIA



LUMSDEN ASSOCIATES, P.C.
ENGINEERS-SURVEYORS-PLANNERS
ROANOKE, VIRGINIA

4664 BRAMBLETON AVENUE
P.O. BOX 20669
ROANOKE, VIRGINIA 24018

PHONE: (540) 774-4411

FAX: (540) 772-9445

E-MAIL: MAIL@LUMSDENPC.COM

DATE:

June 16, 2008

COMM. NO.:

06-224C

SCALE:

1"=50'

SHEET 1 OF 1