



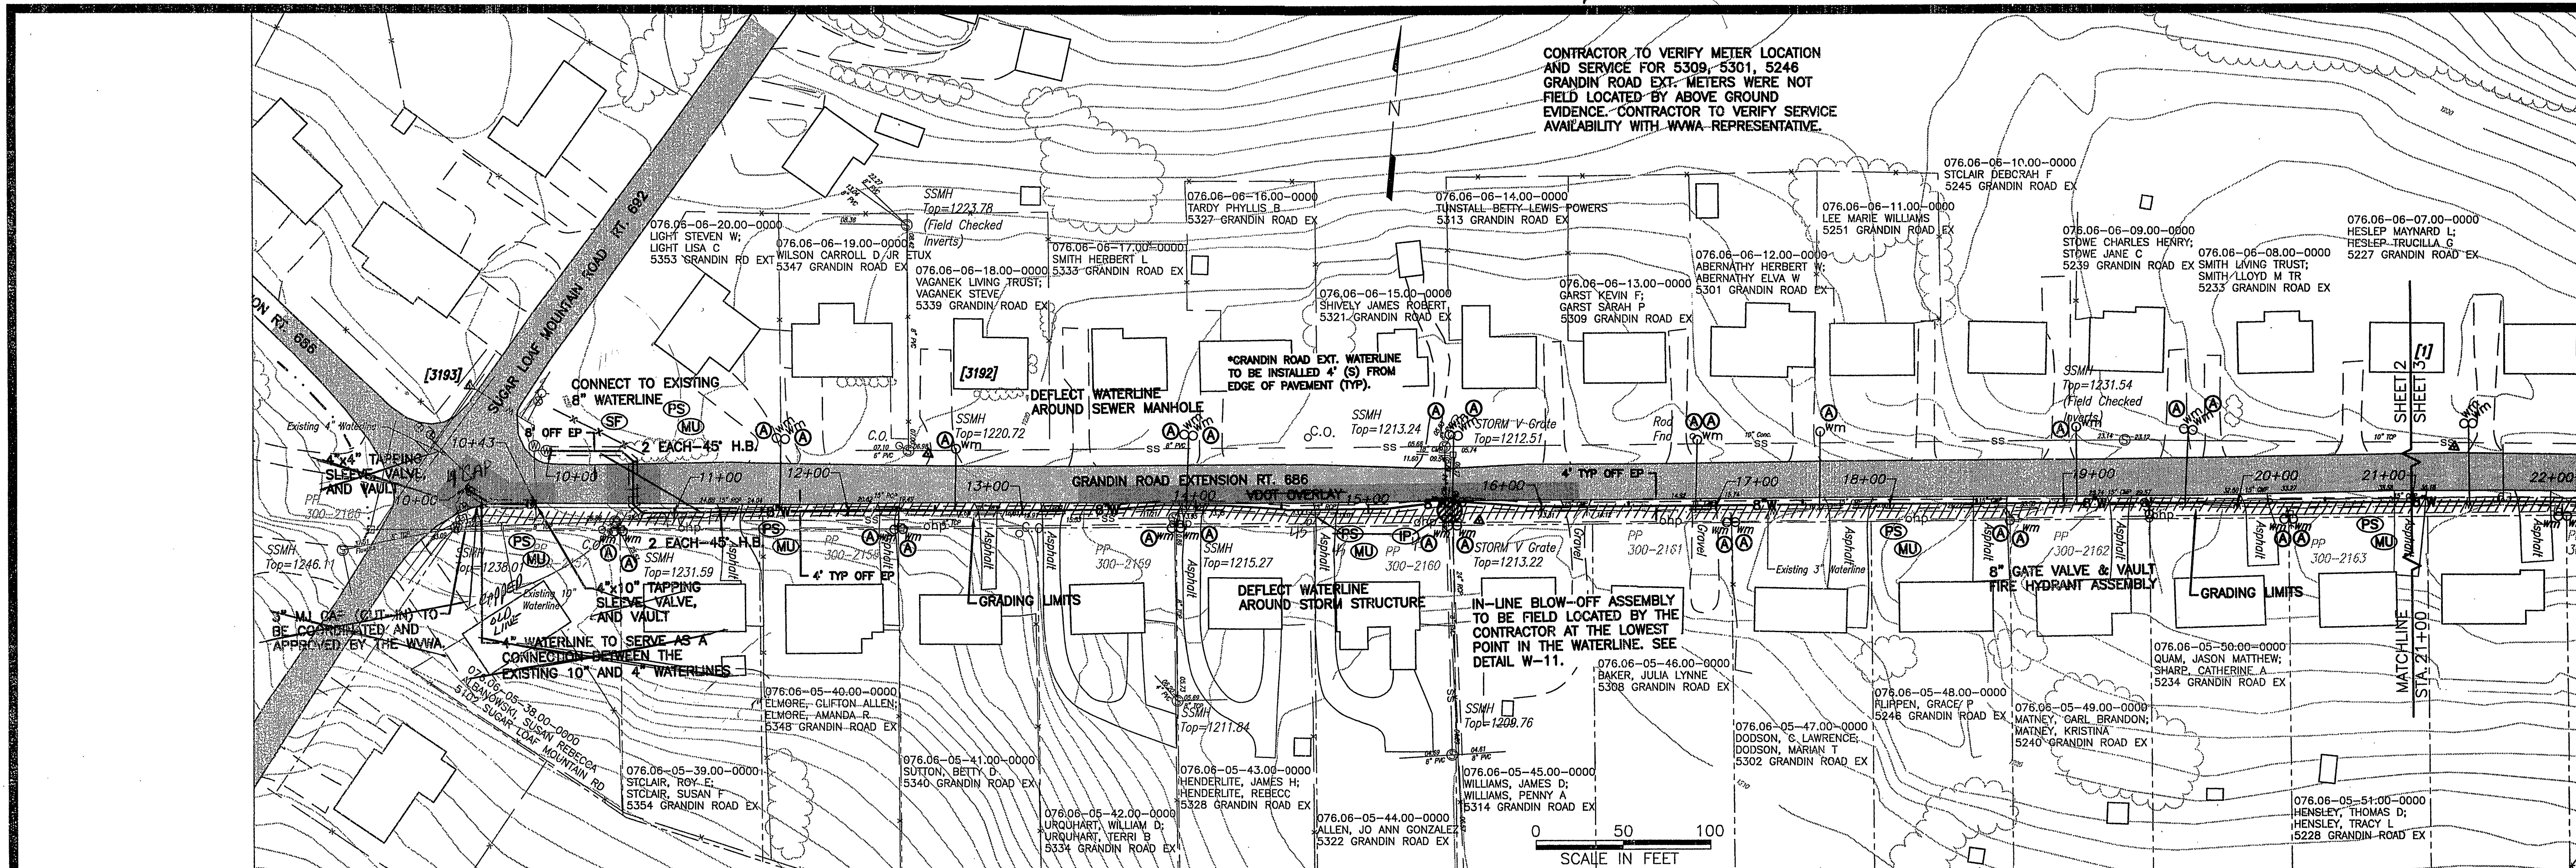

GRANDIN ROAD EXT. 4 INCH CONNECTION

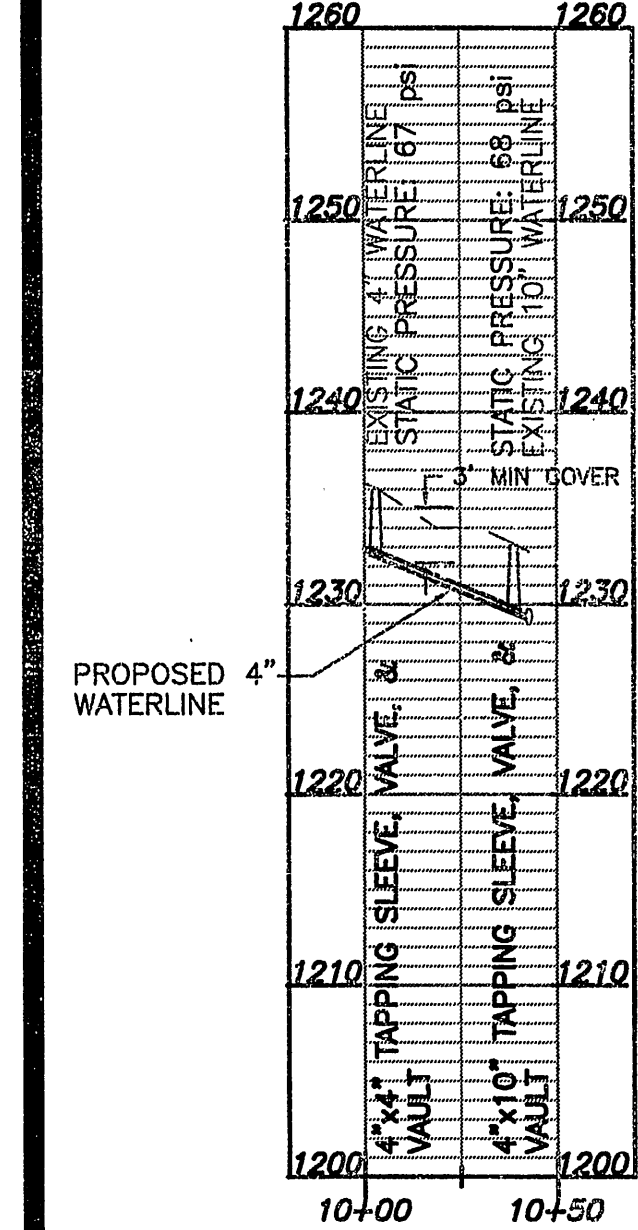


PROPOSED 4\"/>

EROSION CONTROL LEGEND:

- (SF) — x — x — SILT FENCE
- (IP) [Symbol] INLET PROTECTION
- (PS) PERMANENT SEEDING
- (MU) MULCHING

FOR ADDITIONAL REQUIRED ESC EASURES
FOR THE INSTALLATION OF THE WATER LINE
SEE TYPICAL ESC DETAILS ON SHEET 1G.

GRANDIN ROAD EXT WATERLINE [10+00-21+00]

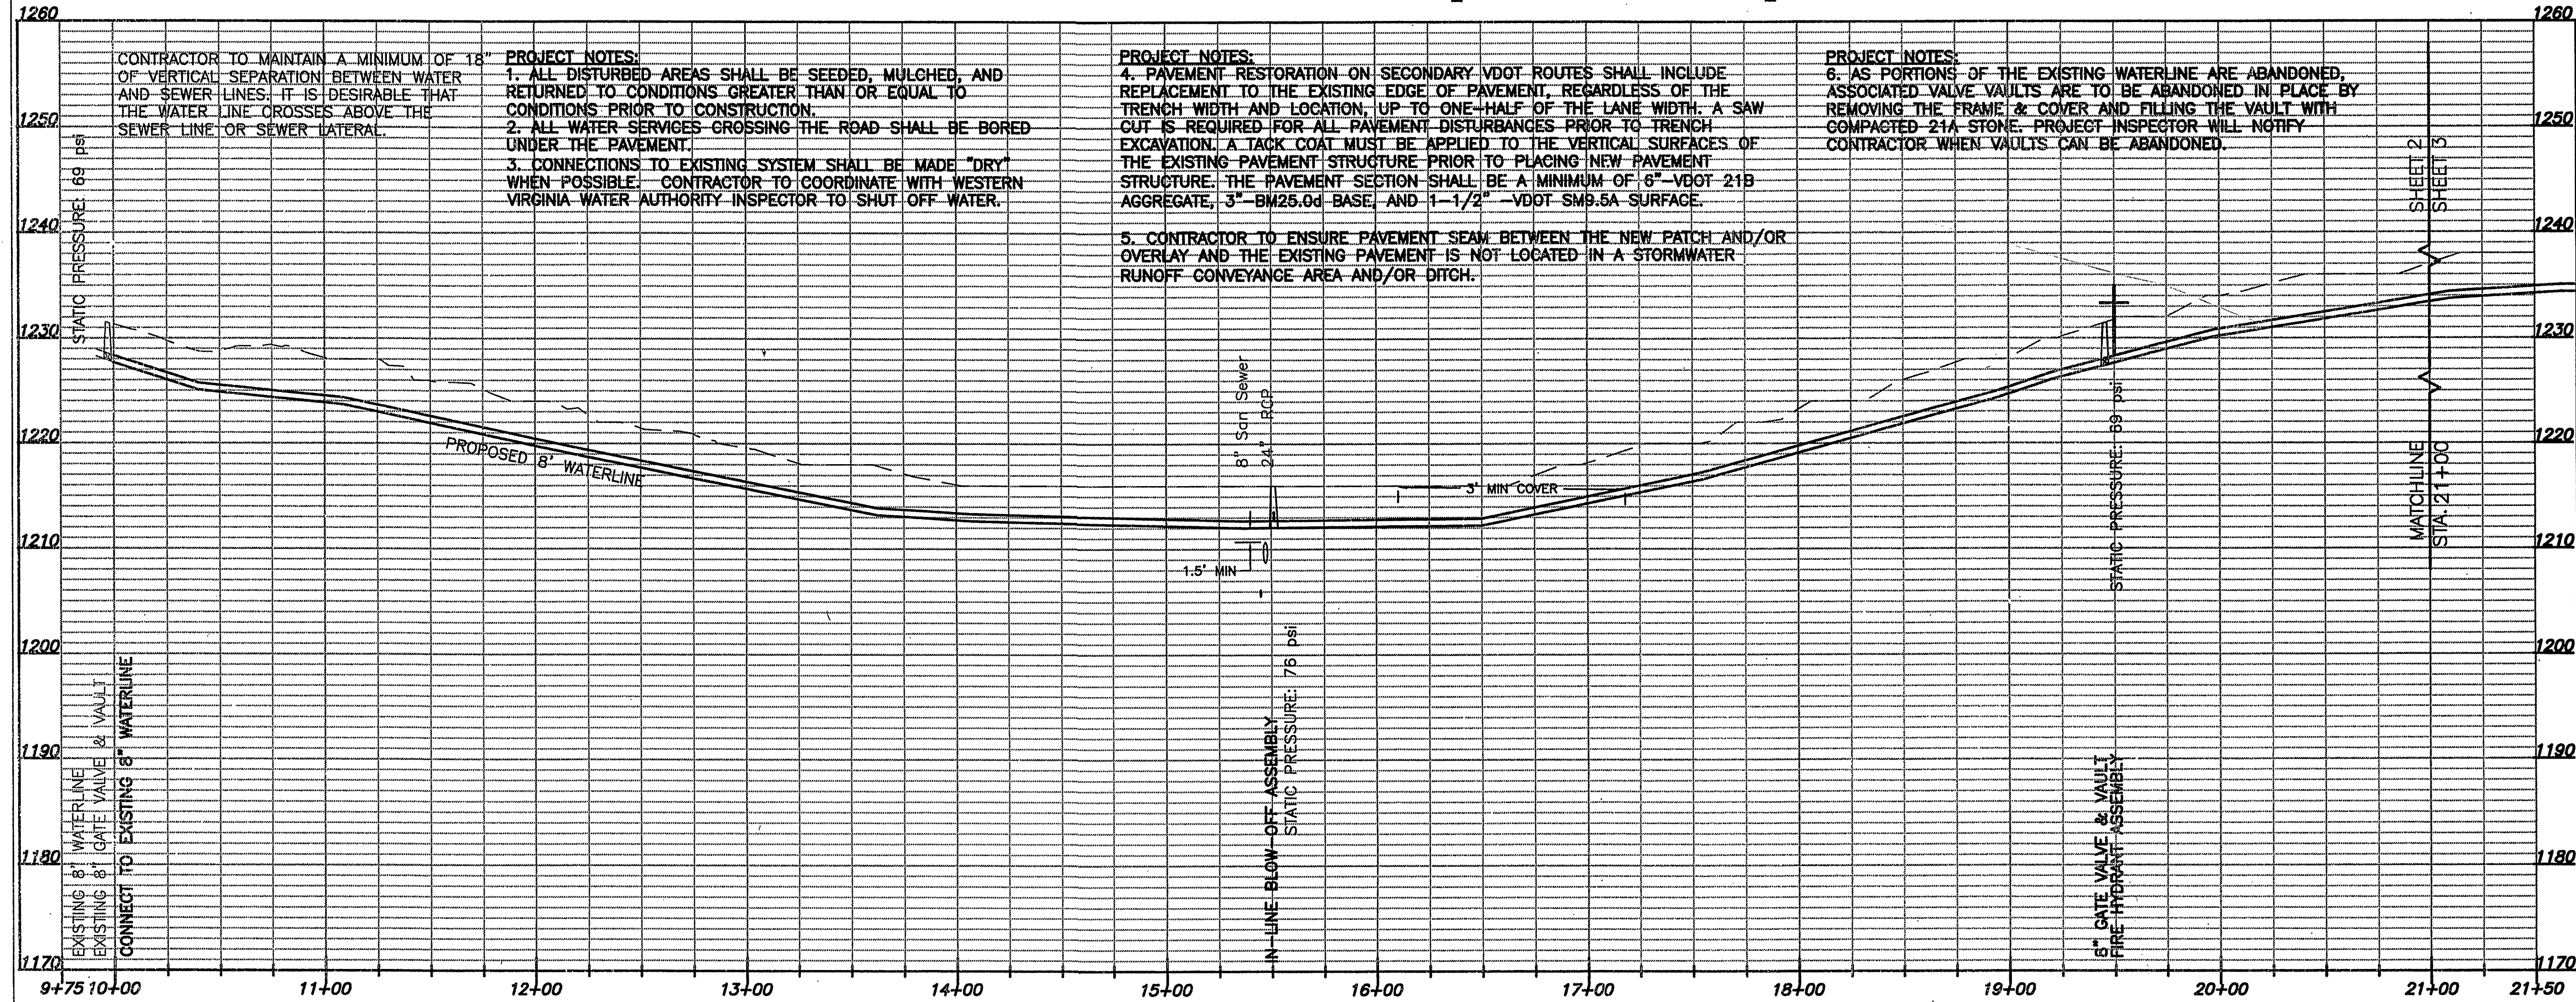

CONTRACTOR TO MAINTAIN A MINIMUM OF 18\"/>

PROJECT NOTES:

1. ALL DISTURBED AREAS SHALL BE SEEDED, MULCHED, AND RETURNED TO CONDITIONS GREATER THAN OR EQUAL TO CONDITIONS PRIOR TO CONSTRUCTION.
2. ALL WATER SERVICES CROSSING THE ROAD SHALL BE BORED UNDER THE PAVEMENT.
3. CONNECTIONS TO EXISTING SYSTEM SHALL BE MADE "DRY" WHEN POSSIBLE. CONTRACTOR TO COORDINATE WITH WESTERN VIRGINIA WATER AUTHORITY INSPECTOR TO SHUT OFF WATER.



PROJECT NOTES:

4. PAVEMENT RESTORATION ON SECONDARY VDOT ROUTES SHALL INCLUDE REPLACEMENT TO THE EXISTING EDGE OF PAVEMENT, REGARDLESS OF THE TRENCH WIDTH AND LOCATION, UP TO ONE-HALF OF THE LANE WIDTH. A SAW CUT IS REQUIRED FOR ALL PAVEMENT DISTURBANCES PRIOR TO TRENCH EXCAVATION. A TACK COAT MUST BE APPLIED TO THE VERTICAL SURFACES OF THE EXISTING PAVEMENT STRUCTURE PRIOR TO PLACING NEW PAVEMENT STRUCTURE. THE PAVEMENT SECTION SHALL BE A MINIMUM OF 6\"/>
- 5. CONTRACTOR TO ENSURE PAVEMENT SEAM BETWEEN THE NEW PATCH AND/OR OVERLAY AND THE EXISTING PAVEMENT IS NOT LOCATED IN A STORMWATER RUNOFF CONVEYANCE AREA AND/OR DITCH.

PROJECT NOTES:

6. AS PORTIONS OF THE EXISTING WATERLINE ARE ABANDONED, ASSOCIATED VALVE VAULTS ARE TO BE ABANDONED IN PLACE BY REMOVING THE FRAME & COVER AND FILLING THE VAULT WITH COMPACTED 21A STONE. PROJECT INSPECTOR WILL NOTIFY CONTRACTOR WHEN VAULTS CAN BE ABANDONED.

ANDERSON & ASSOCIATES, INC.
Professional Design Services
www.andassoc.com
VA - NC - TN - WV

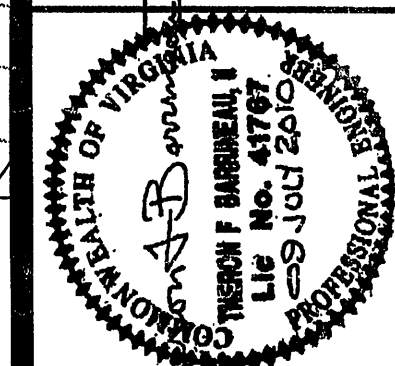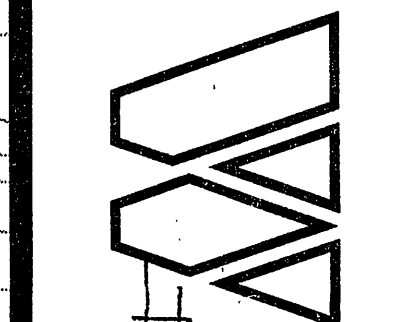

WATERLINE PLAN & PROFILE I
GLEN HEATHER FARMS
WATER LINE REPLACEMENT PROJECT
PHASE IV

Designed By:	TFB
Drawn By:	CBD/LTB
Checked By:	JKD
Date:	13 JAN 2010
Revised:	01 FEB 2010 09 APR 2010 22 JUN 2010 09 JUL 2010
Scale:	HORZ: 1" = 50' VERT: 1" = 10'
Plan #:	27379-002
Sheet:	2 OF 10