


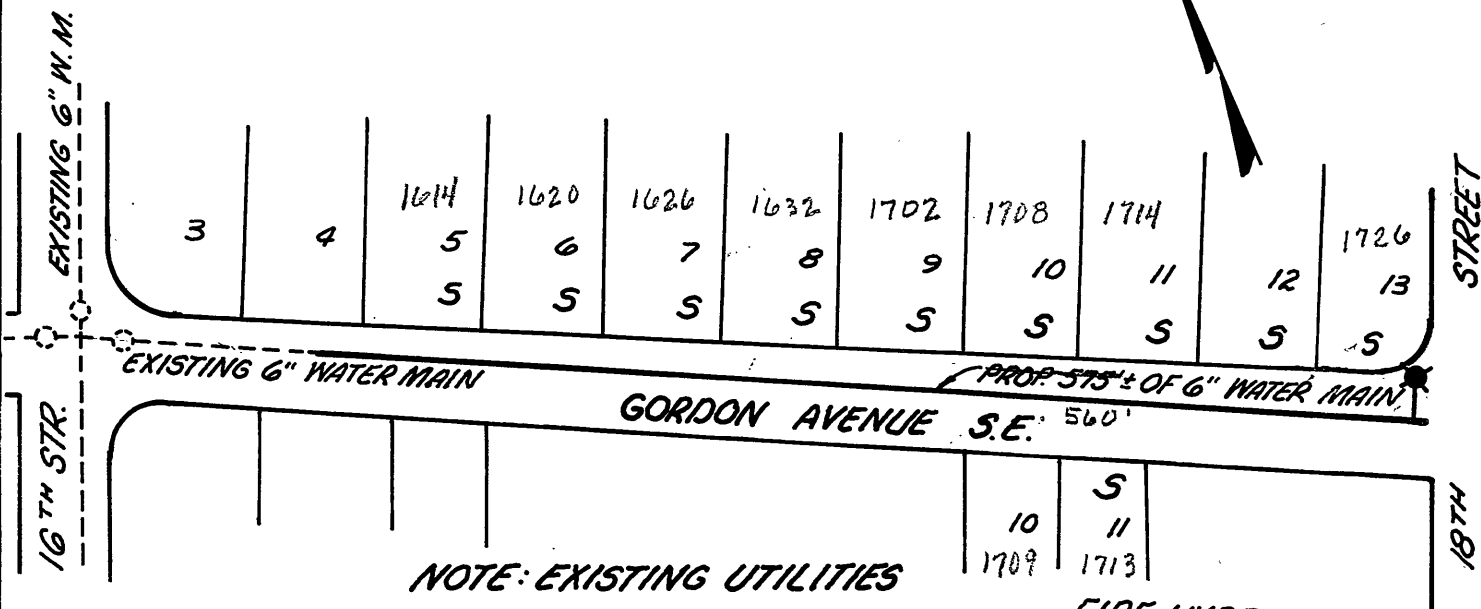

NOTE: EXISTING UTILITIES
TO BE ASCERTAINED
IN FIELD PRIOR TO
CONSTRUCTION.

FIRE HYDRANT TO
BE INSTALLED BY
THE CITY OF ROANOKE

FIRE HYDRANT
LATERALS TO BE
INSTALLED BY
CONTRACTOR.

C. B. Lin
DIRECTOR UTILITIES & OPERATIONS

Thomas J. Brady
CITY ENGINEER OF ROANOKE, VA.

Ruth B. Ingram
DIRECTOR OF PUBLIC WORKS

Lorran Merritt
AGENT FOR ROANOKE PLANNING COMM.

April 2, 1976
DATE

4-2-76
DATE

4-5-76
DATE

4-2-76
DATE

DATE STARTED <u>11-10-76</u>				
DATE COMP. <u>11-23-76</u>				
FEET MAIN	SIZE	VALVE	VAULT	BOX
<u>560</u>	<u>6"</u>			
F. H. COMP. <u>1</u>	<u>6"</u>	<u>1</u>	<u>1</u>	
F. H. STUB ONLY				
SERV. INS. BY: <u>J.F. ST. CLAIR</u>				
MAIN INS. BY: <u>" "</u>				
NO. $\frac{3}{4}$ " SERV. INS. <u>10</u>				
CITY OR CO.				
DEPT. INSP. <u>LEWIS WORRELL</u>				

WATER DEPARTMENT
CITY OF ROANOKE, VA.
SCALE: 1"=100'
DRWN: S.B.G. 4-2-1976
RIVERLAND TERRACE
T# 434,443 76-5