


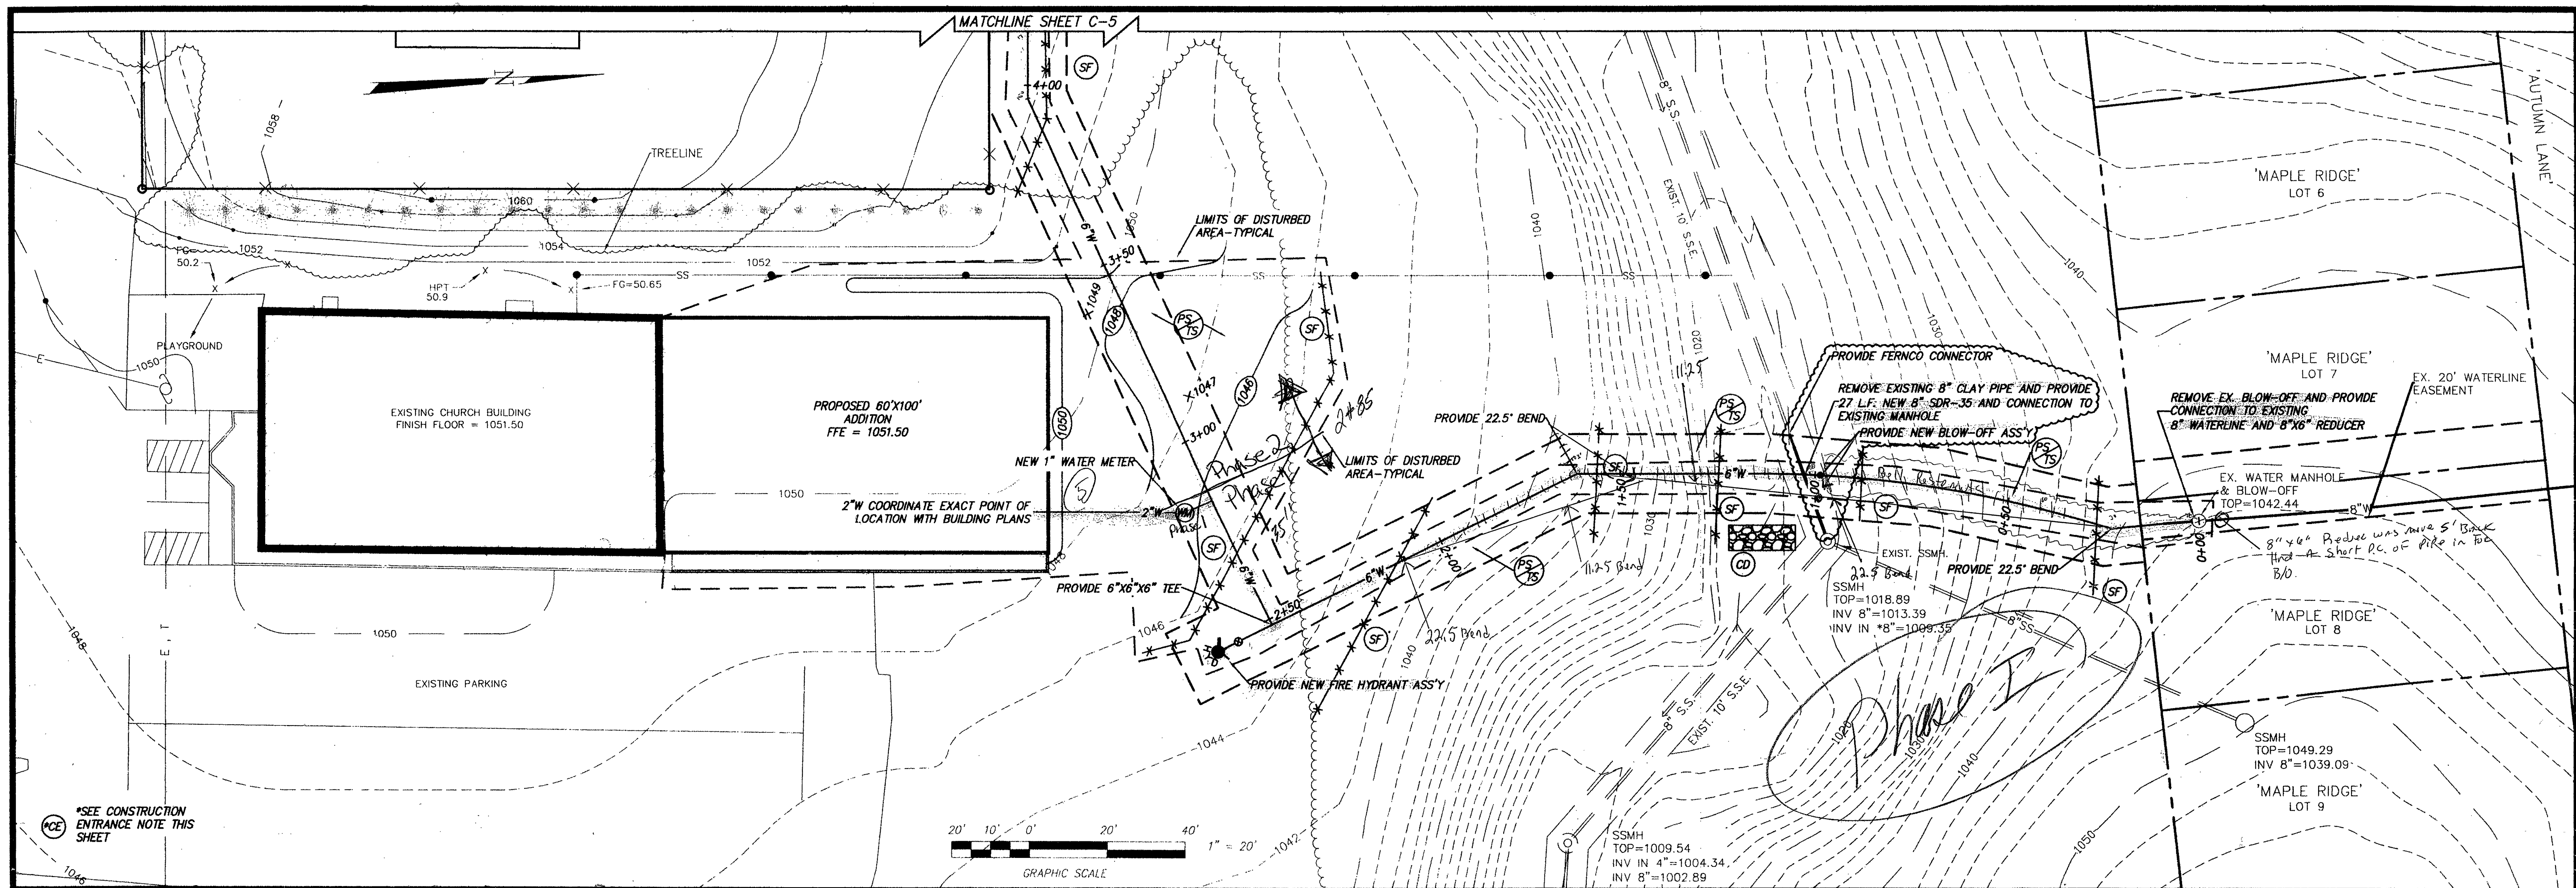

WATER NOTES

A MINIMUM COVER OF THREE (3) FEET IS REQUIRED OVER PROPOSED LINES.
 CONTRACTOR SHALL BE RESPONSIBLE FOR LOCATING AND UNCOVERING VALVE VAULTS AFTER PAVING AND ADJUSTMENT TO FINAL GRADE IF NECESSARY.
 ALL EXISTING UTILITIES MAY NOT BE SHOWN, OR MAY NOT BE SHOWN IN THE EXACT LOCATION. THE CONTRACTOR SHALL COMPLY WITH STATE WATER WORKS REGULATIONS, SECTION 12.05.03, WHERE LINES CROSS.
 ALL WATERLINE CONSTRUCTION SHALL ADHERE TO THE WESTERN VIRGINIA WATER AUTHORITY DESIGN AND CONSTRUCTION STANDARDS, LATEST EDITION.
 ALL TRENCHES IN EXISTING OR FUTURE HIGHWAY RIGHT-OF-WAYS SHALL BE COMPACTED IN ACCORDANCE WITH THE CITY OF ROANOKE "RIGHT OF WAY EXCAVATION AND RESTORATION STANDARDS".
 LINES SHALL BE STAKED PRIOR TO CONSTRUCTION.
 ALL CONNECTIONS TO EXISTING MAINS SHALL BE MADE BY THE WESTERN VIRGINIA WATER AUTHORITY.
 WATER MAIN SHALL BE MINIMUM CLASS 52 DUCTILE IRON IN ACCORDANCE W/ AWWA C151 OR POLYVINYL CHLORIDE (PVC) CONFORMING TO AWWA C900 WITH O.D. DIMENSION RATIO (D.R.) 14.


CONSTRUCTION ENTRANCE NOTE

THE CONTRACTOR SHALL UTILIZE THE EXISTING PAVED ENTRANCE AS THE CONSTRUCTION ENTRANCE FOR THIS PROJECT. THE CONTRACTOR SHALL BE RESPONSIBLE FOR MAINTAINING THE ENTRANCE IN A MANNER WHICH WILL PREVENT THE TRACKING OF MUD OR SEDIMENT ONTO PUBLIC RIGHT-OF-WAY. THE CONTRACTOR SHALL FURTHER BE RESPONSIBLE FOR REPAIRING OR REPLACING ASPHALT PAVEMENT DAMAGED AS A RESULT OF CONSTRUCTION ACTIVITIES AND CONSTRUCTION EQUIPMENT ENTERING/EXITING THE SITE SUBJECT TO APPROVAL BY THE OWNER.

SITE GRADING, EROSION CONTROL AND
 WATERLINE PLAN AND PROFILE
 STA. 0+00 TO 4+13.8

FOR
GRACE COVENANT CHURCH

SITUATE 766 PETERS CREEK ROAD
 CITY OF ROANOKE, VIRGINIA

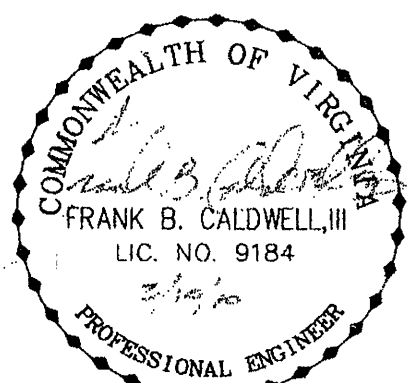

CALDWELL WHITE ASSOCIATES

ENGINEERS / SURVEYORS / PLANNERS

4203 MELROSE AVENUE, N.W.
 P.O. BOX 6260
 ROANOKE, VIRGINIA 24017-0260
 (540) 366-3400
 FAX: (540) 366-8702

Designed: JWK
 Drawn: JWK
 Checked: EBC
 Date: FEB. 17, 2009
 Rev: FEB. 10, 2010
 Scale: 1" = 20'
 Tax Parcel: 6030114
 W.O. No.: 09-0003

