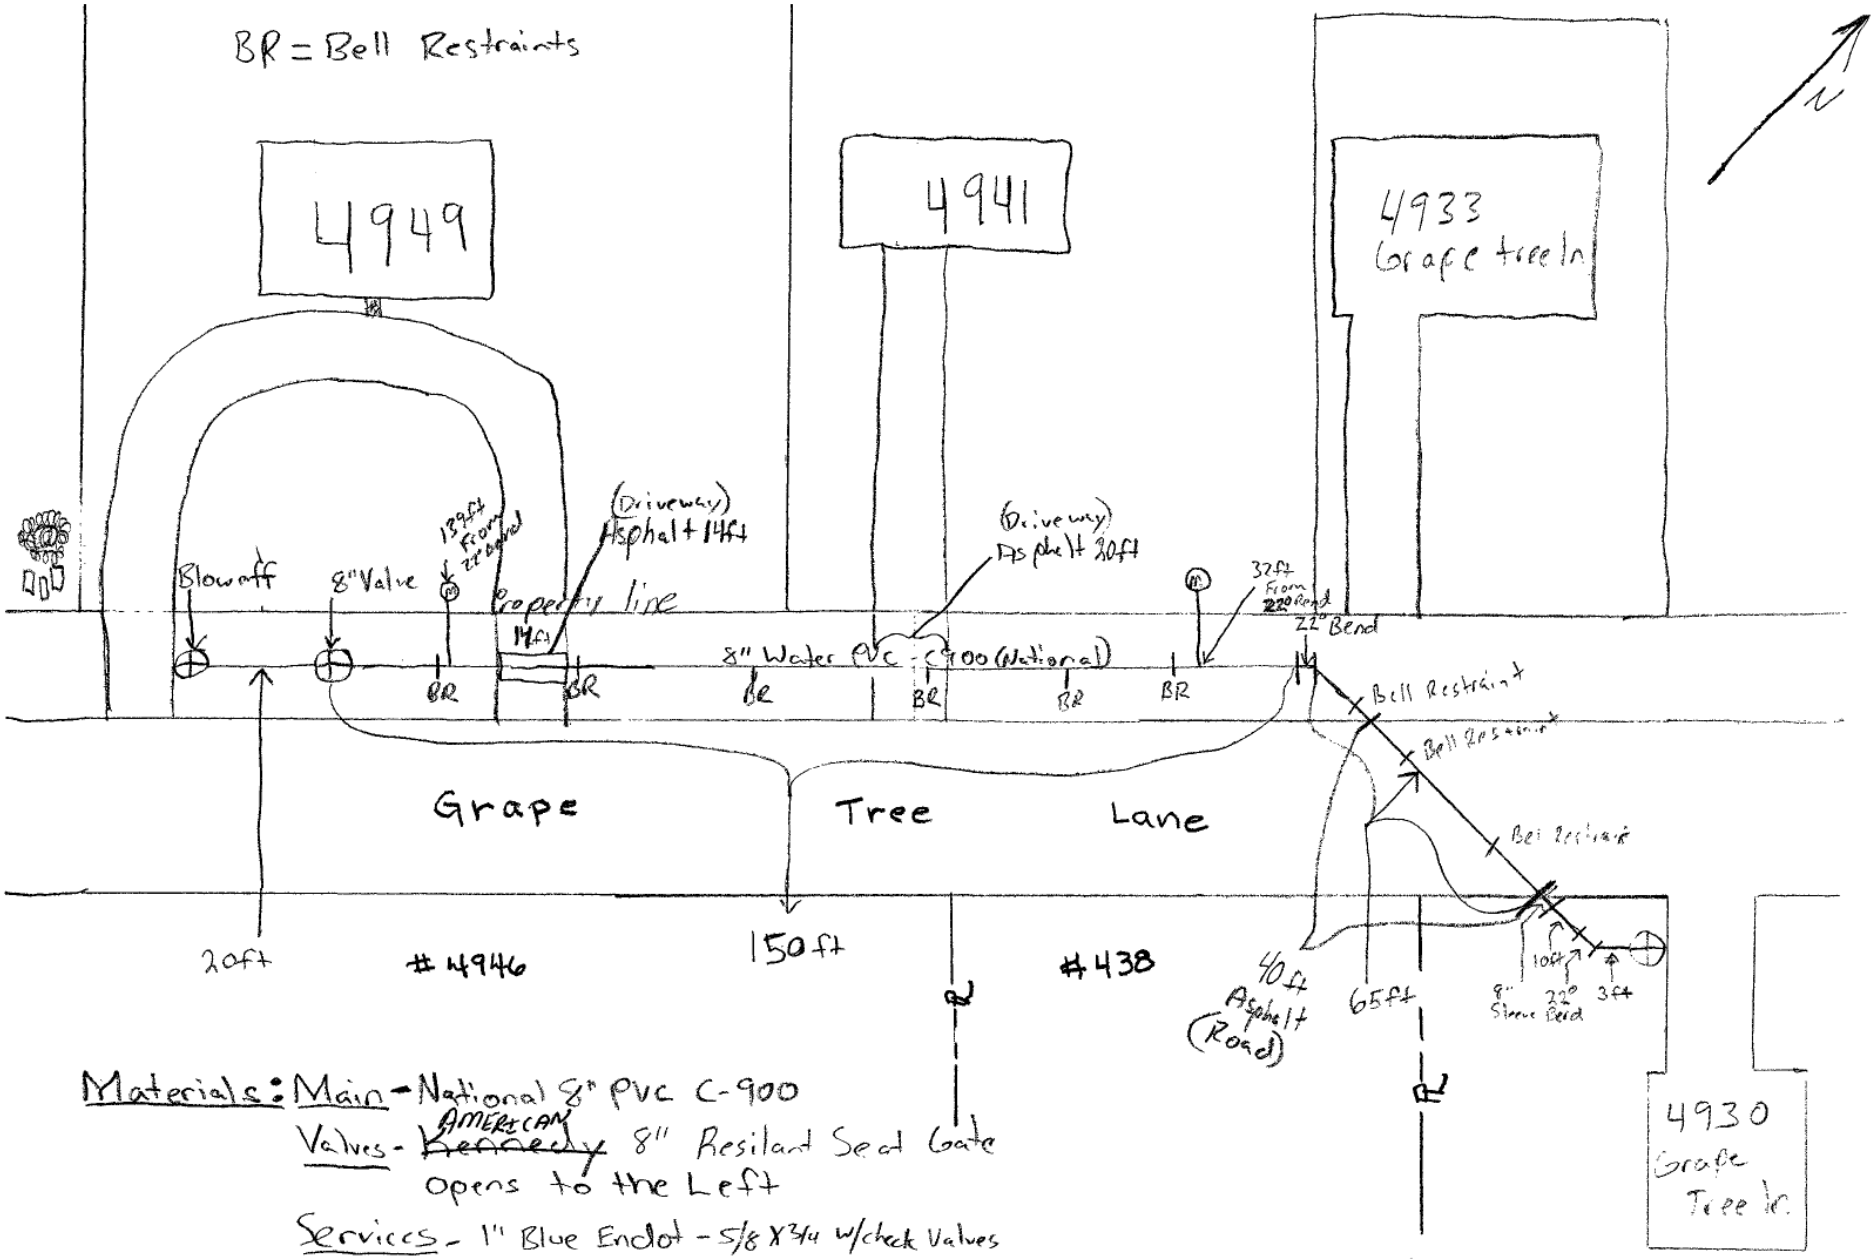

Materials: Main - National 8" PVC C-900

Valves - ~~Kennedy~~ AMERICAN 8" Resilant Seat Gate opens to the Left

Services - 1" Blue Endot - 5/8 X 3/4 w/check Valves

Waterline - 3ft Deep - 250' Long Total From Valve to Blowoff

Month/Year
11/15

* (Not to Scale) Pressure Tested - 11/16/15
Substantial Completion - 12/02/2015

Inspector: Brian Whitenack
Contractor: E.C. PACE