


INSTALL: 6" TAPPING VALVE & SLEEVE
 : F.H. & ASSEMBLY (NOT INSTALLED)

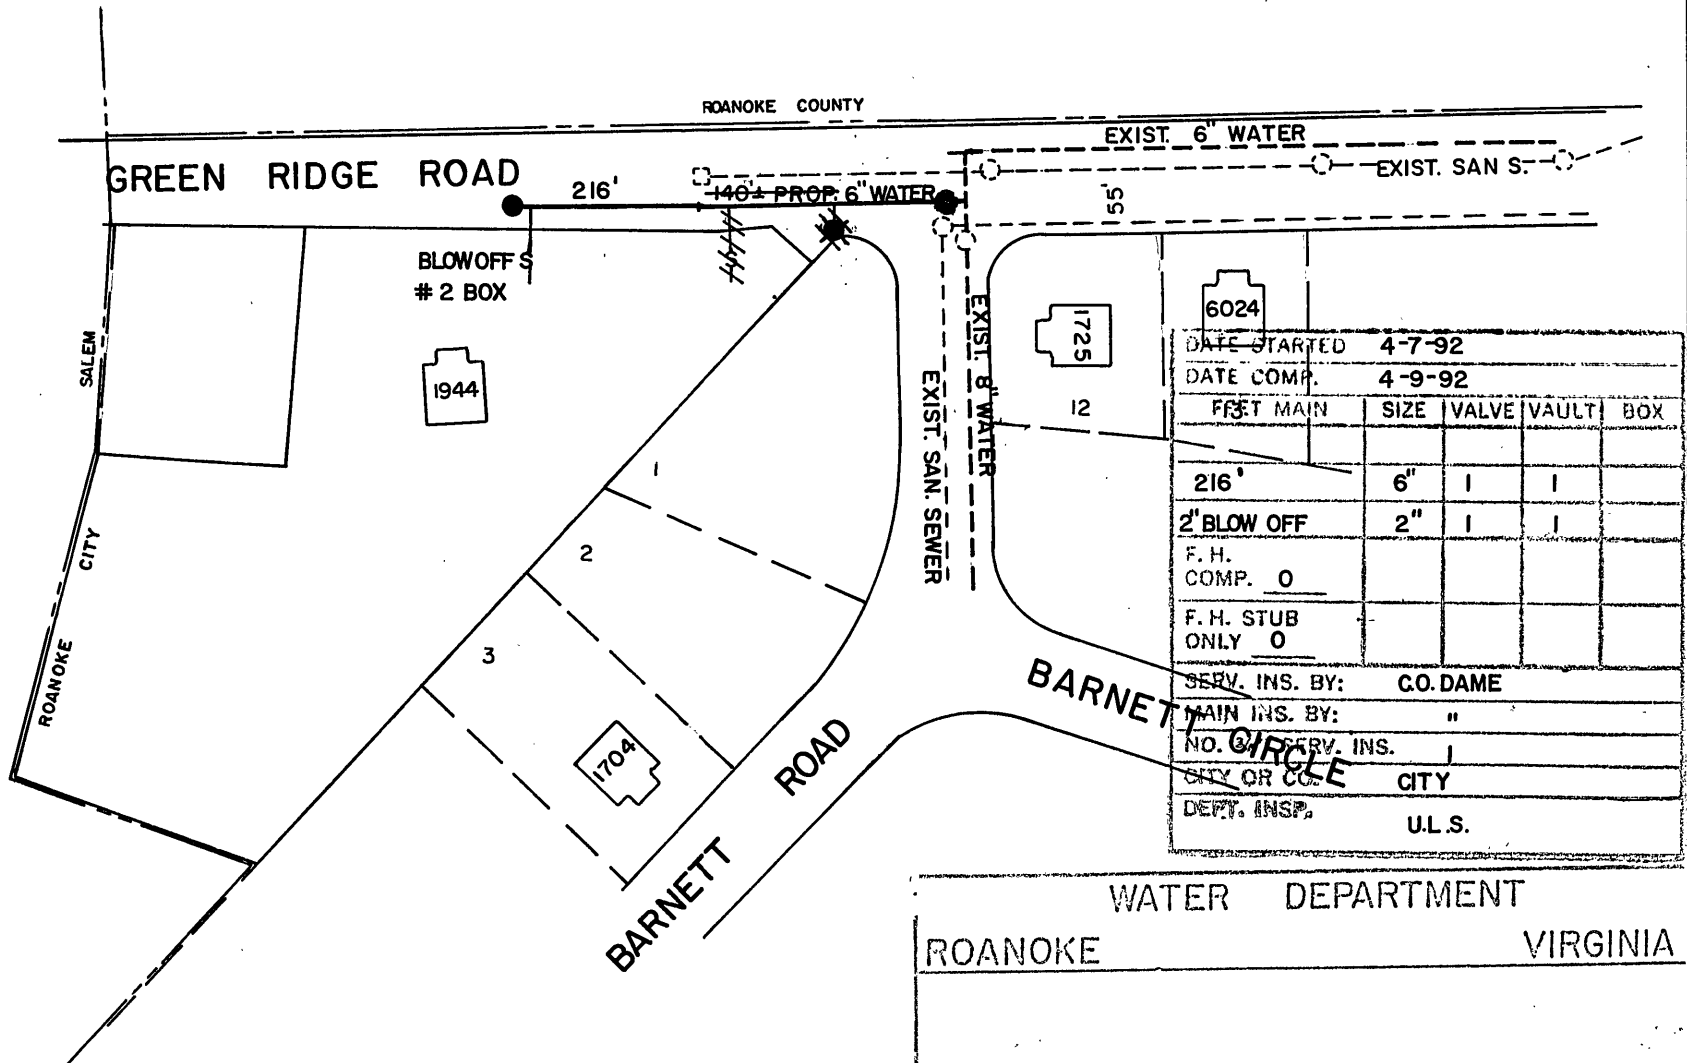

DATE STARTED 4-7-92				
DATE COMP. 4-9-92				
FEET MAIN	SIZE	VALVE	VAULT	BOX
216'	6"	I	I	
2" BLOW OFF	2"	I	I	
F. H. COMP. 0				
F. H. STUB ONLY 0				
SERV. INS. BY: C.O. DAME				
MAIN INS. BY: "				
NO. OF SERV. INS. 1				
CITY OR CO. CITY				
DEPT. INSP. U.L.S.				

NOTE: ALL EXIST. UTILITIES SHALL BE ASCERTAINED IN THE FIELD PRIOR TO CONSTRUCTION.

WATER DEPARTMENT
 ROANOKE VIRGINIA

GREEN RIDGE ROAD, N.W.

[Signature]
 MANAGER UTILITY LINE SERVICES

SCALE: 1" = 100'	
DATE: 3/13/92	DIRECTOR UTILITIES & OPERATIONS DATE
DIST. MAP: 613,615 CO. 44	
PLAN NO.: 92-02	DIRECTOR OF PUBLIC WORKS DATE