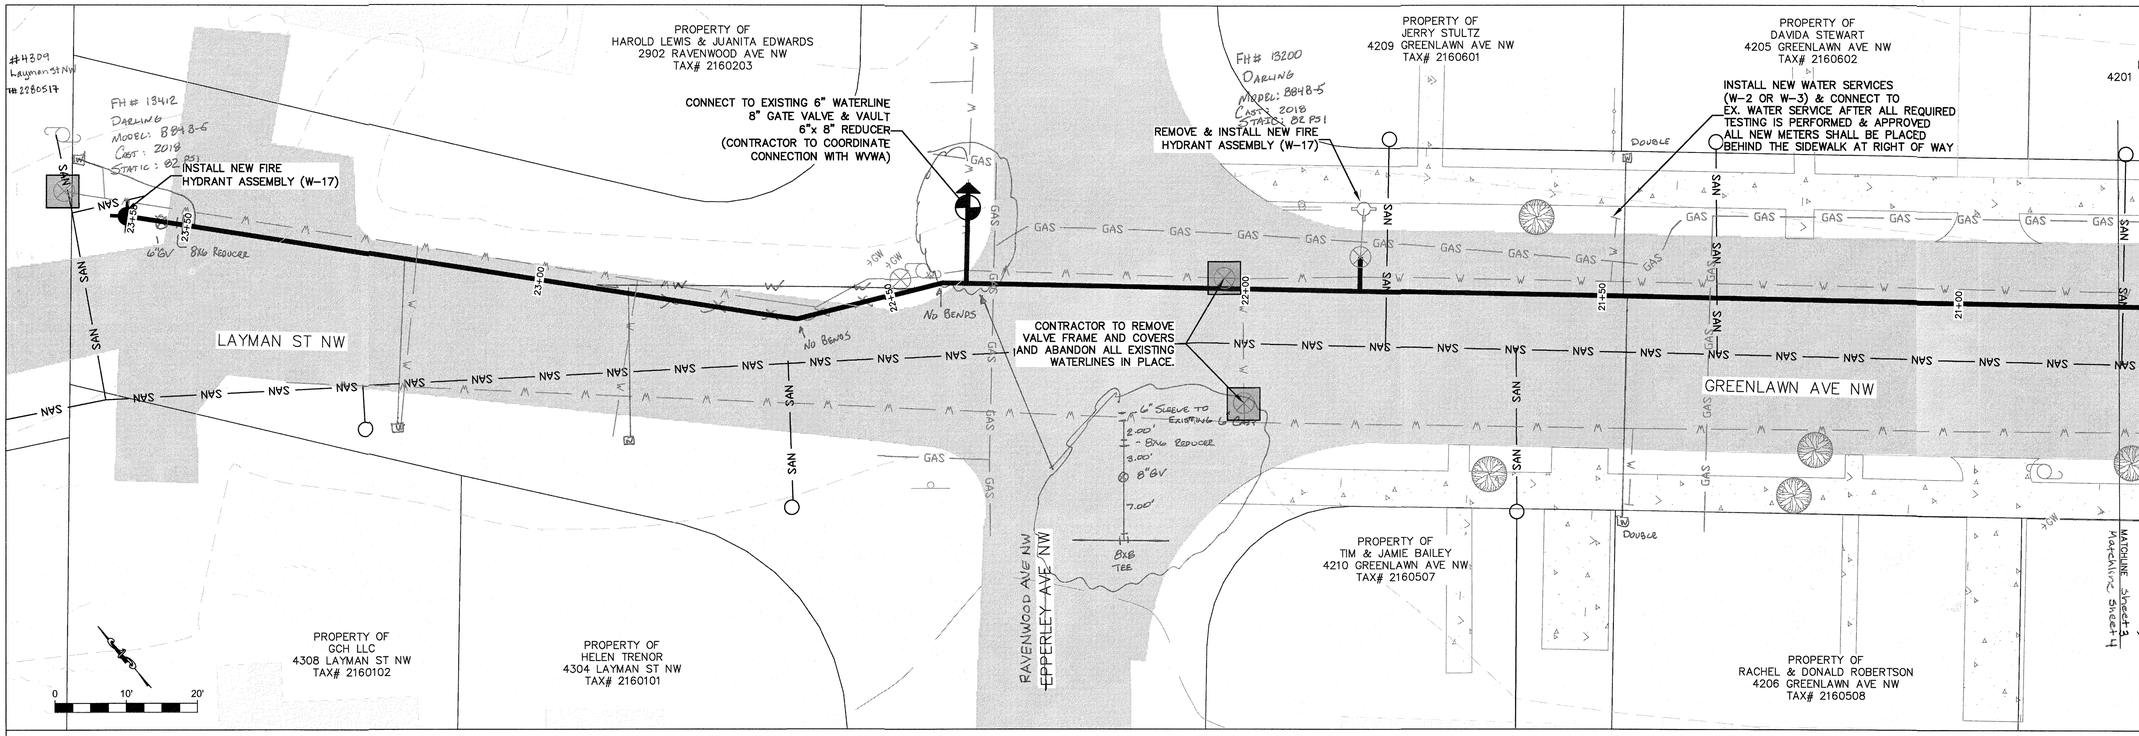

Material

- North American 8" DR14 C900 PVC
- North American 6" DR14 C900 PVC
- ADS Polyflex 1" HDPE
- AFC 8" & 6" Gate Valves

* Pressure Tested 11-29-18

WESTERN VIRGINIA WATER AUTHORITY
ENGINEERING SERVICES
601 S JEFFERSON ST, SUITE 300
ROANOKE, VA 24011
540-853-5700

COMMONWEALTH OF VIRGINIA
W. NICHOLAS ROBERTSON
Lic. No. 0402052204
8/31/18
PROFESSIONAL ENGINEER

GREENLAWN WATER (WCIP-313)

PLAN 3

Rev	Description	Date	By

Designed: AAS
Drawn: AAS
Checked: WNR
Approved: WNR
Date: 8/31/18
Project:

4
Sheet 4 of 5