


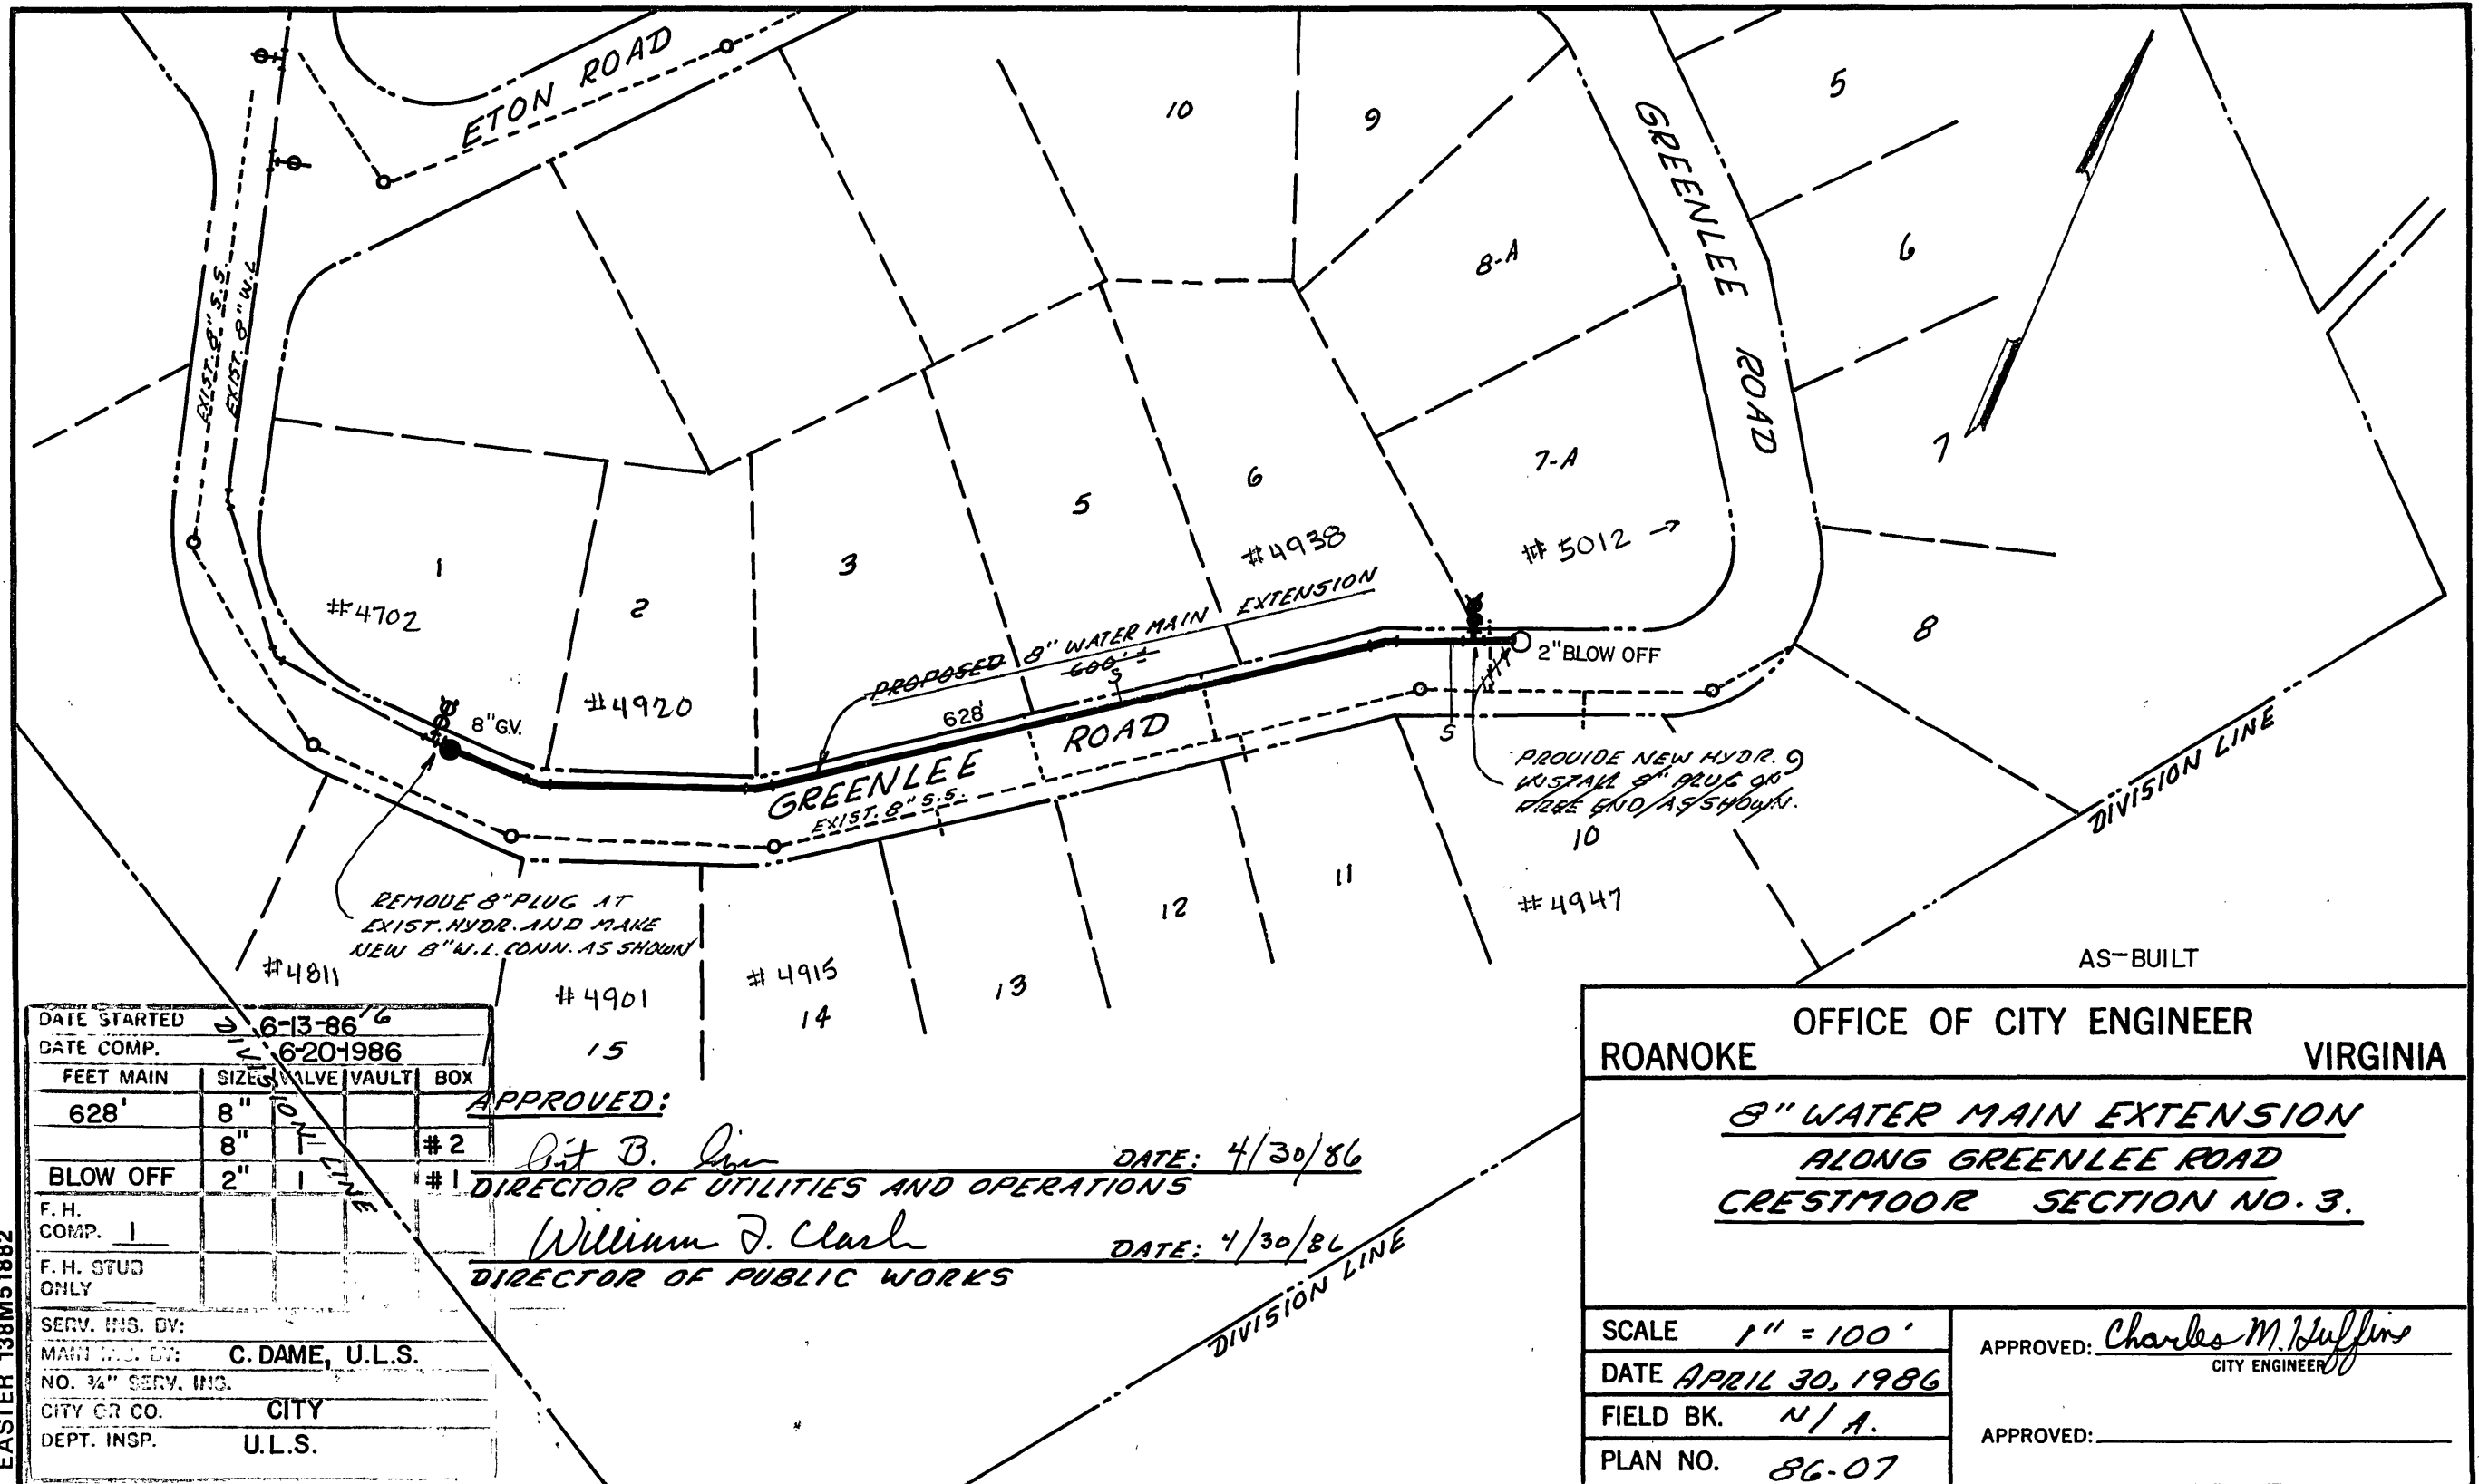

DATE STARTED 6-13-86				
DATE COMP. 6-20-1986				
FEET MAIN	SIZE	VALVE	VAULT	BOX
628'	8"	0		
	8"	1		#2
BLOW OFF	2"	1		#1
F. H. COMP.	1			
F. H. STUD ONLY				
SERV. INS. BY:				
MAIN INS. BY: C. DAME, U.L.S.				
NO. 3/4" SERV. INS.				
CITY CR CO. CITY				
DEPT. INSP. U.L.S.				

APPROVED: *Pat B. [Signature]* DATE: 4/30/86
 DIRECTOR OF UTILITIES AND OPERATIONS

William J. Clark DATE: 4/30/86
 DIRECTOR OF PUBLIC WORKS

OFFICE OF CITY ENGINEER	
ROANOKE	VIRGINIA
<u>8" WATER MAIN EXTENSION</u> <u>ALONG GREENLEE ROAD</u> <u>CRESTMOR SECTION NO. 3.</u>	
SCALE 1" = 100'	APPROVED: <i>Charles M. Huffins</i> CITY ENGINEER
DATE APRIL 30, 1986	
FIELD BK. N/A.	APPROVED: _____
PLAN NO. 86-07	

EASTER 138M51882