

ALL COSTS GIVEN ARE COMPLETE IN PLACE				
DESCRIPTION	UNIT	QUANTITY	UNIT COST	TOTAL COST
CLEARING & GRUBBING	LS		\$	\$
EXCAVATION	CY			
EMBANKMENT	CY			
FENCING	LF			
STRUCTURES				
ACCESS ROAD				
AS-BUILTS				
SUB-TOTAL				\$
10% CONTINGENCY				\$
TOTAL PROJECT COST				\$

The image contains two cross-sectional diagrams of a dam structure, both showing a reservoir on the left and a dam body on the right. The diagrams are labeled with various design elevations and storage capacities.

Top Diagram: DESIGN ELEVATIONS WITH EMERGENCY SPILLWAY

- DESIGN HIGH WATER (25-YR. STORM ELEV.)**: Indicated by a dashed line at the top of the reservoir.
- MIN. 1.0'**: Minimum height of the dam body above the spillway crest.
- MIN. 1.0'**: Minimum height of the spillway crest above the dewatering device.
- 67 C.Y./AC. "DRY" STORAGE**: Storage capacity above the spillway crest.
- 67 C.Y./AC. "WET" STORAGE**: Storage capacity below the spillway crest.
- SEDIMENT CLEANOUT POINT ("WET" STORAGE REDUCED TO 34 C.Y./ACRE)**: Point where sediment is cleaned out, reducing wet storage.
- RISER CREST**: The top of the dam body.
- DEWATERING DEVICE**: Located at the base of the dam body.
- CREST OF EMERGENCY SPILLWAY**: The top of the spillway structure.


Bottom Diagram: DESIGN ELEVATIONS WITHOUT EMERGENCY SPILLWAY

- DESIGN HIGH WATER (25-YR. STORM ELEV.)**: Indicated by a dashed line at the top of the reservoir.
- MIN. 2.0'**: Minimum height of the dam body above the spillway crest.
- MIN. 3.0'**: Minimum height of the spillway crest above the dewatering device.
- 67 C.Y./AC. "DRY" STORAGE**: Storage capacity above the spillway crest.
- 67 C.Y./AC. "WET" STORAGE**: Storage capacity below the spillway crest.
- SEDIMENT CLEANOUT POINT**: Point where sediment is cleaned out.
- RISER CREST**: The top of the dam body.
- DEWATERING DEVICE**: Located at the base of the dam body.

1. DESIGN OF DETENTION BASINS SHALL CONFORM TO THE REQUIREMENTS OF THE COUNTY OF ROCKFORD DRAINAGE STANDARDS (REF. SECTIONS 503.02, 503.03, AND 506.02). THE DESIGN OF THE FACILITY AND PREPARATION OF AS-BUILT PLANS SHALL BE BY A CERTIFIED PROFESSIONAL ENGINEER LICENSED TO PRACTICE IN THE COMMONWEALTH OF VIRGINIA.
2. ACCESS TO THE FACILITY MUST BE PROVIDED IN ACCORDANCE WITH THE COUNTY OF ROCKFORD DRAINAGE AND CONSTRUCTION STANDARDS FOR DETENTION PONDS, LATEST EDITION.
3. IF THE FACILITY IS OVER FOUR (4) FEET DEEP, TAKES OVER TWO (2) FEET TO DRAIN, OR THE INTERIOR SLOPE EXCEEDS 3 (H): 1 (V), PERMANENT FENCING MUST BE REQUIRED. ADDITIONALLY, IF THE FACILITY IS IN A CONGESTED AREA OR WILL IN ANY WAY PUT A HAZARD TO THE GENERAL PUBLIC, FENCING MAY BE REQUIRED. FENCING SHALL BE A MINIMUM OF SIX (6) FEET HIGH, A MINIMUM OF STANDARD NINE GAUGE RAIL FENCE, AND MUST HAVE ONE OR MORE LOOKING DOUBLE GATES (MINIMUM TEN FEET WIDE) FOR ACCESS.
4. DETENTION PONDS SHALL BE BONDED IN ACCORDANCE WITH THE ROCKFORD COUNTY BONDING POLICY FOR SUBDIVISION AND SITE DEVELOPMENT. A SEPARATE BOND FOR THE DETENTION FACILITY WILL BE REQUIRED AND ADMINISTERED APART FROM THE SUBDIVISION DEVELOPMENT BOND. REFERENCE ESTIMATE -- THIS SHEET.
5. REFERENCE THE COUNTY OF ROCKFORD DESIGN AND CONSTRUCTION STANDARDS FOR DETENTION PONDS, LATEST EDITION, FOR ACCEPTANCE AND MAINTENANCE OF THE FACILITY. CERTIFIED AS-BUILTS ARE REQUIRED AND MUST INCLUDE:
 - A. DIMENSIONS OF THE FACILITY
 - B. VOLUME @ MAXIMUM DEPTH
 - C. ELEVATIONS OF STRUCTURES, SPILLWAYS, AND TOP
 - D. MATERIALS VERIFICATION INCLUDING RESULTS OF DENSITY TESTS CONDUCTED BY AN INDEPENDENT SOIL TESTING LABORATORY
 - E. LOCATION AND ELEVATION OF BENCHMARK.
6. ONE FOOT MINIMUM FREEBOARD REQUIRED FOR THE 100 YR WATER SURFACE ELEVATION.

1. SITE PREPARATION SHALL BE IN ACCORDANCE WITH THE COUNTY OF ROCKSKE DESIGN AND CONSTRUCTION STANDARDS FOR DETENTION PONDS, LATEST EDITION.
2. SLOPES STEEPER THAN 3 TO 1 (HORIZONTAL TO VERTICAL) SHALL BE BENCH OR STEPPED PRIOR TO PLACING FILL ON THEM.
3. ON-SITE FILL MATERIAL OR BORROW FILL MATERIAL MAY BE UTILIZED. FILL MATERIAL SOILS, IN GENERAL:
 - A. SHALL BE COMPACTABLE
 - B. SHALL BE WITHIN AN ACCEPTABLE RANGE OF MOISTURE CONTENT WHICH IS READILY CONTROLLED
 - C. SHALL BE OF HIGHLY SUSCEPTIBLE TO VOLUME CHANGE (SHRINKAGE OR SWELL) OR SETTLEMENT
4. FILL MATERIALS CONTAINING ROCKS LARGER THAN SIX (6) INCHES (15.2 CM) SHALL NOT BE USED. THE UPPERMOST TWO (2) FEET (61 CM) SHALL NOT HAVE ANY ROCK LARGER THAN TWO (2) INCHES (5.1 CM) IN DIAMETER.
5. THE APPROVED FILL SHALL BE PLACED IN EIGHT (8) INCH (20 CM) LOOSE LIFTS. EACH LIFT SHALL BE SPREAD IN UNIFORM LAYERS. FILL SOIL SHALL BE UTILIZED ONLY WITHIN A MOISTURE RANGE OF +/- 5% OF THE OPTIMUM MOISTURE CONTENT. COMPACTION OF THE FILL SHALL BE PERFORMED WITH APPROVED EQUIPMENT. COMPACTION OF THE LAYERS SHALL BE CONTINUOUS AND UNIFORM.
6. EMBANKMENT MATERIAL IN FILL AREAS SHALL BE PLACED IN LIFTS NOT EXCEEDING EIGHT (8) INCHES AND SHALL BE COMPACTED TO A MINIMUM 95% DENSITY IN ACCORDANCE WITH SECTION 303 OF THE VIRGINIA DEPARTMENT OF TRANSPORTATION ROAD AND BRIDGE SPECIFICATIONS.
7. FIELD DENSITY TESTS ARE TO BE CONDUCTED BY AN INDEPENDENT SOILS TESTING LABORATORY UNDER THE DIRECTION OF A QUALIFIED GEOTECHNICAL ENGINEER. THE RESULTS OF THESE TESTS SHALL BE SUBMITTED TO THE CHIEF OF ROCKSKE WITH AS-BUILT PLANS AS A CONDITION OF ACCEPTANCE OF THE FACILITY BY THE COUNTY. FIELD DENSITY TESTS, AS DIRECTED BY THE ENGINEER SHALL BE PERFORMED PERIODICALLY TO DETERMINE THE DEGREE OF COMPACTION. ANY AREAS FAILING TO MEET THE ABOVE REQUIREMENTS SHALL BE REWORKED AND/OR COMPACTED UNTIL THE REQUIRED DEGREE OF COMPACTION IS ACHIEVED.
8. ANTI-SEEP COLLARS SHALL BE INSTALLED IN ACCORDANCE WITH THE REQUIREMENTS OF THE VIRGINIA EROSION AND SEDIMENT CONTROL HANDBOOK, LATEST EDITION.
9. ALL DISTURBED AREAS SHALL BE COVERED WITH FOUR (4) INCHES OF TOPSOIL AND SEEDED.
10. THE MINIMUM SLOPE OF THE BASIN "FLOOR SHALL BE ONE (1) PERCENT GRADED TO DRAIN TO THE PRINCIPAL SPILLWAY.

NO.	TITLE	KEY	SYMBOL	NO.	TITLE	KEY	SYMBOL
3.01	SAFETY FENCE	(SAF)		3.20	ROCK CHECK DAMS	(CD)	
3.02	TEMPORARY GRAVEL CONSTRUCTION ENTRANCE	(CE)		3.21	LEVEL SPREADER	(LS)	
3.03	CONSTRUCTION ROAD STABILIZATION	(CRS)		3.22	VEGETATIVE STREAMBANK STABILIZATION	(VSS)	
3.04	STRAW BALE BARRIER	(STB)		3.23	STRUCTURAL STREAMBANK STABILIZATION	(SSS)	
3.05	SILT FENCE	(SF)		3.24	TEMPORARY VEHICULAR STREAM CROSSING	(VSC)	
3.06	BRUSH BARRIER	(BB)		3.25	UTILITY STREAM CROSSING	(USC)	
3.07	STORM DRAIN INLET PROTECTION	(IP)		3.26	DEWATERING STRUCTURE	(DS)	
3.08	CULVERT INLET PROTECTION	(CIP)		3.27	TURBIDITY CURTAIN	(TC)	
3.09	TEMPORARY DIVERSION DIKE	(DD)		3.28	SUBSURFACE DRAIN	(SD)	
3.10	TEMPORARY FILL DIVERSION	(FD)		3.29	SURFACE ROUGHENING	(SR)	
3.11	TEMPORARY RIGHT-OF-WAY DIVERSION	(RWD)		3.30	TOPSOILING	(TO)	
3.12	DIVERSION	(DV)		3.31	TEMPORARY SEEDING	(TS)	
3.13	TEMPORARY SEDIMENT TRAP	(ST)		3.32	PERMANENT SEEDING	(PS)	
3.14	TEMPORARY SEDIMENT BASIN	(SB)		3.33	SODDING	(SO)	
3.15	TEMPORARY SLOPE DRAIN	(TSD)		3.34	BERMUDA GRASS AND ZOYSIAURASS ESTABLISHMENT	(Z/N)	
3.16	PAVED FLUME	(PF)		3.35	MULCHING	(MU)	
3.17	STORMWATER CONVEYANCE CHANNEL	(SCC)		3.36	SOIL STABILIZATION BLANKETS AND MATTING	(S/ZB)	
3.18	OUTLET PROTECTION	(OP)		3.37	TREES, SHRUBS, VINES AND GROUND COVERS	(VEG)	
3.19	RIPRAP	(RR)		3.38	TREE PRESERVATION AND PROTECTION	(TP)	
				3.39	DUST CONTROL	(DC)	

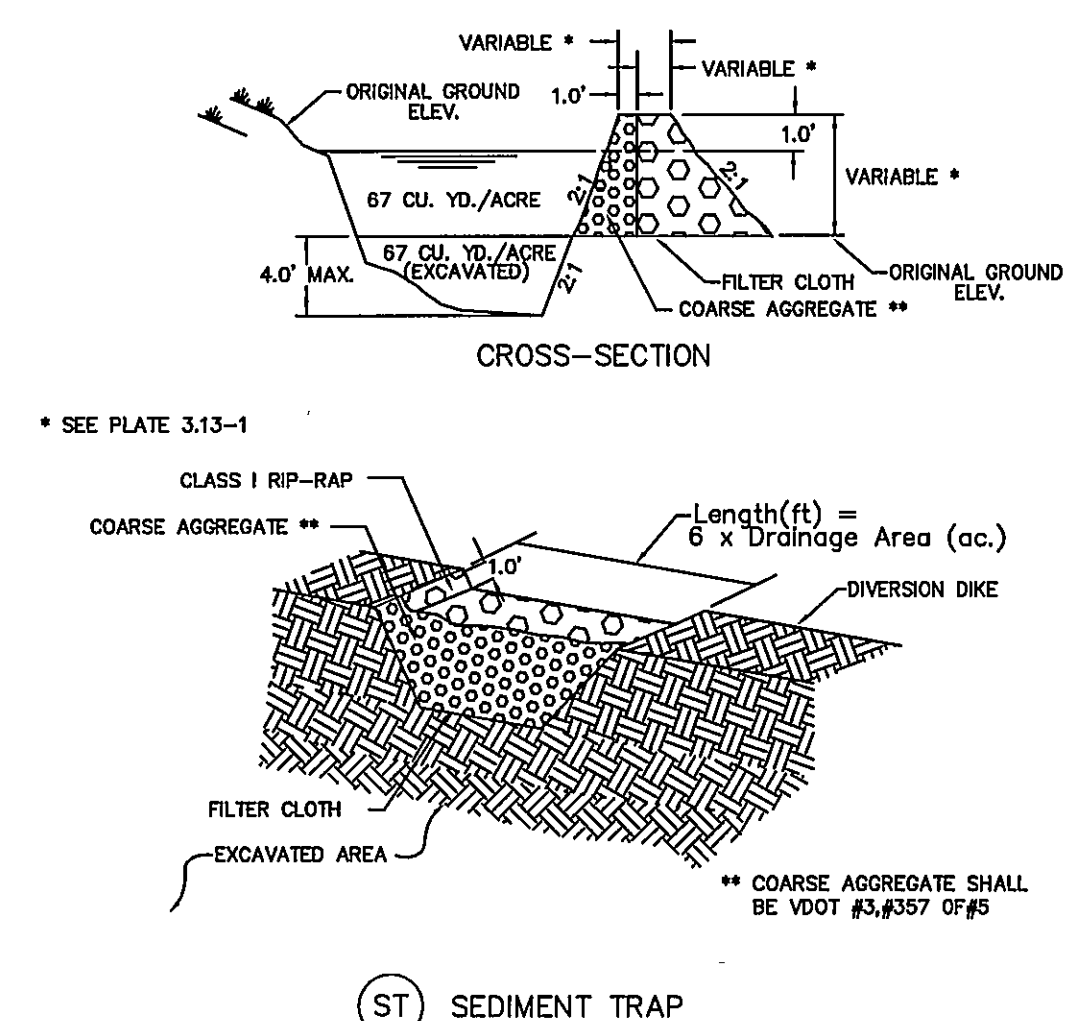

NOTES

For areas less than 3.0 acres. For areas larger than 3.0 acres, A SEDIMENT TRAP, is required. Please see Va' ESC manual for design.

[illegible]

ALL COSTS GIVEN ARE COMPLETE IN PLACE				
DESCRIPTION	UNIT	QUANTITY	UNIT COST	TOTAL COST
CONSTRUCTION ENTRANCE	EA	2	\$ 1,200.00	\$ 2,400.00
SILT FENCE	LF	800	3.00	2,400.00
CONSTRUCTION ROAD STABILIZATION	LF	200	4.00	800.00
RIGHT-OF-WAY DIVERSION	LF	25	3.00	75.00
DIVERSION DIKE/SCC	LF	725	3.00	2,175.00
BLANKET MATTING	SY	1,200	1.50	1,800.00
SEDIMENT TRAP	EA	3	1,000.00	3,000.00
PERMANENT SEEDING	AC	3.0	1,000.00	3,000.00
TEMPORARY SEEDING	AC	3.0	500.00	1,500.00
MULCHING	AC	3.0	250.00	750.00
RIP-RAP	CY			
CHECK DAM	EA	5	250.00	1,250.00
SUB-TOTAL				\$ 19,150.00
10% CONTINGENCY				\$ 1,850.00
TOTAL PROJECT COST				\$ 21,000.00

1. ALL SOIL EROSION & SEDIMENT CONTROL MEASURES SHALL BE ACCOMPLISHED IN STRICT ACCORDANCE WITH THE STANDARDS AND SPECIFICATIONS CONTAINED IN THE VIRGINIA EROSION AND SEDIMENT CONTROL HANDBOOK, LATEST EDITION.
2. THE APPROVING AUTHORITY MAY ADD TO, DELETE, RELOCATE, CHANGE, OR OTHERWISE MODIFY CERTAIN EROSION AND SEDIMENT CONTROL MEASURES WHERE FIELD CONDITIONS ARE ENCOUNTERED THAT WARRANT SUCH MODIFICATIONS.
3. ALL SOIL EROSION AND SEDIMENT CONTROL MEASURES AS SHOWN ON THE PLAN SHALL BE PLACED IN ADVANCE OF THE WORK BEING PERFORMED, AS FAR AS PRACTICAL.
4. IN NO CASE DURING CONSTRUCTION SHALL WATER RUNOFF BE DIVERTED OR ALLOWED TO FLOW TO LOCATIONS WHERE ADEQUATE PROTECTION HAS NOT BEEN PROVIDED.
5. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO LEAVE THE SITE ADEQUATELY PROTECTED AGAINST EROSION, SEDIMENTATION, OR ANY DAMAGE TO ANY ADJACENT PROPERTY AT THE END OF EACH DAY'S WORK.
6. FOR THE EROSION CONTROL KEY SYMBOLS SHOWN ON THE PLANS, REFER TO THE VIRGINIA UNIFORM CODING SYSTEM FOR EROSION AND SEDIMENT CONTROL PRACTICES MAINTAINED IN THE VIRGINIA EROSION AND SEDIMENT CONTROL HANDBOOK, LATEST EDITION. THESE SYMBOLS AND KEYS ARE TO BE UTILIZED ON ALL EROSION CONTROL PLANS SUBMITTED TO ROANOKE COUNTY.

TYPE A

15 OCTOBER TO 1 FEBRUARY
K-31 FESCUE @ 5 LB / 1000 SF
BORZY WINTER RYE @ 1/2 LB / 1000 SF

1 FEBRUARY TO 1 JUNE
K-31 FESCUE @ 5 LB / 1000 SF
ANNUAL RYE @ 1/2 LB / 1000 SF

1 JUNE TO 1 SEPTEMBER
K-31 FESCUE @ 5 LB / 1000 SF
GERMAN MILLET @ 1/2 LB / 1000 SF

1 SEPTEMBER TO 15 OCTOBER
K-31 FESCUE @ 5 LB / 1000 SF
ANNUAL RYE @ 1/2 LB / 1000 SF

TYPE B (SLOPES 3:1 OR STEEPER)

15 MARCH TO 1 MAY
CROWN VETCH @ 1/2 LB / 1000 SF
PERENNIAL RYEGRASS @ 1/2 LB / 1000 SF
RED TOP @ 1/8 LB / 1000 SF

15 OCTOBER TO 1 OCTOBER
CROWN VETCH @ 1/2 LB / 1000 SF
PERENNIAL RYEGRASS @ 1/2 LB / 1000 SF
RED TOP @ 1/8 LB / 1000 SF

LIME: 140 LB / 1000 SF PULVERIZED AGRICULTURAL LIMESTONE

FERTILIZER: 5-20-10 @ 25 LB / 1000 SF
38-0-0 @ 7 LB / 1000 SF

MULCH: IF REQUIRED, SHALL BE USED OVER ALL SEEDED AREAS AND SHALL BE APPLIED IN ACCORDANCE WITH SECTION 1.75 OF THE VIRGINIA EROSION AND SEDIMENT CONTROL HANDBOOK, LATEST EDITION.

SOIL CONDITIONS:
INCORPORATION OF LIME AND FERTILIZER, SELECTION OF CERTIFIED SEED, MULCHING, MAINTENANCE OF NEW SEEDINGS, AND RESEEDING SHALL BE IN ACCORDANCE WITH SPECIFICATIONS CONTAINED WITHIN THE VIRGINIA SOIL EROSION AND SEDIMENT CONTROL HANDBOOK, LATEST EDITION. ADDITIONAL SEEDING TO BE PERFORMED AS REQUIRED BY THE INSPECTOR.

SEED APPLICATION: APPLY SEED UNIFORMLY WITH A CYCLONE SEEDER, DRILL, OULIPFAKER SEEDER, OR HYDROSEEDER ON A FIRM, FRIABLE, SEEDED. MAXIMUM SEEDING DEPTH SHALL BE 1/4 INCH.

TOTAL DISTURBED AREA = 3.0 AC. = 131,000 SQ. FT.

1	ENGR. & INSPEC.	04-10-93
2	ENGR. & INSPEC.	08-05-93
3	ENGR. & INSPEC.	10-27-93
4		
5		
6		
NO.	REVISIONS	DATE

DATE: 11/02/93
SCALE: NO SCALE
DRAWING BY: CLN,AF (G:\CAD\DETAILS\EROS)
DESIGNED BY:
APPROVED BY: GWS,III

SHEET
6 OF 8