


CONDITIONS

1. ALL VALVES, INCLUDING THOSE ON EXIST. MAINS, WILL BE VAULTED ACCORDING TO CITY STANDARDS.
2. ADDITIONAL SERVICES WILL BE ADDED TO PROVIDE A STANDARD 3/4" SERVICE CONNECTION TO EACH LOT, ACCORDING TO CITY OF ROANOKE SPECIFICATIONS, AND TO INCLUDE THE WORK NECESSARY TO BRING THE EXISTING SERVICES TO THIS STANDARD.
3. IT IS HEREBY CERTIFIED THAT EXISTING MAINS ARE ENAMELINED, CLASS 150/22, CAST IRON.

C.F. Kefauver
SIGNED: C.F. KEFAUVER

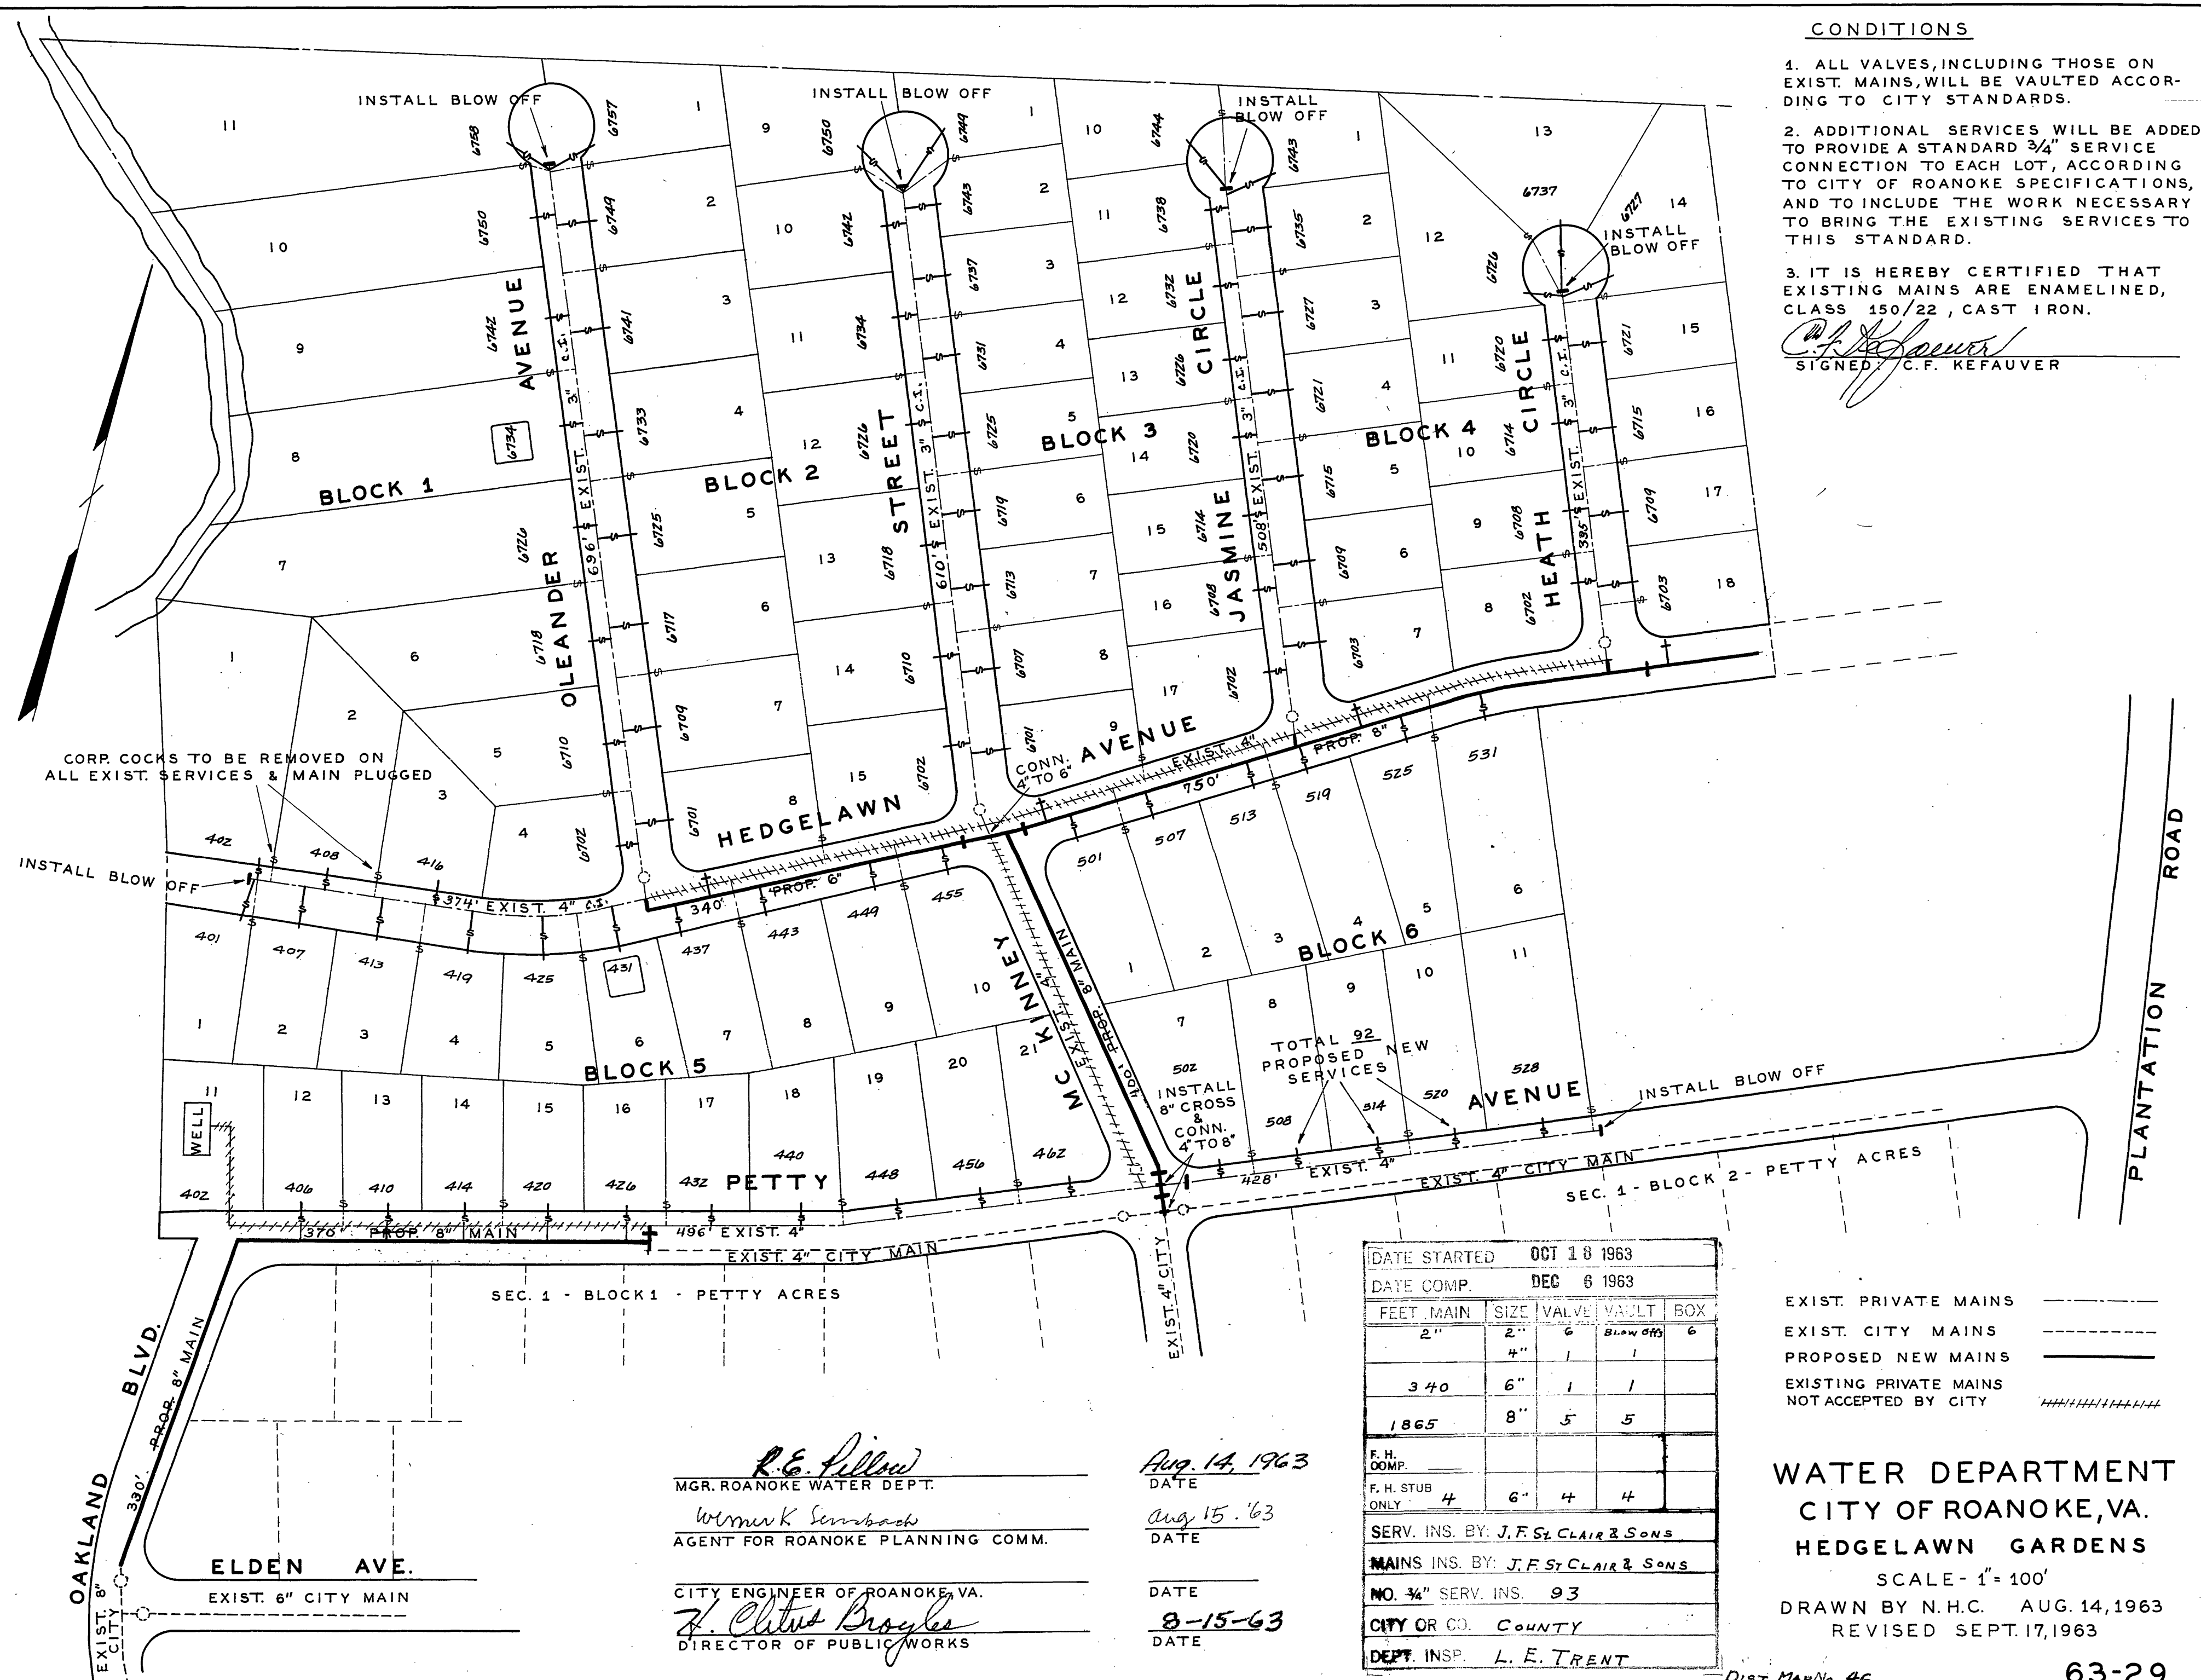

TOTAL 92
PROPOSED NEW
SERVICES

DATE STARTED		OCT 18 1963		
DATE COMP.		DEC 6 1963		
FEET MAIN	SIZE	VALVE	VAULT	BOX
2"	2"	6	BLOW OFF	6
	4"	1	1	
340	6"	1	1	
1865	8"	5	5	
F. H. OOMP.				
F. H. STUB ONLY	4	6"	4	4
SERV. INS. BY: J. F. ST. CLAIR & SONS				
MAINS INS. BY: J. F. ST. CLAIR & SONS				
NO. 3/4" SERV. INS.		93		
CITY OR CO.		COUNTY		
DEPT. INSP.		L. E. TRENT		

EXIST. PRIVATE MAINS
EXIST. CITY MAINS
PROPOSED NEW MAINS
EXISTING PRIVATE MAINS
NOT ACCEPTED BY CITY

WATER DEPARTMENT
CITY OF ROANOKE, VA.
HEDGELAWN GARDENS
SCALE - 1" = 100'
DRAWN BY N.H.C. AUG. 14, 1963
REVISED SEPT. 17, 1963

DIST. MAP No. 46

63-29

R.E. Pillow
MGR. ROANOKE WATER DEPT.
Werner K. Sembrach
AGENT FOR ROANOKE PLANNING COMM.

CITY ENGINEER OF ROANOKE, VA.
Z. Clatus Boyles
DIRECTOR OF PUBLIC WORKS

Aug. 14, 1963
DATE

Aug. 15, '63
DATE

DATE
8-15-63
DATE